ELEVATION NOTES:
GRADE ELEVATIONS SHOWN DO NOT NECESSARILY REFER TO THIS OR ANY OTHER LOT, THEY ARE
FOR DIAGRAMMATIC PURPOSES ONLY AND MAY VARY, BUILDER IS RESPONSIBLE FOR ADAPTING THIS PLAN
TO SUIT THE EXISTING TOPOGRAPHY OF THE SITE,

ROOF VENTILATION TO BE DETERMINED BY BUILDER AS PER CODE.

ALL EGRESS OR RESCUE WINDOWS FROM SLEEPING ROOMS MUST HAVE A MIN, NET CLEAR OPENING OF 4.0 SQ FT, THE MIN NET CLEAR OPENING HEIGHT DIMENSION SHALL BE 22", THE MIN NET CLEAR OPENING WIDTH SHALL BE 20".

EACH EGRESS WINDOW FROM SLEEPING ROOMS MUST HAVE A SILL HIGHT OF NO MORE THAN 44" FROM THE FLOOR. ALL WINDOW SIZES ARE NOMINAL AND ARE TO BE VERIFIED WITH MANUFACTURER FOR AVAILABILITY AND CONFORMITY TO STATE AND LOCAL CODE REQUIREMENTS.

PORCHES, BALCONIES, OR RAISED FLOOR SURFACES LOCATED MORE THAN 30" ABOVE THE FLOOR OR GRADE BELOW SHALL HAVE GUARDRAILS NOT LESS THAN 32" IN HEIGHT.

I ASSUME NO RESPONSIBILITY FOR ANY DISTANCES AFTER START OF CONSTRUCTION.

CONTRACTOR/BUILDER SHALL CONSULT WITH HOME OWNER ON ALL INTERIOR AND EXTERIOR MOLDINGS, TRIMS, COLORS, FINISHES, CABINET LAYOUTS, AND MANUFACTORS BEFORE CONSTRUCTION BEGINS.

ALL BEAMS AND FRAMING MEMBERS ARE SIZED BY OTHERS.


1.1 This plan has been drawn to comply with the 2018 NC Building Code

1.2 Minimum Design Loads for Building and Other Structures ASCE 7-9B

- 2 Roof Dead Load 115 PSF
- 3 Roof Live Load 20 PSF
- 4 Typical Floor Dead Load 10 PSF 5 Floor Live Loads
- 5.1 Rooms other than sleeping rooms 40 PSF
- 5.2 Sleeping Rooms 30 PSF 5.3 Stairs 40 PSF
- 5.4 Decks 40 PSF
- 5.5 Exterior Balconies 60 PSF Wind Loads
- 6.1 Ultimate Design Wind Speeds 15 MPH
- 6.2 Wind Importance Factor, IW 1.00 6.3 Exposure B
- 6.4 Walls (Component and Cladding) 25 PSF
- 6.5 Roofs (Component and Cladding)
  6.5.1 Roof Slopes 2.25/12 to 7/12 34.8 PSF
  - 6.5.2 Roof Slopes 7/12 to 12/12 21 PSF

It is the sole responsibility of the Contractor and/or Builder to conform to all standards, provisions, requirements, methods of construction and uses of materials provided in buildings and/or structures as required by NC Uniform Building Code, Local Agencies and in accordance with good engineering practices. Verify all dimensions prior to construction.

LAMCO CUSTOM BUILDERS/LAMCO HOMES RETAINS TITLE AND OWNERSHIP OF ALL PLANS. THESE PLANS CAN NOT BE COPIED OR REPRODUCED. THESE PLANS CAN NOT BE BUILT BY ANYONE OTHER THAN LAMCO CUSTOM BUILDERS/LAMCO HOMES

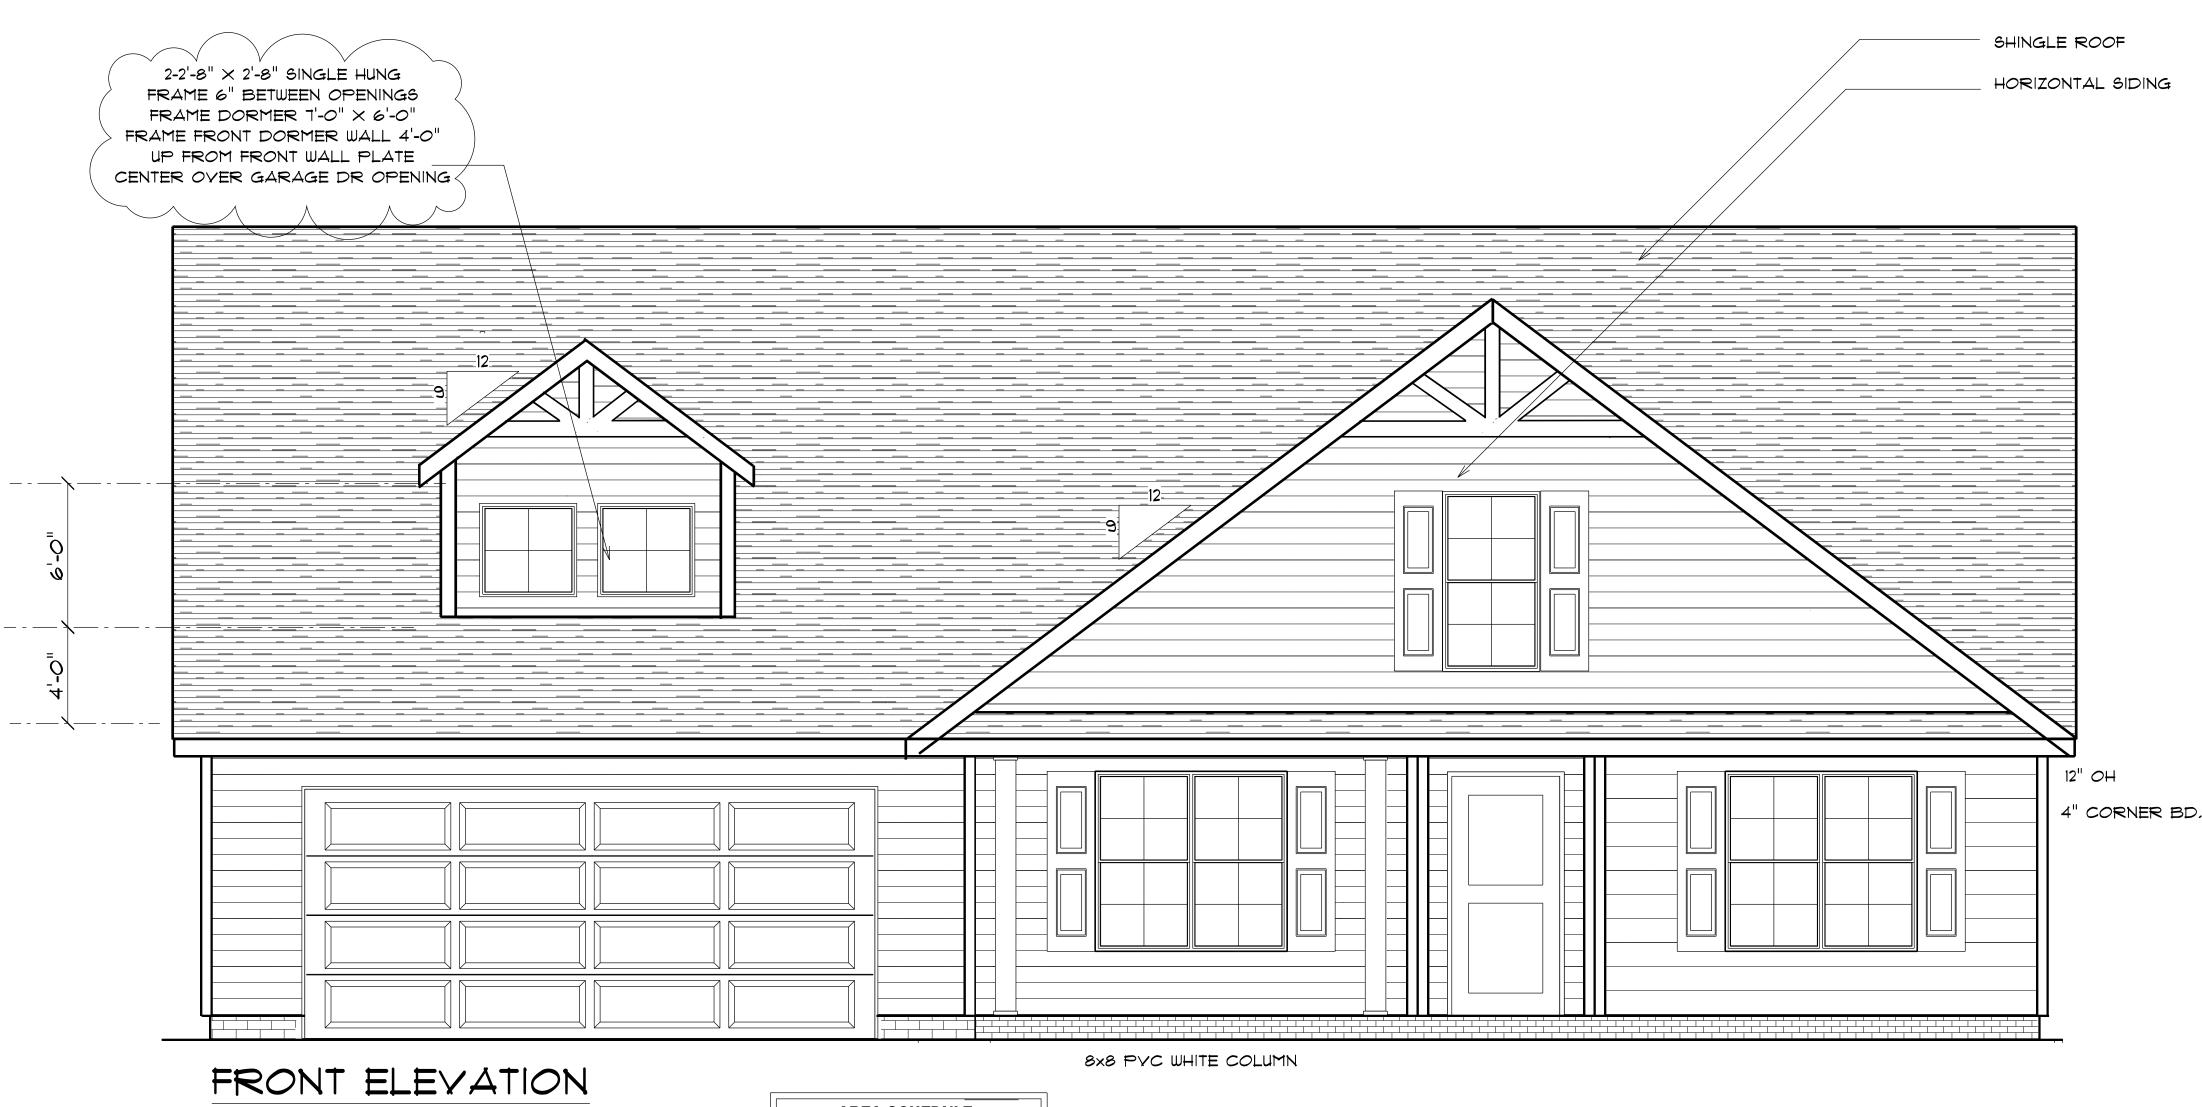

AREA SCHEDULENAMEAREAHeated Floor Area1717.1 sq ft.Garage447.3 sq ft.Covered Porch199.2 sq ft.


Total Fenestration Total Exterior Walls Percentage of wall openings


246 sq. ft. 1752 15%

Above Grade Walls
Surrounding Heated Space

# FENESTRATION CALCULATIONS

	Floor		eight Of kt. Wall	Area Of Ext. Wall	Ext. Wall	
	lst					
]	2nd					
	other	8		1752 1	752	
	1752	1	Total Sq.	. Ft. of Exterior Walls		

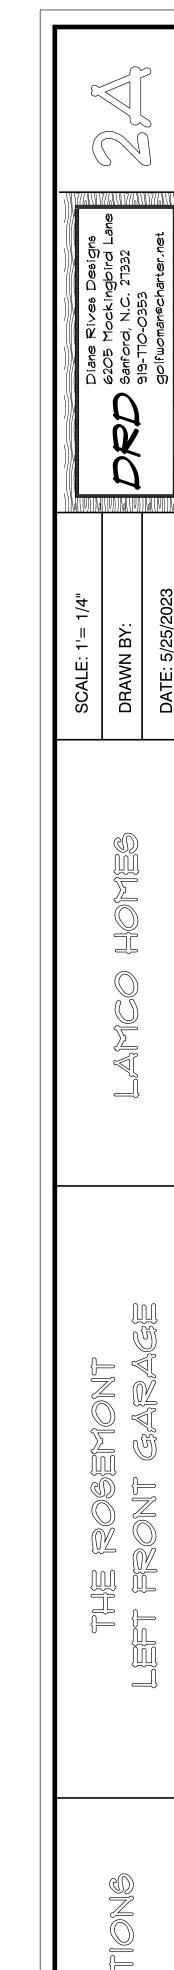

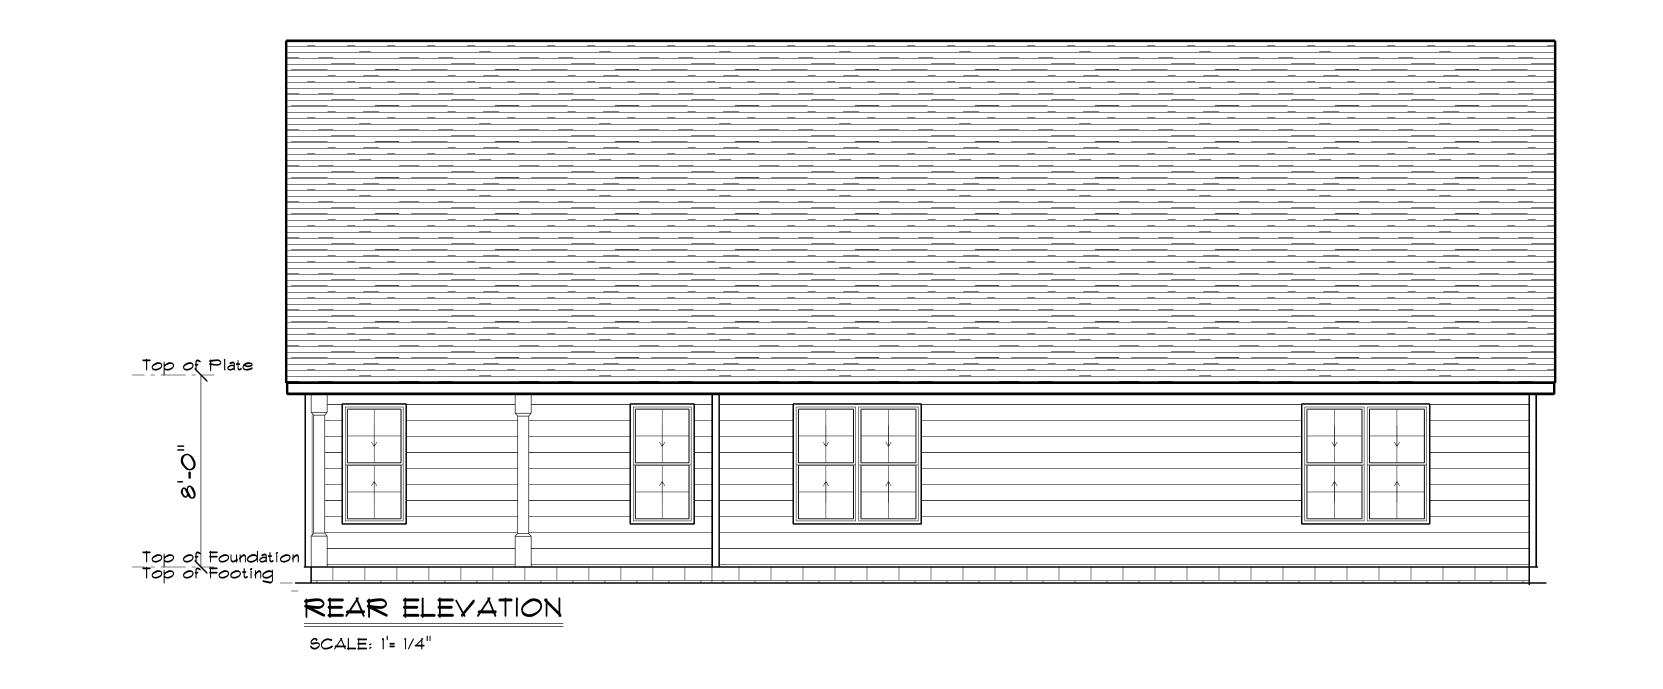




LEFT ELEVATION
SCALE: 1'=/4"

LAMCO CUSTOM BUILDERS/LAMCO HOMES RETAINS TITLE AND OWNERSHIP OF ALL PLANS. THESE PLANS CAN NOT BE COPIED OR REPRODUCED. THESE PLANS CAN NOT BE BUILT BY ANYONE OTHER THAN LAMCO CUSTOM BUILDERS/LAMCO HOMES




RIGHT ELEVATION


SCALE: 1'= 1/4"

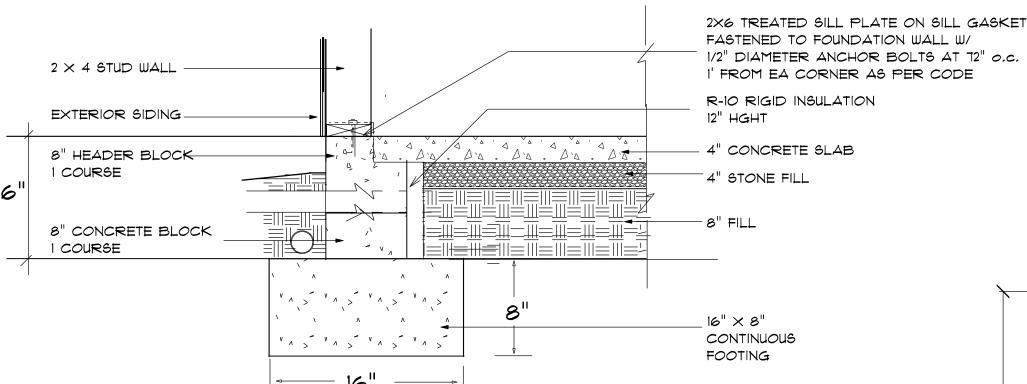

## STEM WALL FOUNDATION Detail not to scale

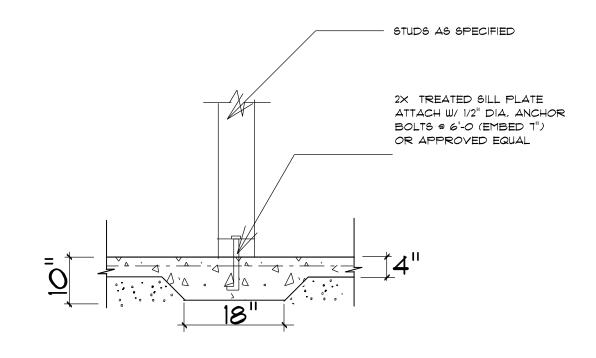

#### TYPICAL THICKENED SLAB

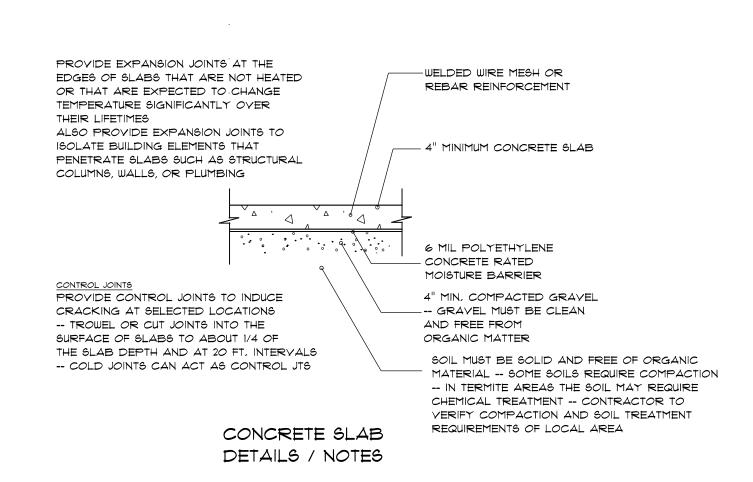

FOUNDATION NOTES:
ALL FOOTINGS SHALL BEAR ON ORIGINAL UNDISTURBED SOIL.
THE 28 DAY COMPRESSIVE STRENGTH OF ALL FOOTINGS IS 3000 PSI
PROVIDE WATER PROOFING AND PERIMETER DRAINS AS REQUIRED.
FOUNDATION CONCRETE MIX TO HAVE 1-1/2" MAX AGGREGATE SIZE, CONCRETE

FILL MIX TO HAVE 1/2" MAX AGGREGATE SIZE,

FOOTING WIDTHS ARE BASED ON A LOAD-BEARING SOIL CAPACITY OF 2000 PSI.

PROVIDE 6 MIL POLY VAPOR BARRIER TO COVER GROUND SURFACE IN CRAWL SPACE

ALL ANCHOR BOLTS TO BE 12" LONG, 1/2" DIA, A36 UNO ANCHOR BOLTS SHALL BE SPACE AT A MAX OF 6' OC AND NO MORE THAN 1' FROM EA CORNER.

Termite Soil Treatment: Treat entire slab area soil or crawl space

surface before vapor barrier is installed and slab is poured

with a state approved termiticide. Termiticide should be applied by a licensed and certified pest control professional

by the state of North Carolina.

50'-9½" 33'-10" 16'-11½" 10'-0" CONTROL JOINT 10'-0 O.C. (MAX) EACH WAY TYPICAL WALL: 8" BLOCK W/ 16"  $\times$  8" FOOTING 4" CONC. SLAB (3000 PSI) FIBER MESH RENF, W/SLICK 20'-4" 4" CONC. SLAB (3000 PSI) OPTIONAL GAS FIREPLACE FIBER MESH RENF, W/SLICK FINISH SCALE: 1'= 1/4" 11'-7%" FOOTING THRU FRONT FOUNDATION WALL 4" BLOCK & BRICK  $W/16" \times 8"$  FOOTING 16'-3" 17'-8½" 12'-1" 2'-41/21 2'-41/2" 21'-0" 29'-9½" 50'-91/2"

### FOUNDATION PLAN

LAMCO CUSTOM BUILDERS/LAMCO HOMES RETAINS TITLE AND

OWNERSHIP OF ALL PLANS. THESE PLANS CAN NOT BE COPIED

OR REPRODUCED. THESE PLANS CAN NOT BE BUILT BY

ANYONE OTHER THAN LAMCO CUSTOM BUILDERS/LAMCO HOMES

SCALE: 1'= 1/4"

OPENING SCHEDULE							
SIZE	COUNT	LIBRARY NAME	R.O. WIDTH	R.O. HEIGHT			
2'-8" x 5'-0"	4	Window\Double Hung	32"	60-1/2"			
2'-8" x 5'-0" Dbl	4	Window\Double Hung	64-1/2"	60-1/2"			
2'-0" x 3'-0"	2	Window\Double Hung	24"	36"			
4'-0" x 3'-0"	1	Window\Double Hung	48"	36"			

GENERAL FRAMING NOTES:

ALL LUMBER IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED

FRAMING LUMBER SHALL BE SYP #2 GRADE AND/OR SPRUCE PINE FIR \*I AND/OR \*2, KILN DRIED.

WHERE PRE-ENGINEERED JOISTS ARE USED, JOIST MANUFACTURER SHALL

PROVIDE SHOP DRAWINGS, WHICH BEAR SEAL OF A N.C. ENGINEER.

STUDS AND JOISTS SHALL NOT BE CUT TO INSTALL PLUMBING OR WIRING WITHOUT ADDING METAL OR WOOD SIDE PANELS TO STRENGTHEN THE MEMBER TO ITS ORIGINAL CAPACITY.

NAIL MULTIPLE MEMBERS WITH 2 ROWS OF 16d NAILS STAGGERED 32" OC AN USE 3-16d NAILS 2" IN AT EACH END. DOUBLE ALL STUDS UNDER ROOF POST DOWNS UND.

NAIL FLOOR JOISTS TO SILL PLATE WITH 8d TOE NAILS.

ALL EXPOSED FRAMING ON PORCHES AND DECKS SHALL BE PRESSURE TREATED.


PROVIDE WATERPROOFING AND DRAINS AS REQUIRED. ALL FRAMING TO BE 16" OC UNO. WALL FRAMING DIMENSIONS ARE BASED ON 2  $\times$  4 STUDS UNO. DOUBLE STUDS UNDER ALL HEADERS.

LVL'S AND TJI'S TO BE SIZED BY OTHERS

EXTERIOR WALLS IN LIVING AREAS ARE 2 X 4


It is the sole responsibility of the Contractor and/or Builder to conform to all standards, provisions, requirements, methods of construction and uses of materials provided in buildings and/or structures as required by NC Uniform Building Code, Local Agencies and in accordance with good engineering practices. Verify all dimensions prior to construction.

LAMCO CUSTOM BUILDERS/LAMCO HOMES RETAINS TITLE AND OWNERSHIP OF ALL PLANS. THESE PLANS CAN NOT BE COPIED OR REPRODUCED. THESE PLANS CAN NOT BE BUILT BY ANYONE OTHER THAN LAMCO CUSTOM BUILDERS/LAMCO HOMES

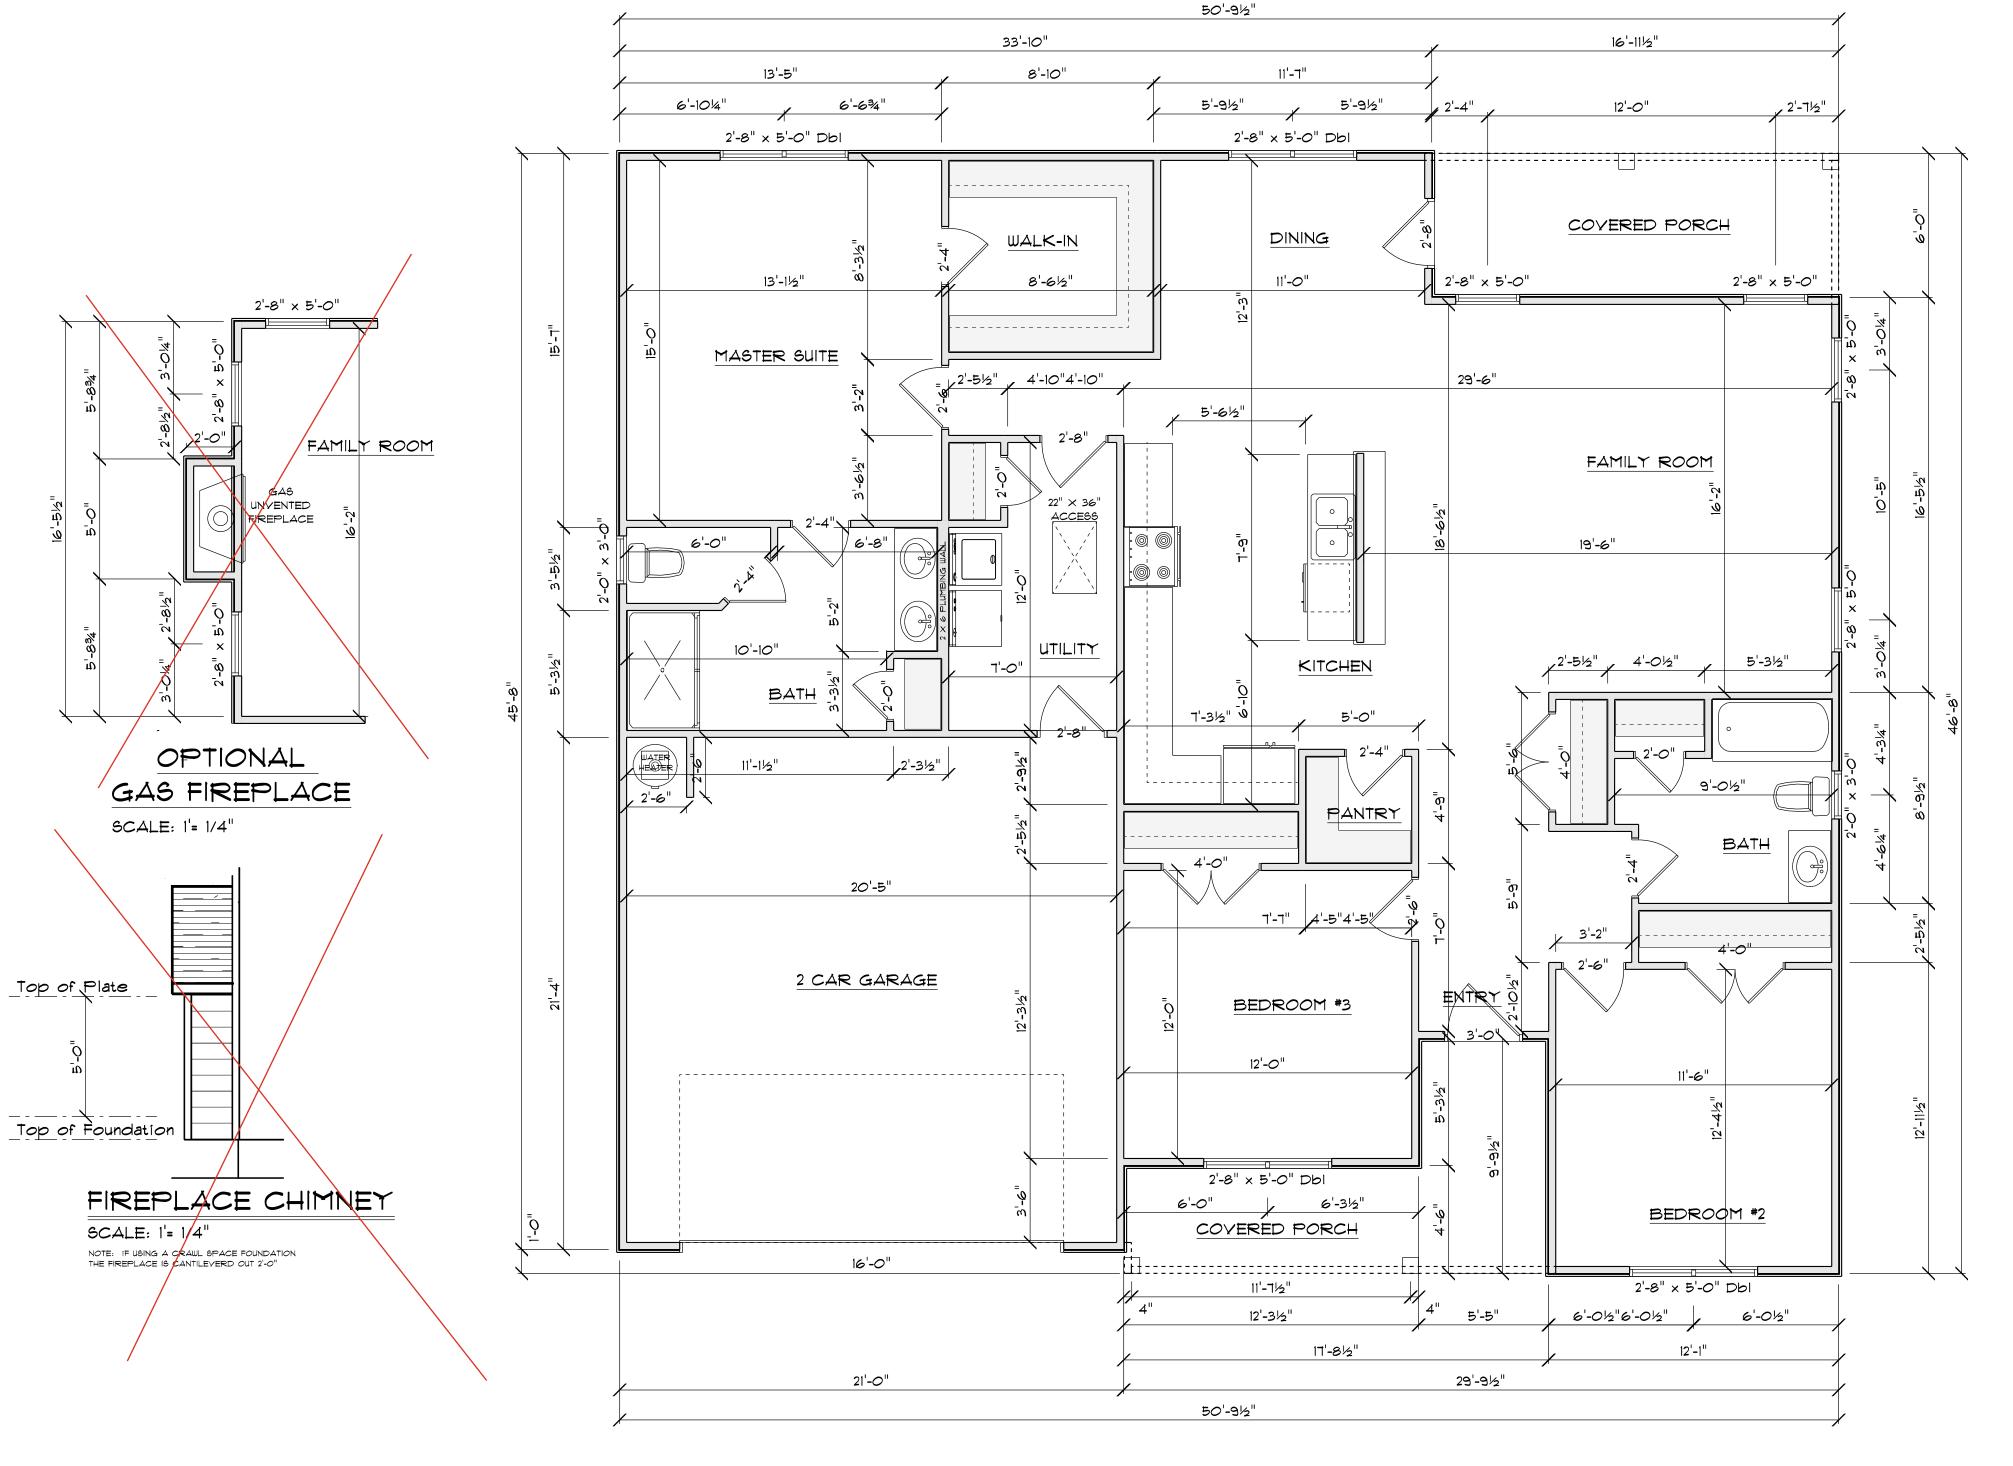

#### FLOOR PLAN

SCALE: 1'= 1/4"

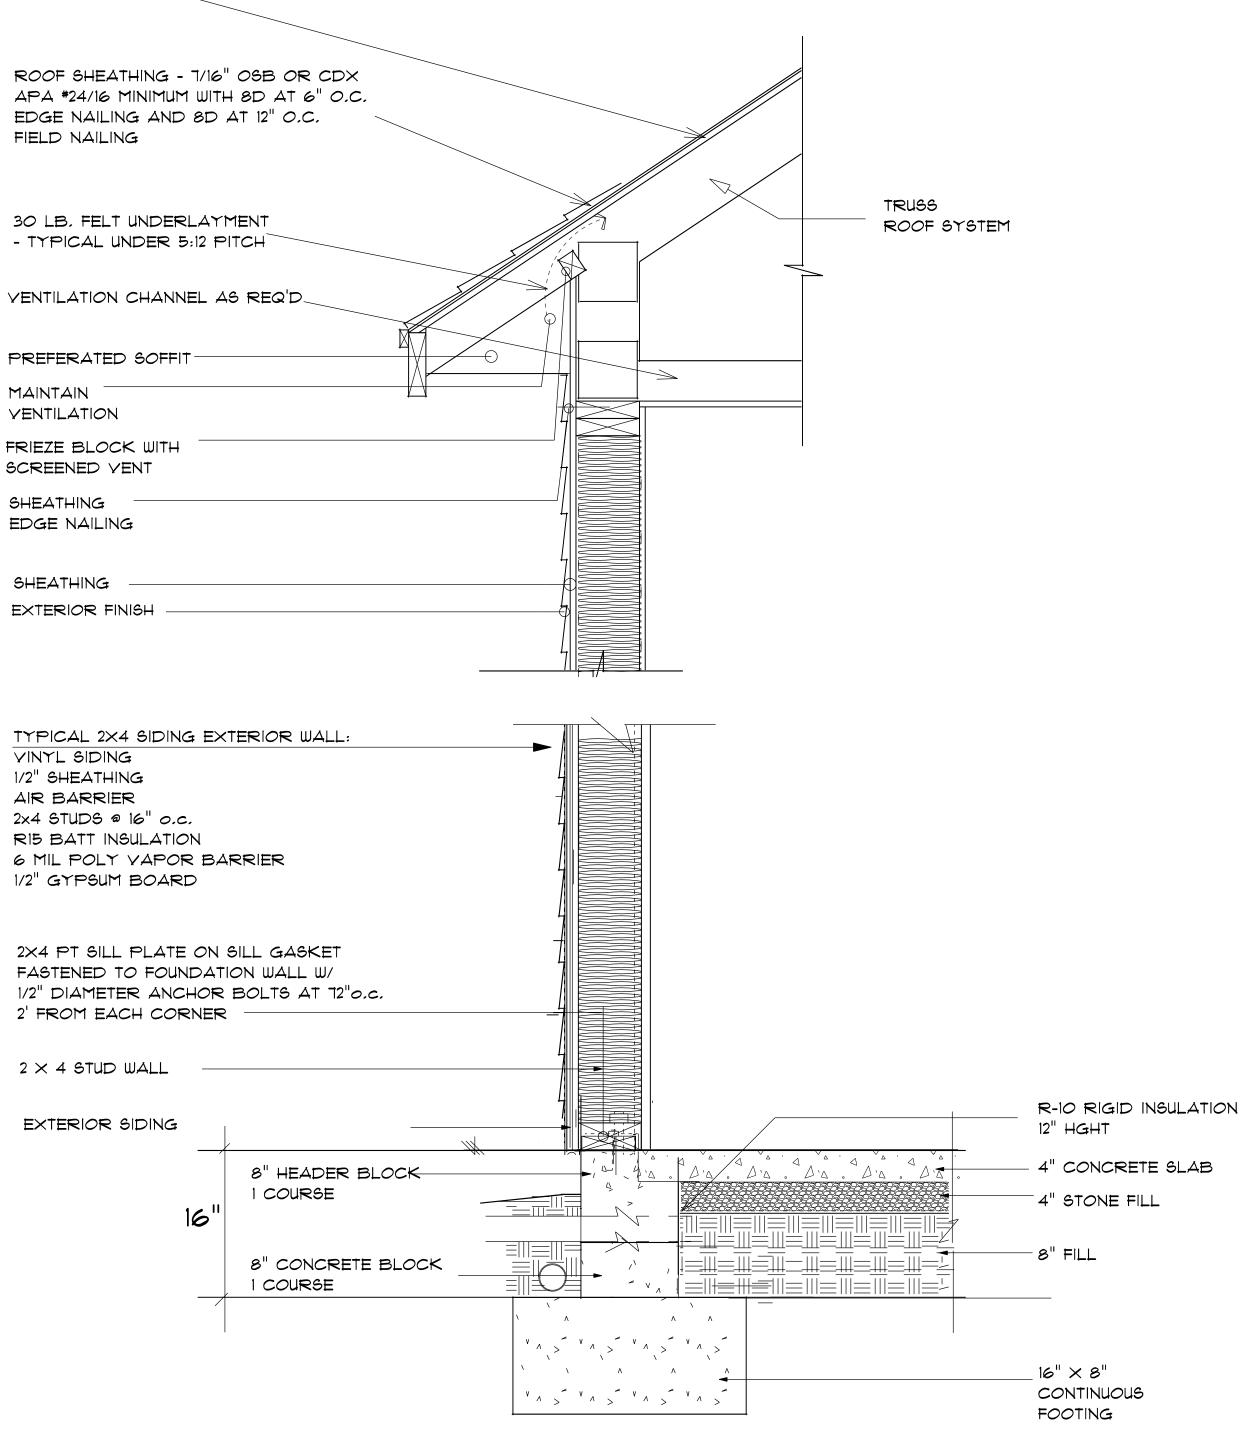


2x4/SIDING STEM WALL FOUNDATION not to scale

LAMCO CUSTOM BUILDERS/LAMCO HOMES RETAINS TITLE AND OWNERSHIP OF ALL PLANS. THESE PLANS CAN NOT BE COPIED OR REPRODUCED. THESE PLANS CAN NOT BE BUILT BY ANYONE OTHER THAN LAMCO CUSTOM BUILDERS/LAMCO HOMES

SHINGLE ROOF

TYPICAL TRUSS ROOF: SHINGLES 7/16" ROOFING PLYWOOD c/w 'H' CLIPS BLOCK & BRACE PER TRUSS MGR. PRE-ENGINEERED TRUSSES @ 24" o.c. 2×4 TRUSS BRACING TYPICAL 2x4 SIDING EXTERIOR WALL: R38 BLOWN INSULATION VINYL SIDING 5/8" CEILING BOARD 7/16" PLYWOOD SHEATHING TAPED & SANDED 2x4 STUDS @ 16" 0.c. RI3 BATT INSULATION 1/2" DRYWALL TYPICAL 2x4 WALL: TAPED & SANDED 1/2" DRYWALL TAPED & SANDED 2×4 STUDS @ 16" o.c. 1/2" DRYWALL TAPED & SANDED Top of Plate Top of Foundation
Top of Footing SECTION

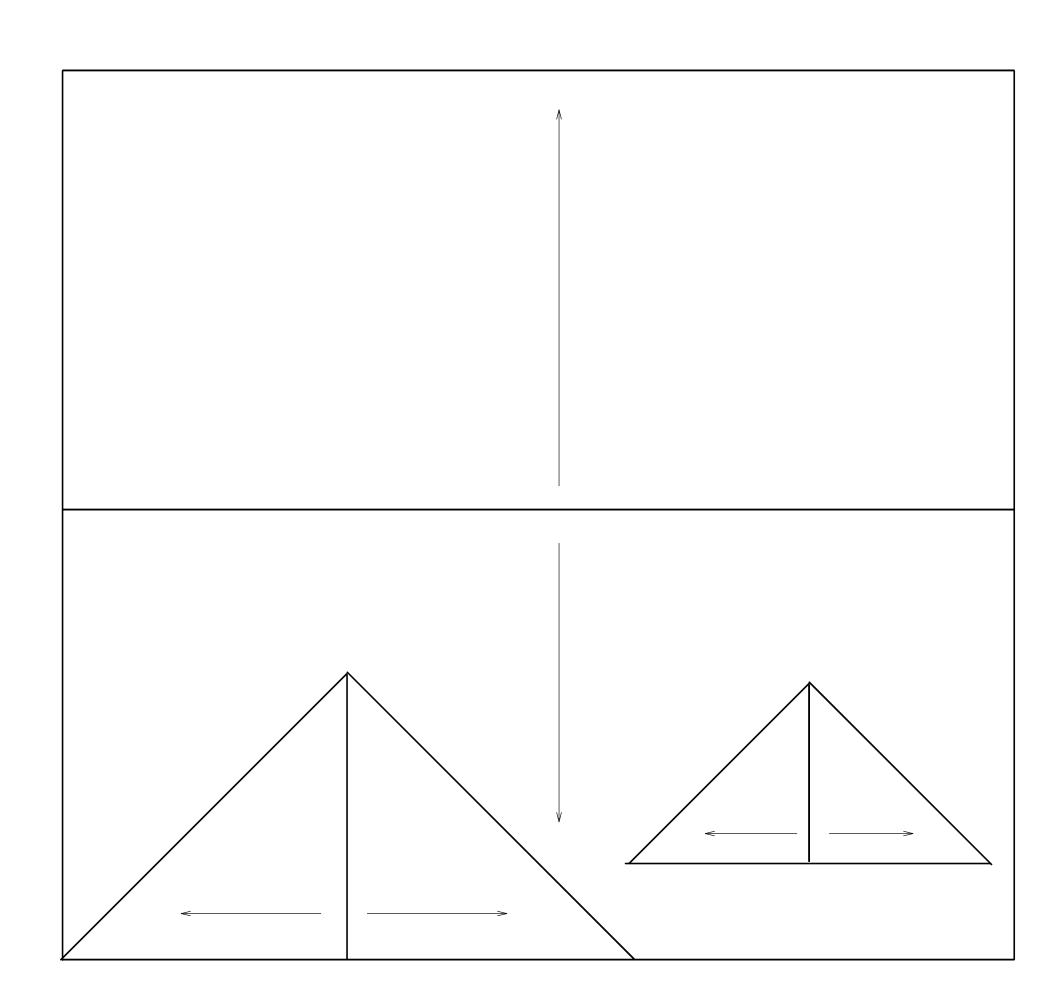

ROOF NOTES:

TRUSSES, BRACINGS, BRIDGING AND CONNECTORS ARE TO BE DESIGNED BY THE TRUSS MANUFACTURER.

SCALE: 1'= 1/4"

IDENTIFY LUMBER BY OFFICIAL GRADE MARKINGS.

DO NOT CUT OR REMOVE CHORDS OR OTHER TRUSS MEMBERS. DO NOT NOTCH OR DRILL TRUSS MEMBERS.

WHERE PRE-ENGINEERED ROOF TRUSSES ARE USED, TRUSS
MANUFACTURER SHALL PROVIDE SHOP DRAWINGS, WHICH BEAR SEAL
OF A N. C. REGISTERED ENGINEER.

ROOF PLAN

12" OH ALL 1/12 PITCH

SCALE: 1'= 3/16"

9/12 PITCH SHED DORMER

