




Front Elevation
Scale: 1/4" = 1'0"



Rear Elevation
Scale: 1/8" = 1'0"



Right Elevation
Scale: 1/8" = 1'0"

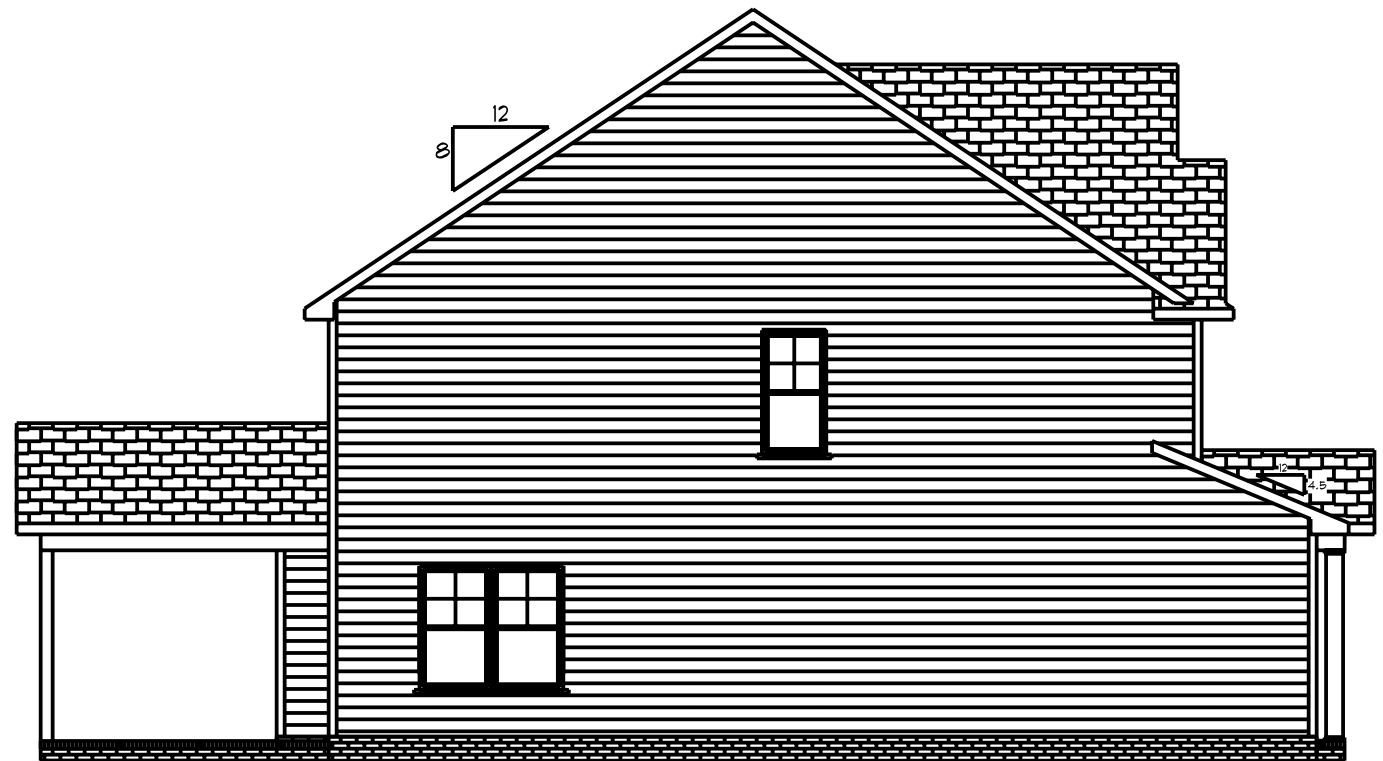

Left Elevation
Scale: 1/8" = 1'0"

DATE: Monday, July 22, 2024

REVISED

DRAWING#

SCALE: 1/4"

DRAWN BY


APPROVED

Plan #10



Areas


First Floor	842
Second Floor	1139
=====	
Total Heated	1981
Garage	437
Front Porch	76
Rear Porch	167

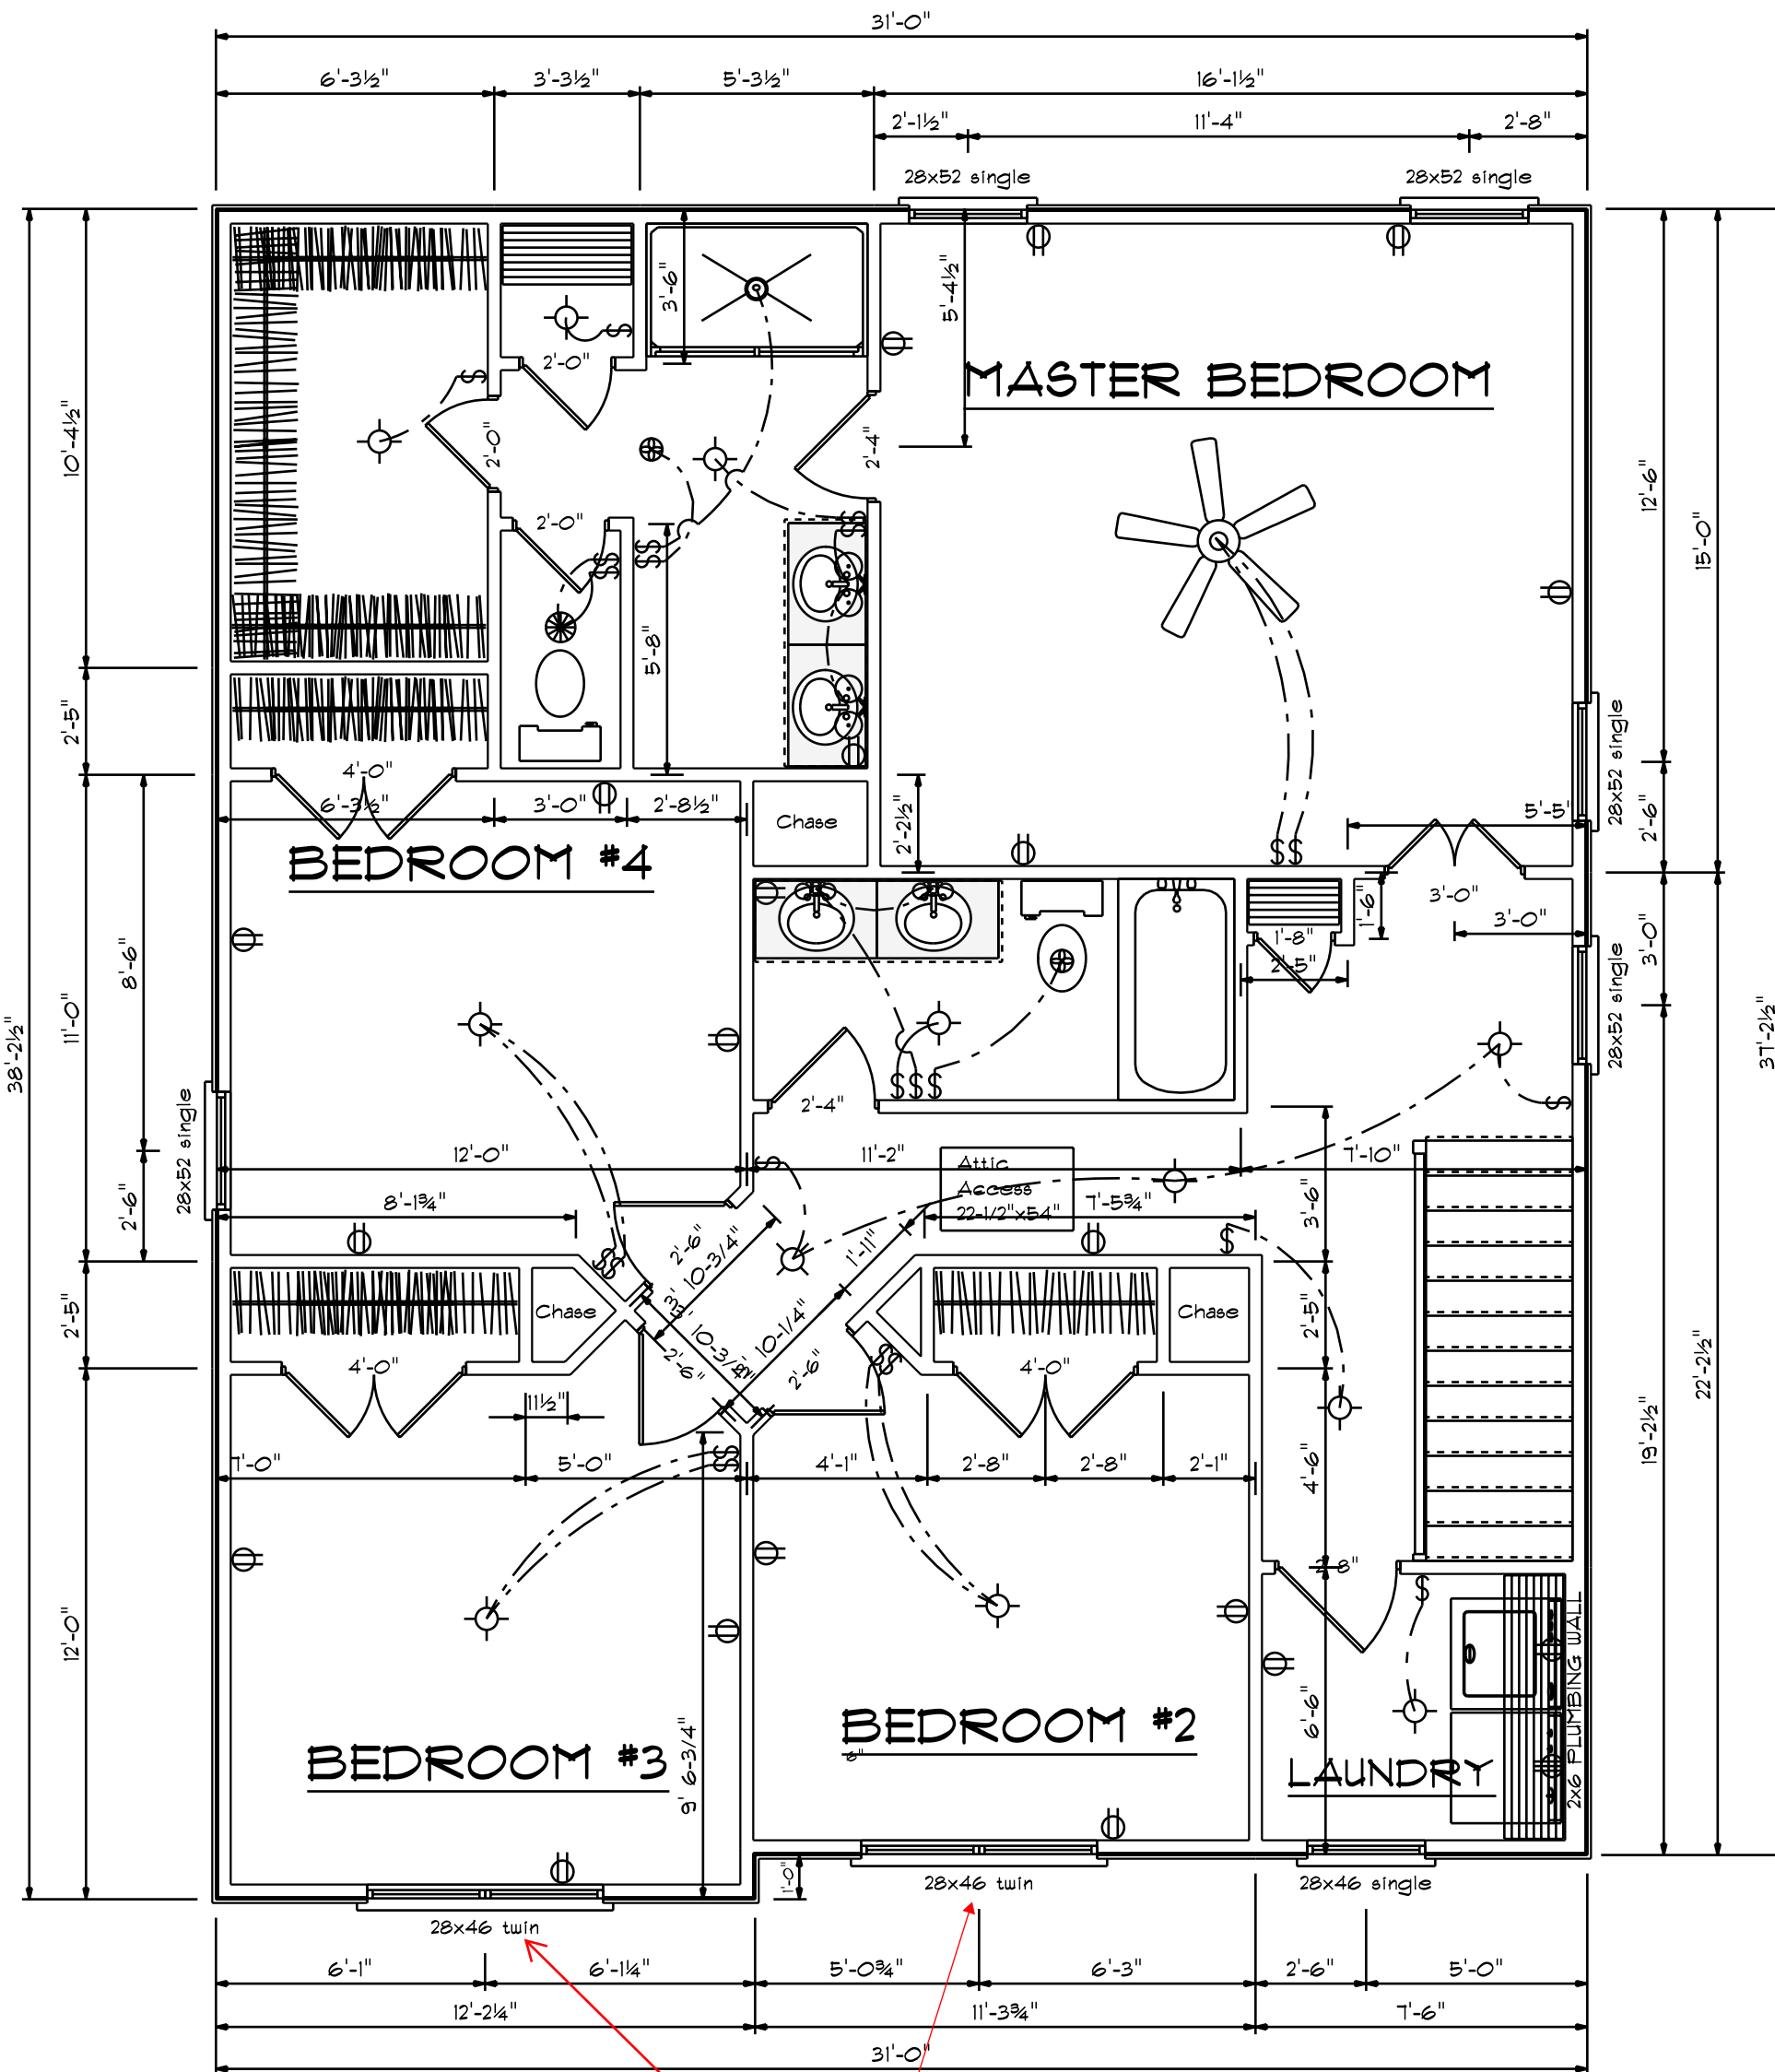

Second Floor Plan

Scale: 1/4" = 1'-0"

FIELD VERIFY
EGRESS
COMPLIANCE

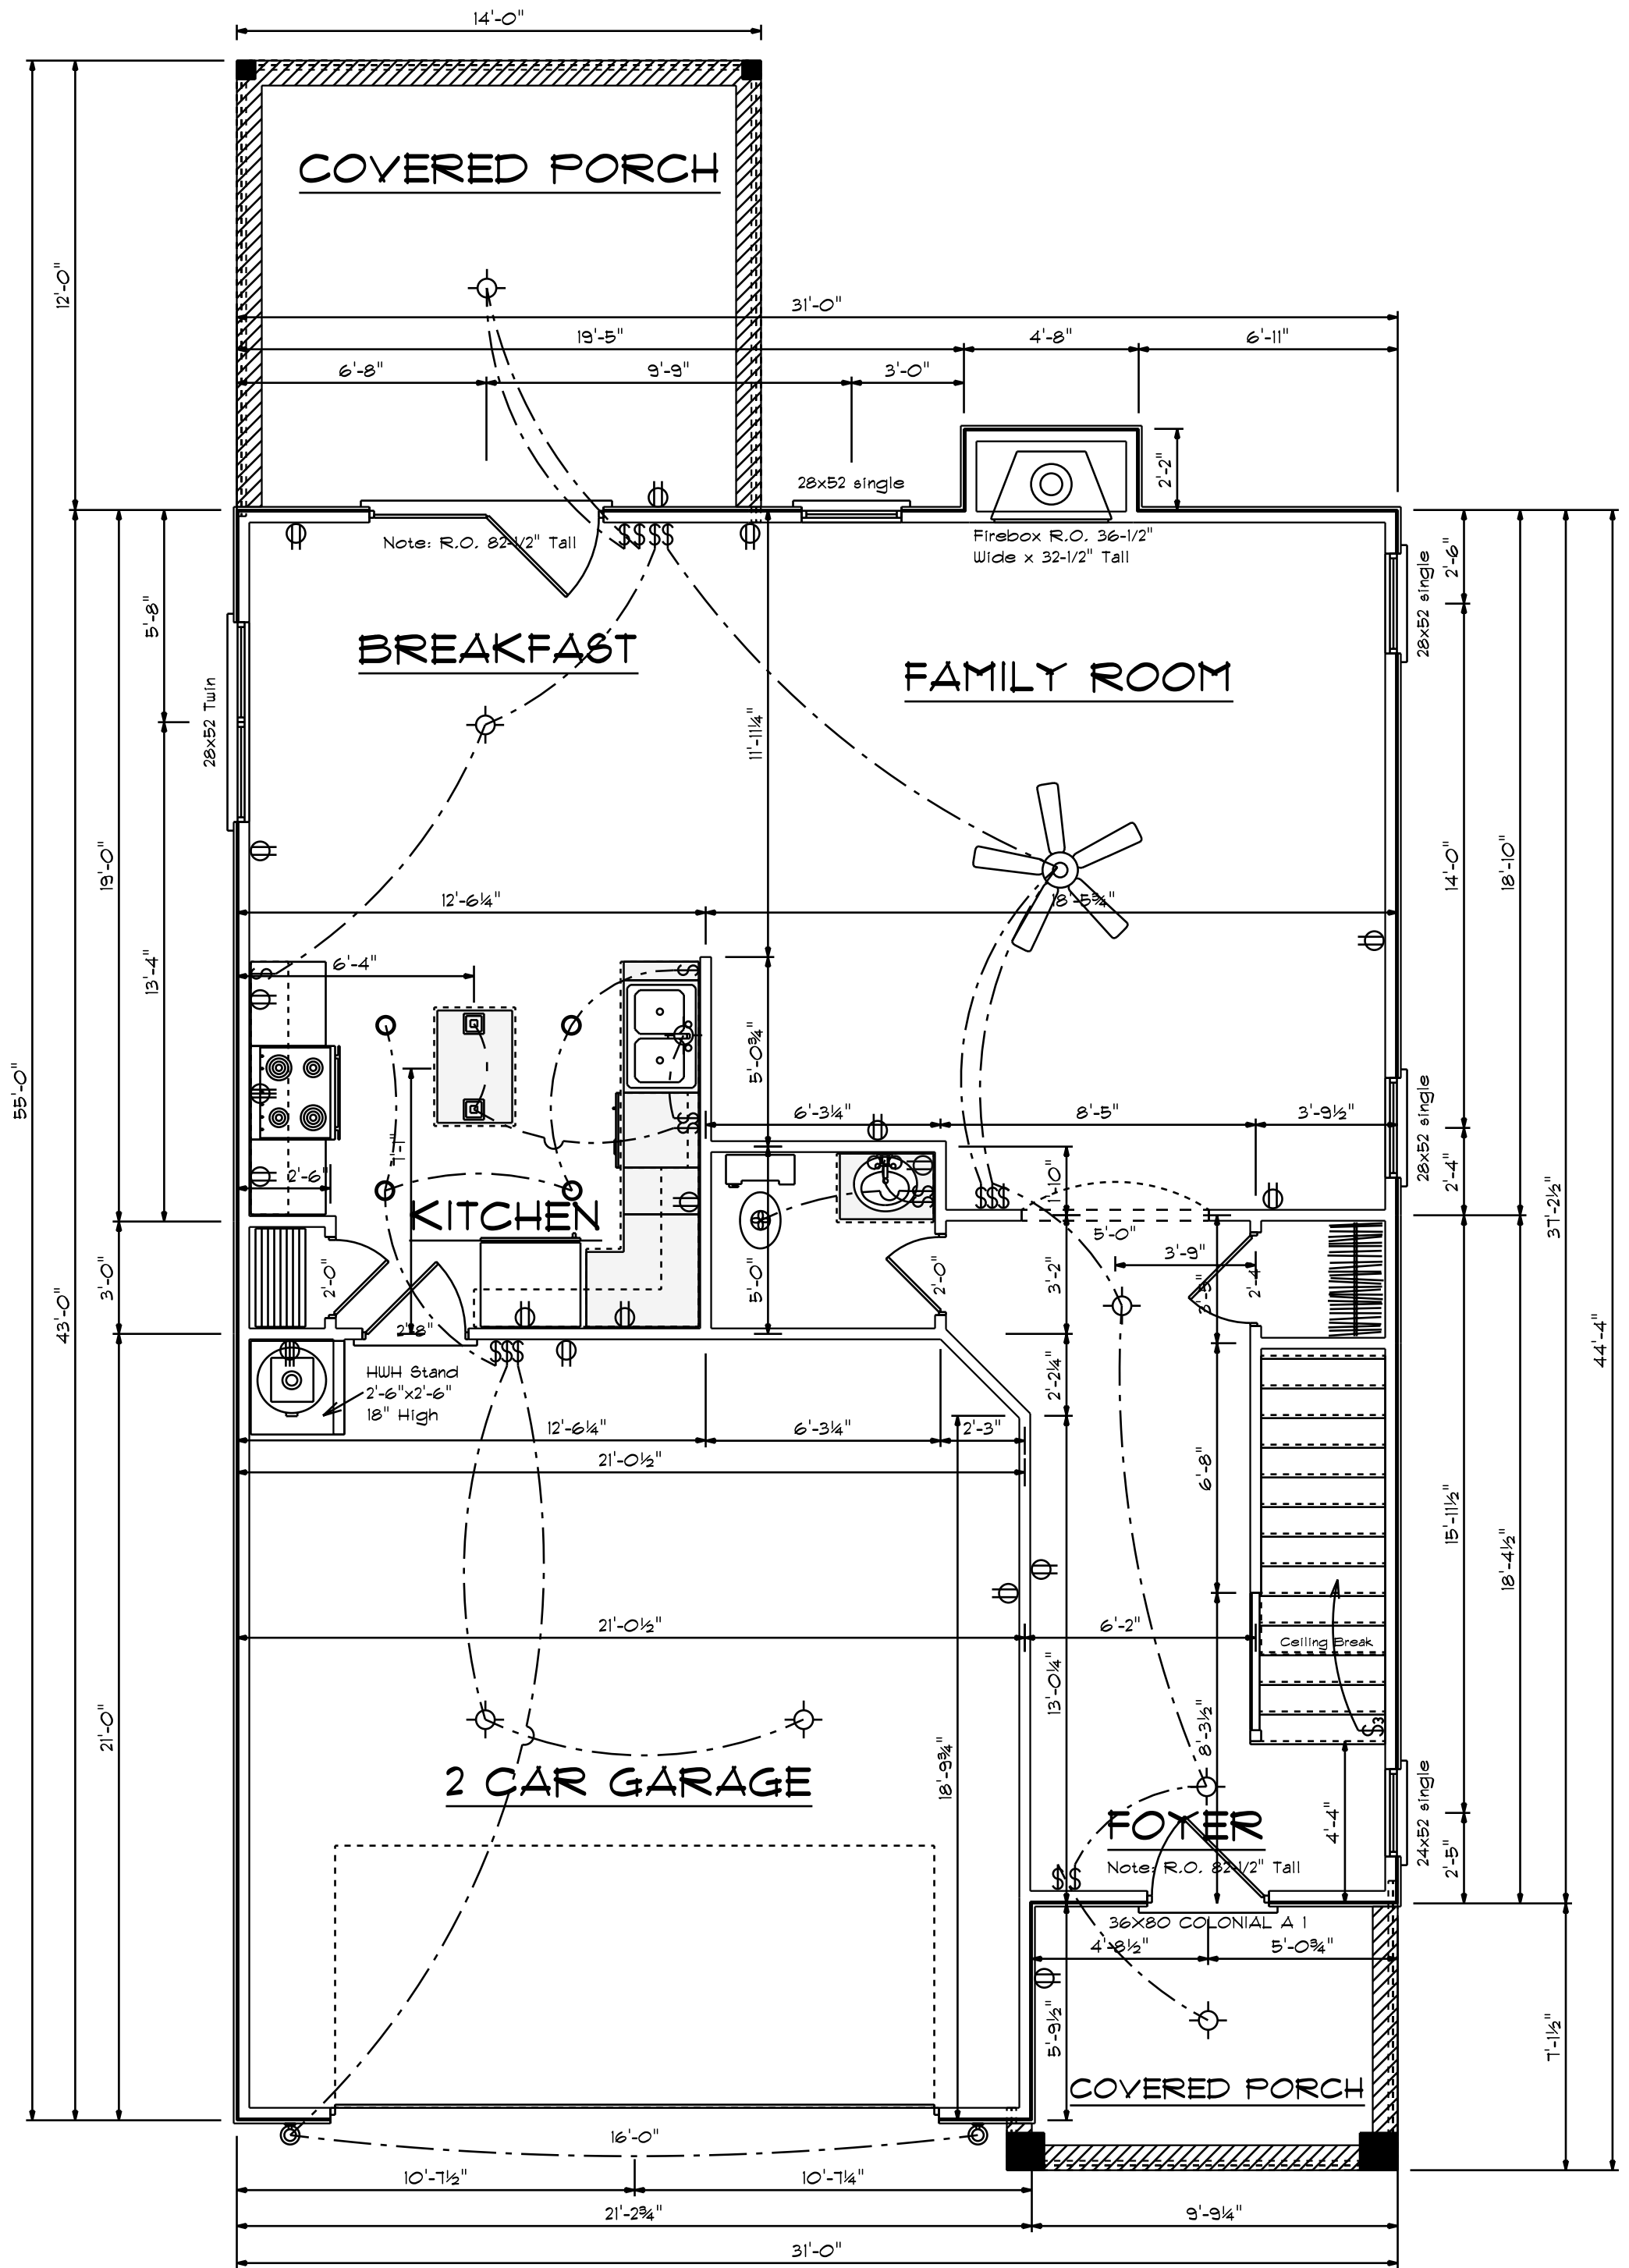

First Floor Plan

Scale: 1/4" = 1'-0"

DATE: Monday, July 22, 2024

REVISED




DRAWING#

SCALE: 1/4"

DRAWN BY

APPROVED

Plan #10

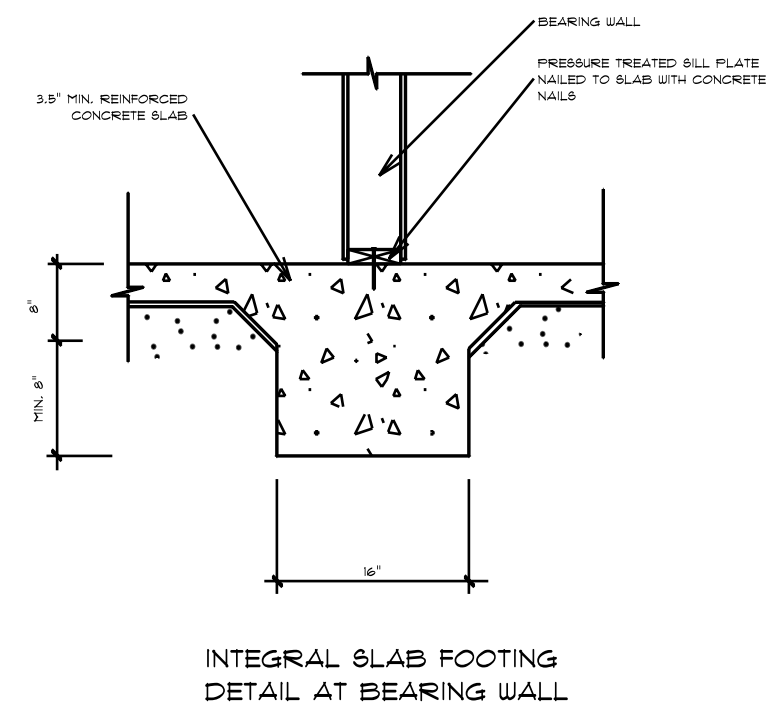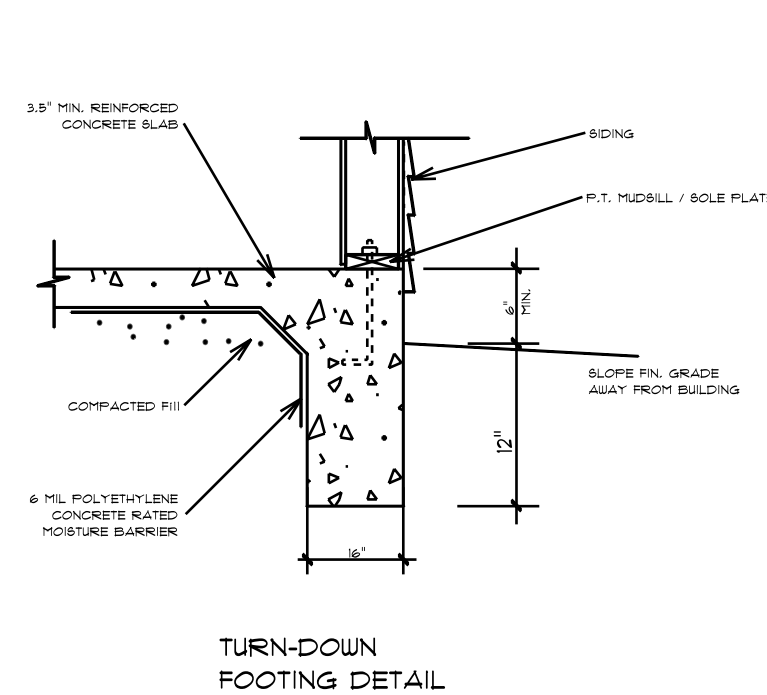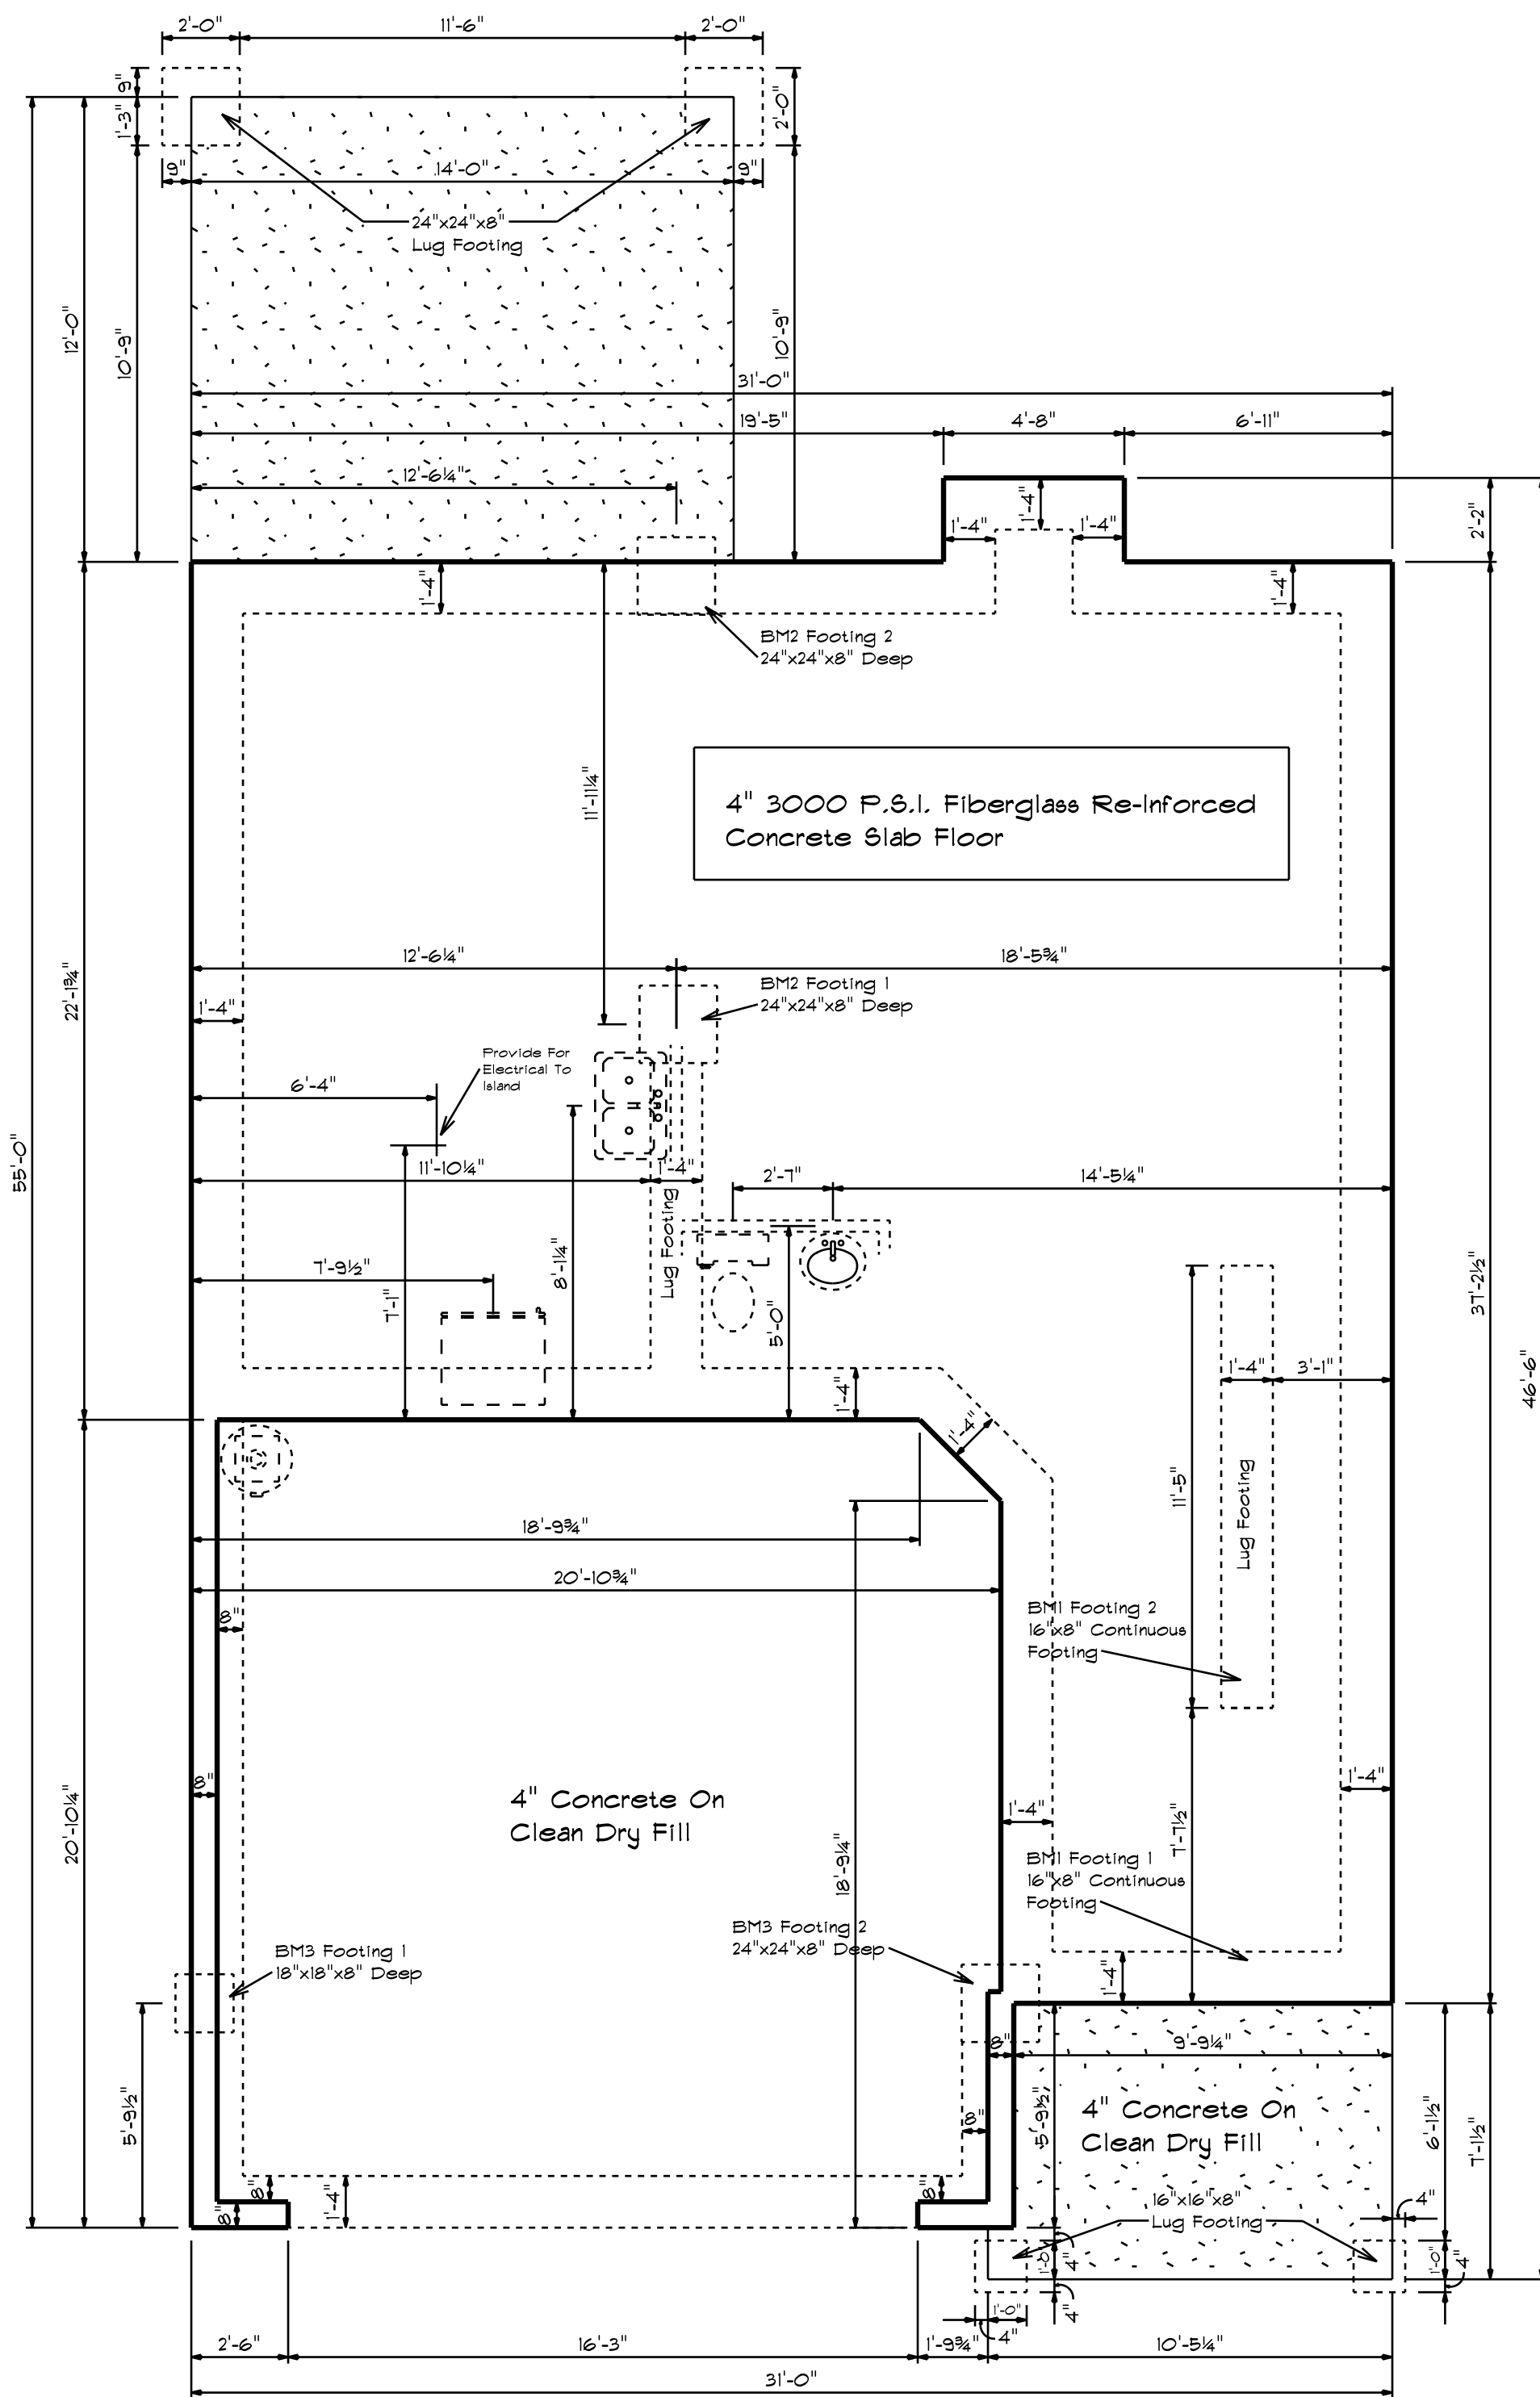


Foundation Plan
Scale: 1/4" = 1'-0"



Carter Sanford Component Plant
298 Harvey Faulk Rd
Sanford, NC 27332

Phone #:919-775-1450

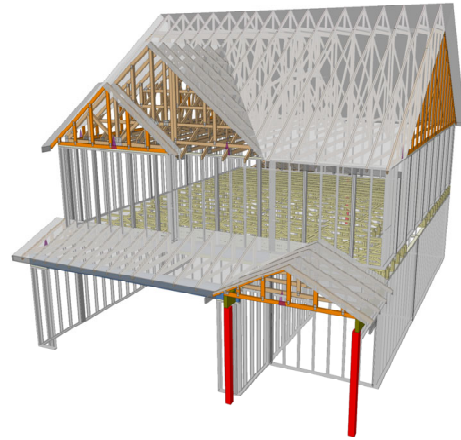

Builder: Wellco Contractor

**Model: 127 Hidden Lakes - Plan 10
GLH**

THE PLACEMENT PLAN NOTES:

1. The Placement Plan is a diagram for truss installation. It is not an engineered drawing and has not been reviewed by an engineer. The Owner/Building Designer is responsible for obtaining an engineer's review if one is required by the local jurisdiction.
2. The responsibilities of the Owner, Contractor, Building Designer, Component Designer and Component Manufacturer shall be as set forth in ANSI/TPI 1. Capitalized terms shall be as defined in ANSI/TP 1 unless otherwise indicated.
3. Each Component is designed as an individual component utilizing information provided by others. The Owner/Building Designer is responsible for reviewing all Component Submittal Packages and individual Component Design Drawings for compliance with the Construction Documents and compatibility with the overall Building design.
4. Contractor will not proceed with component installation until the Owner/Building Designer has reviewed the Component Submittal Package. Questions on the suitability of any Component will be resolved by the Building Designer.
5. The Building Designer and Contractor are responsible for all temporary and permanent bracing.
6. The Placement Plan assumes the building is dimensionally correct, structurally sound, and in a suitable condition to support each Component during installation and thereafter, including but not limited to installation of all bearing points. Proper design and construction of all structural components, including foundations, headers, beams, walls and columns are the responsibility of the Owner, Building Designer and Contractor.
7. Do not cut, drill, or modify any Component without first consulting the Component Manufacturer or Building Designer. Damaged Components shall not be installed unless directed by the Building Designer or approved by the Component Manufacturer.
8. Components must be handled and installed following all applicable safety standards and best practices, including but not limited to BCSI, OSHA, TPI and local codes. Failure to properly handle, brace or otherwise install Component can result in serious injury or death.
9. All uplift connectors shown within these documents are recommendations only. Per ANSI/TPI 1, all uplift connectors are the responsibility of the building designer and or contractor.



Approved By: _____

Date: _____

General Notes:

General Notes: ** CUTTING OR DRILLING OF COMPONENTS SHOULD NOT BE DONE WITHOUT CONTACTING COMPONENT SUPPLIER FIRST. CUSTOMER TAKES FULL RESPONSIBILITY FOR COMPONENTS IF CUT BEFORE AUTHORIZATION. ** ALL POINT LOADS FROM ABOVE MUST BE TRANSFERRED TO BEARING FROM UNDER SIDE OF SHEATHING.

*** FRAMER MUST REFER TO PLANS WHILE SETTING COMPONENTS. ***
 *** DAMAGED COMPONENTS SHOULD NOT BE INSTALLED UNLESS TOLD TO BY THE COMPONENT PLANT. ***
 *** ALL BEARING POINTS MUST BE INSTALLED PRIOR TO SETTING ANY COMPONENTS. ***

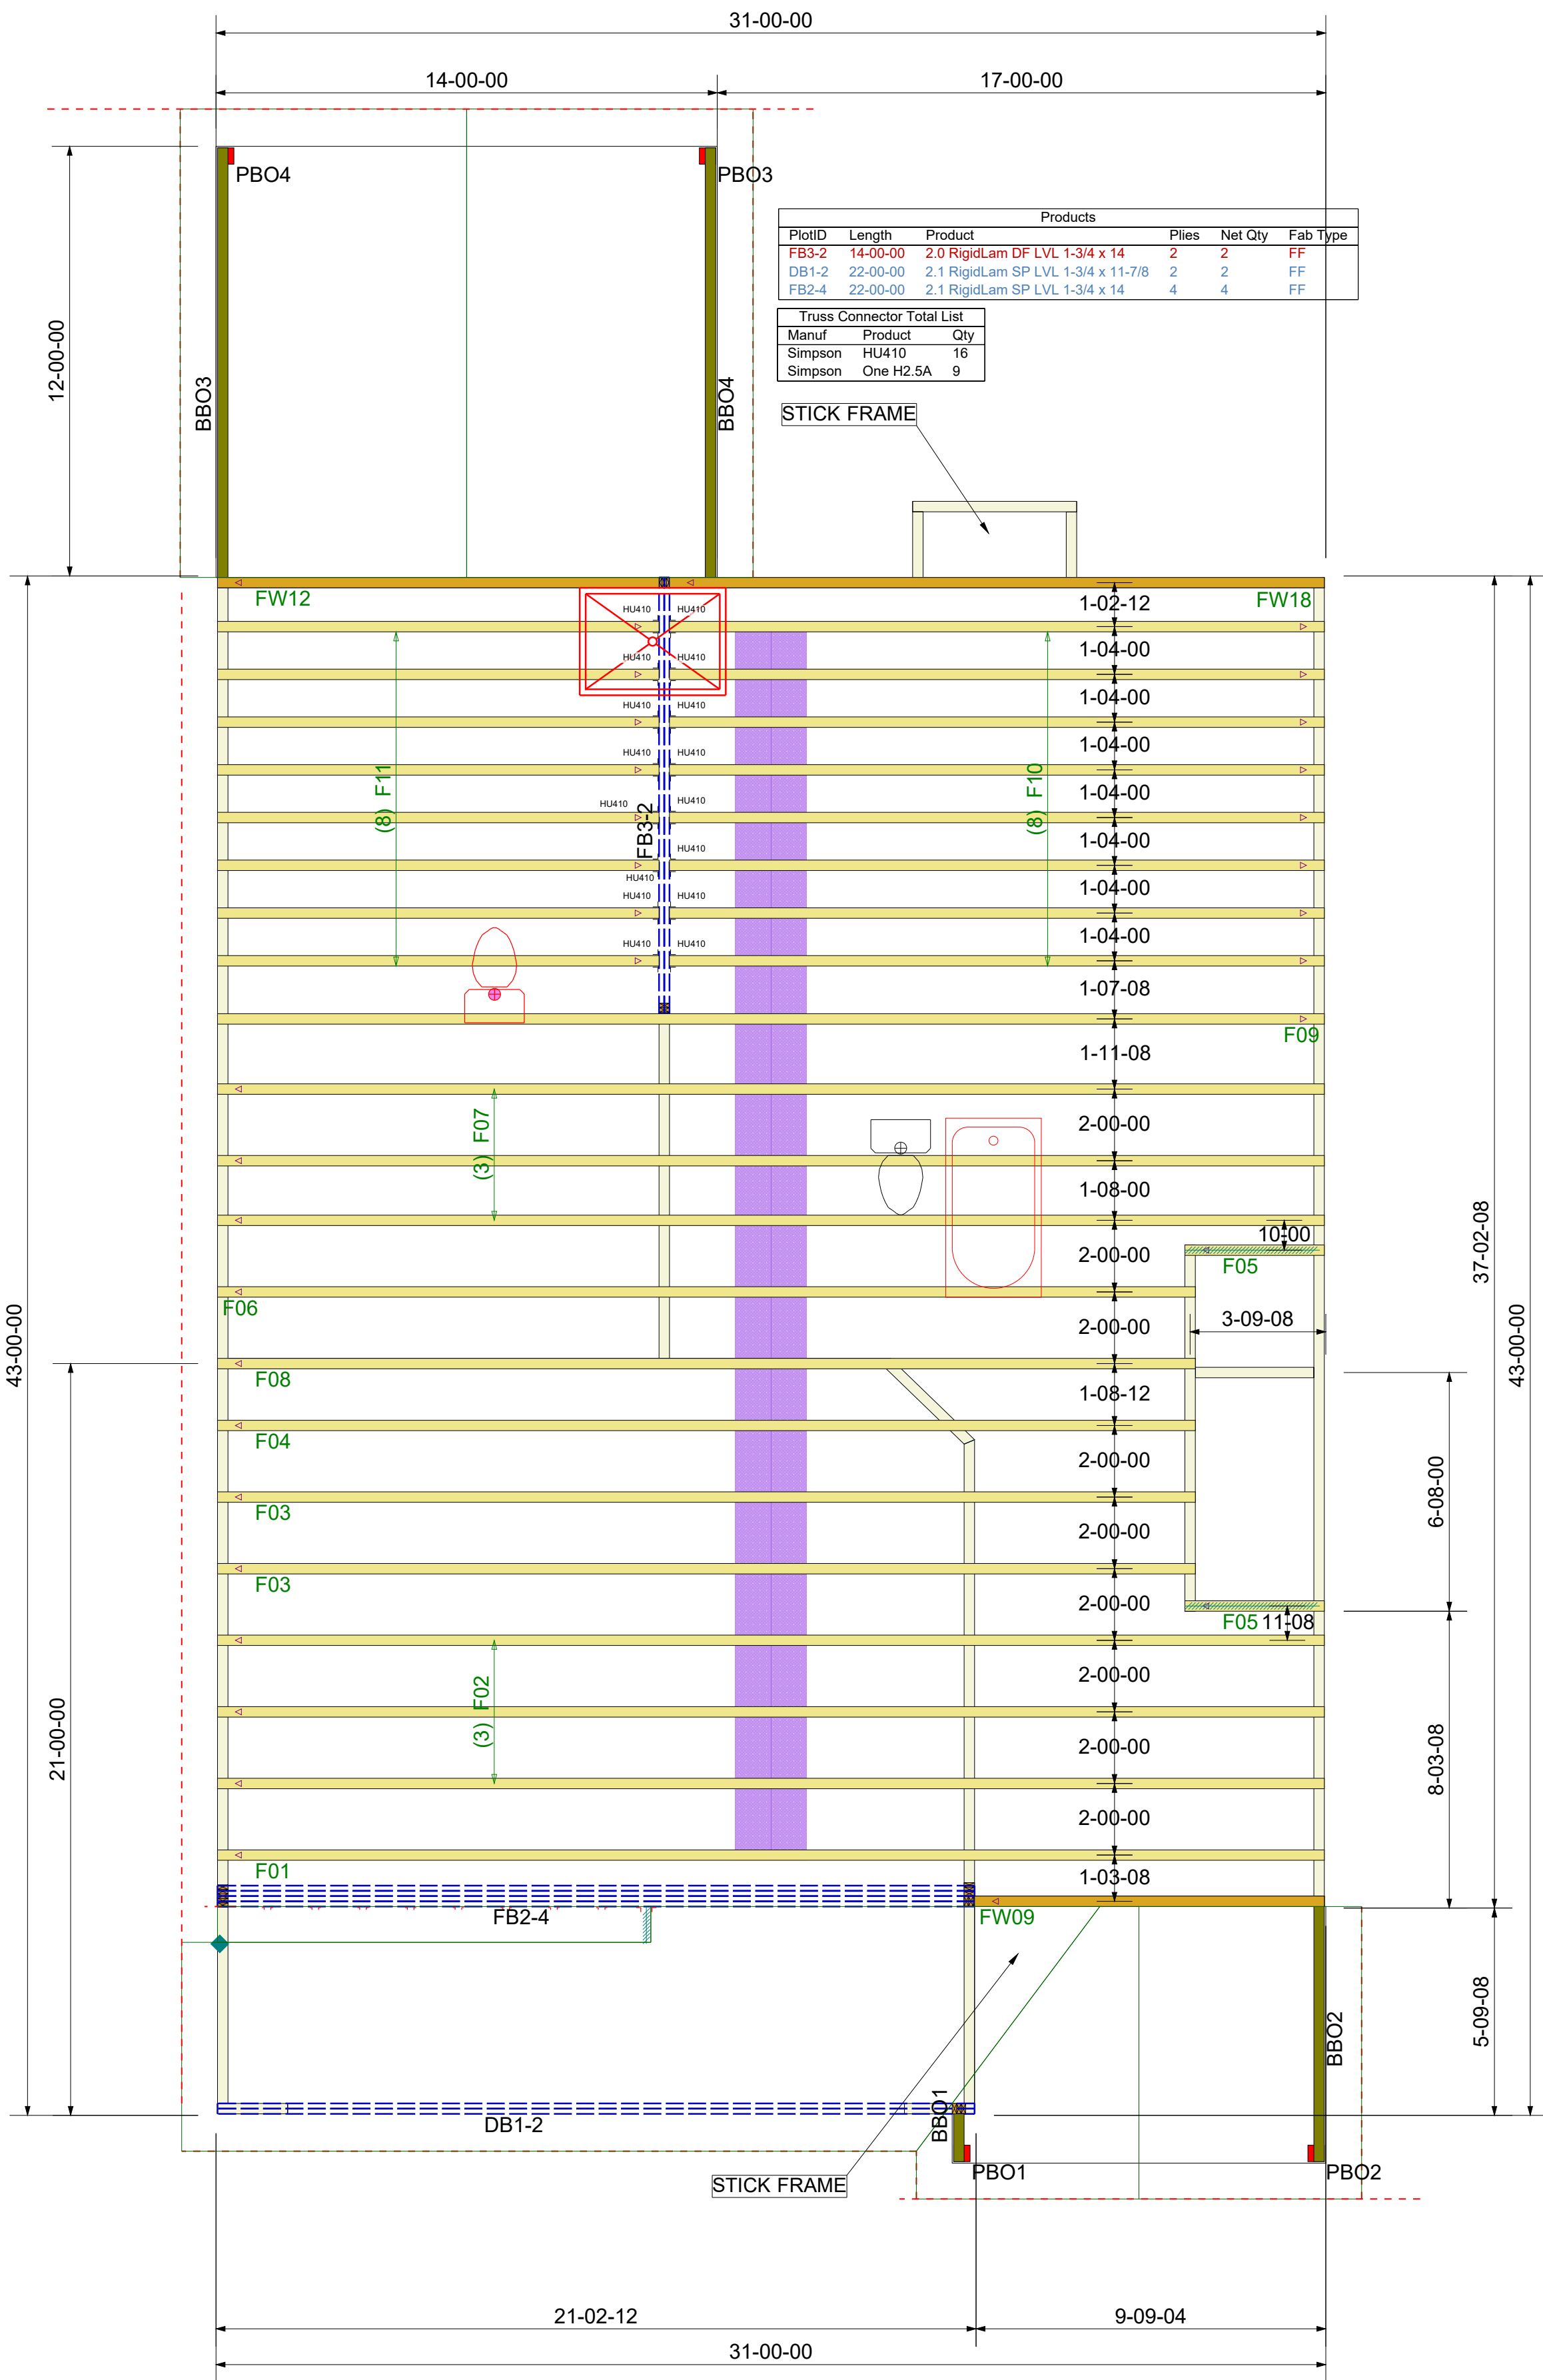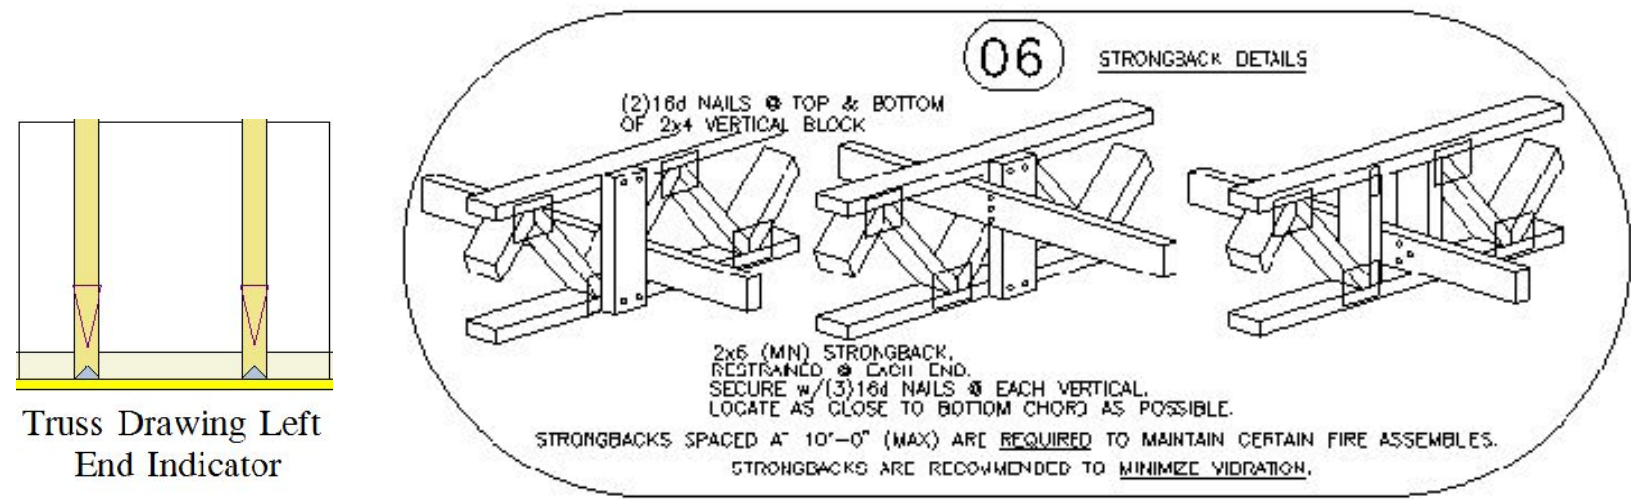

PLUMBING DROPS NOTED ARE IN THE APPROXIMATE LOCATIONS PER PLAN. BUILDER TO VERIFY LOCATIONS BEFORE SETTING TRUSSES.

* REFER TO FINAL TRUSS ENGINEERING SHEETS FOR PLY TO PLY CONNECTIONS.

Revisions	
00/00/00	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor systems and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding the design of "Bracing of Wood Trusses," see the Truss Design Manual, "Bracing of Trusses," Bracing of Wood Trusses, available from the Truss Plate Institute, 563 D Onifrio Drive, Madison, WI 53719.



Wellco Contractor
29 Hidden Lakes North-2nd Floor-Plan 10 GLH
FLOOR PLACEMENT PLAN

Scale:	<i>NTS</i>
Date:	10/10/2025
Designer:	Aaron Rogers
Project Number:	25100038-A
Sheet Number:	1/1

GIRDERS MUST BE FULLY CONNECTED TOGETHER PRIOR TO ADDING ANY LOADS.

DIMENSIONS ARE READ AS: FOOT-INCH-SIXTEENTH.

TRUSS TO TRUSS CONNECTIONS ARE TOE-NAILED, UNLESS NOTED OTHERWISE.

RE: 25100038-A
29 Hidden Lakes North-2nd Floor-Plan 10 GLH

Trenco
818 Soundside Rd
Edenton, NC 27932

Site Information:

Customer: Wellco Contractor Project Name: 25100038-A
Lot/Block: 29 Model:
Address: Subdivision: Hidden Lakes North
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2021/TPI2014 Design Program: MiTek 20/20 8.7
Wind Code: ASCE 7-16 Wind Speed: 130 mph
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 14 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date
1	I70700750	F01	1/13/2025
2	I70700751	F02	1/13/2025
3	I70700752	F03	1/13/2025
4	I70700753	F04	1/13/2025
5	I70700754	F05	1/13/2025
6	I70700755	F06	1/13/2025
7	I70700756	F07	1/13/2025
8	I70700757	F08	1/13/2025
9	I70700758	F09	1/13/2025
10	I70700759	F10	1/13/2025
11	I70700760	F11	1/13/2025
12	I70700761	FW09	1/13/2025
13	I70700762	FW12	1/13/2025
14	I70700763	FW18	1/13/2025


The truss drawing(s) referenced above have been prepared by
Truss Engineering Co. under my direct supervision
based on the parameters provided by Carter Components (Sanford, NC)).

Truss Design Engineer's Name: Gilbert, Eric

My license renewal date for the state of North Carolina is December 31, 2025.

North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

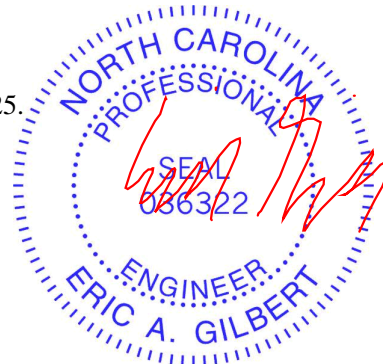

Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:37 Page: 1
ID:LzpTTEzOVRJl4PL9deHypFzwi?H-RfC?PsB70Hg3NSqPanL8w3uITXbGKWrcDoi7J4zJC?f




Plate Offsets (X, Y): [1:0-1-8,0-0-8], [11:0-1-8,Edge], [12:0-1-8,Edge], [29:0-3-12,Edge], [31:0-3-0,Edge], [34:0-3-8,Edge], [38:0-3-4,Edge], [40:0-1-8,0-0-8]

NUMBER
TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP No.2(flat) *Except* 37-30,33-25:2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat) *Except* 34-11,38-1,29-15:2x4 SP No.2(flat)
OTHERS 2x4 SP No.3(flat)
BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.
REACTIONS (size) 24=0-3-8, 28=0-3-8, 39=0-3-8
 Max Uplift 24=-210 (LC 3)
 Max Grav 24=402 (LC 4), 28=2246 (LC 1), 39=982 (LC 3)
FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-39=-964/0, 23-24=-68/0, 1-2=-1987/0, 2-4=-1986/0, 4-5=-4074/0, 5-6=-4074/0, 6-7=-4727/0, 7-8=-4727/0, 8-9=-4135/0, 9-11=-4135/0, 11-12=-2256/0, 12-14=0/974, 14-15=0/974, 15-16=0/3866, 16-17=0/3866, 17-18=-347/2119, 18-19=-347/2119, 19-20=-802/878, 20-22=-802/878, 22-23=0/0
BOT CHORD 38-39=0/0, 36-38=0/3192, 35-36=0/4570, 34-35=0/4542, 32-34=0/2256, 31-32=0/2256, 29-31=0/2256, 28-29=-2644/0, 27-28=-2858/0, 26-27=-1471/721, 24-26=-407/560

WEBS

11-32=-627/0, 12-31=0/663, 16-28=-219/0,
11-34=0/2230, 9-34=-466/0, 8-34=-518/0,
8-35=0/274, 7-35=-176/0, 6-35=0/178,
6-36=-561/0, 5-36=-163/0, 4-36=0/998,
4-38=-1365/0, 2-38=-188/0, 1-38=0/2159,
12-29=-3120/0, 14-29=-69/285,
15-29=0/2158, 15-28=-1724/0,
17-28=-1550/0, 17-27=0/1279, 18-27=-170/0,
19-27=-930/0, 19-26=0/683, 20-26=-151/0,
22-26=-542/279, 22-24=-644/468

NOTES

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) All plates are 3x6 MT20 unless otherwise indicated.
- 4) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at j(s) 24. This connection is for uplift only and does not consider lateral forces.
- 5) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 6) CAUTION. Do not erect truss backwards.

LOAD CASE(S) Standard



January 13, 2025



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	F02	Floor	3	1	I70700751
					Job Reference (optional)

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:38

Page: 1

ID:7JtmrPhPcZINfTLVaXroiwhzi_M-RfC?PsB70Hq3NSgPqnL8w3uITxbGKWrcDoi7J4zJC?i

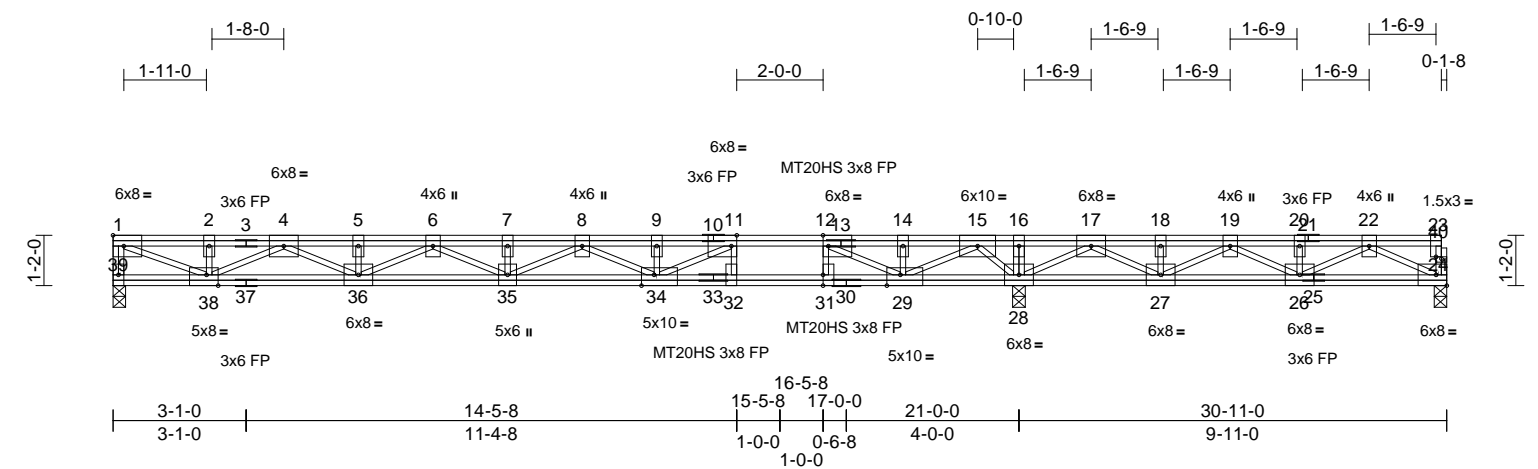

Scale = 1:53.4									
Plate Offsets (X, Y): [11:0-1-8,Edge], [12:0-1-8,Edge], [29:0-3-12,Edge], [31:0-3-0,Edge], [34:0-3-8,Edge], [38:0-3-4,Edge], [40:0-1-8,0-0-8]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl
TCLL	40.0	Plate Grip DOL	1.00	TC	0.82	Vert(LL)	-0.35	34-35	>710
TCDL	10.0	Lumber DOL	1.00	BC	0.85	Vert(CT)	-0.48	34-35	>520
BCLL	0.0	Rep Stress Incr	YES	WB	0.75	Horz(CT)	0.04	28	n/a
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MSH					
								Weight: 242 lb	FT = 20%F, 11%E

LUMBER		WEBS		11-32=627/0, 12-31=0/663, 16-28=219/0, 11-34=0/2230, 9-34=466/0, 8-34=518/0, 8-35=0/274, 7-35=176/0, 6-35=0/178, 6-36=561/0, 5-36=163/0, 4-36=0/998, 4-38=1366/0, 2-38=206/0, 1-38=0/2165, 12-29=3120/0, 14-29=69/285, 15-29=0/2158, 15-28=1724/0, 17-28=1550/0, 17-27=0/1279, 18-27=170/0, 19-27=930/0, 19-26=0/683, 20-26=151/0, 22-26=542/279, 22-24=644/468
TOP CHORD	2x4 SP No.2(flat)			
BOT CHORD	2x4 SP No.2(flat) *Except* 37-30,33-25:2x4 SP No.1(flat)			
WEBS	2x4 SP No.3(flat) *Except*			
OTHERS	34-11,38-1,29-15:2x4 SP No.2(flat)			
BRACING		NOTES		
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	1) Unbalanced floor live loads have been considered for this design.		
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.	2) All plates are MT20 plates unless otherwise indicated.		
REACTIONS	(size) 24=0-3-8, 28=0-3-8, 39=0-3-8	3) All plates are 3x6 MT20 unless otherwise indicated.		
	Max Uplift 24=210 (LC 3)	4) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 24. This connection is for uplift only and does not consider lateral forces.		
	Max Grav 24=402 (LC 4), 28=2246 (LC 1), 39=982 (LC 3)	5) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.		
FORCES	(lb) - Maximum Compression/Maximum Tension	6) CAUTION, Do not erect truss backwards.		
TOP CHORD	1-39=963/0, 23-24=68/0, 1-2=1985/0, 2-4=1985/0, 4-5=4074/0, 5-6=4074/0, 6-7=4727/0, 7-8=4727/0, 8-9=4135/0, 9-11=4135/0, 11-12=2256/0, 12-14=0/975, 14-15=0/975, 15-16=0/3867, 16-17=0/3867, 17-18=347/2119, 18-19=347/2119, 19-20=802/878, 20-22=802/878, 22-23=0/0	LOAD CASE(S) Standard		
BOT CHORD	38-39=0/0, 36-38=0/3192, 35-36=0/4570, 34-35=0/4542, 32-34=0/2256, 31-32=0/2256, 29-31=0/2256, 28-29=2644/0, 27-28=2859/0, 26-27=1472/721, 24-26=407/560			



January 13,2025

Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:38 Page: 1
ID:BkL179H83cwQ1?bwvYKDHB0zwhzb-RfC?PsB70Hg3NSqPnL8w3uITXbGKWRCDoi7J4zJC?f




Plate Offsets (X, Y): [11:0-1-8,Edge], [12:0-1-8,Edge], [23:0-3-12,Edge], [24:0-3-0,Edge], [27:0-3-8,Edge], [31:0-3-8,Edge], [33:0-1-8,0-0-8]

LUMBER
TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP No.2(flat) *Except* 28-20,26-20:2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat) *Except* 27-11,31-1,23-14:2x4 SP No.2(flat)
OTHERS 2x4 SP No.3(flat)

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except:
6-0-0 oc bracing: 22-23,21-22,20-21.


REACTIONS (size) 20=0-3-8, 22=0-3-8, 32=0-3-8
Max Uplift 20=522 (LC 3)
Max Grav 20=152 (LC 4), 22=2296 (LC 1), 32=968 (LC 3)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-32=949/0, 19-20=71/0, 1-2=1953/0, 2-3=1953/0, 3-4=3990/0, 4-5=3990/0, 5-6=4590/0, 6-7=4590/0, 7-9=3944/0, 9-11=3944/0, 11-12=2019/0, 12-13=0/1038, 13-14=0/1038, 14-15=0/3997, 15-16=0/3997, 16-17=0/2128, 17-18=0/2128, 18-19=0/0, 31-32=0/0, 30-31=0/3132, 29-30=0/4454, 27-29=0/4374, 25-27=0/2019, 24-25=0/2019, 23-24=0/2019, 22-23=2754/0, 21-22=3305/0, 20-21=1029/121
BOT CHORD
WEBS 11-25=630/0, 12-24=0/669, 15-22=163/0, 11-27=0/2239, 9-27=468/0, 7-27=523/0, 7-29=3/287, 6-29=181/0, 5-29=0/154, 5-30=525/0, 4-30=167/0, 3-30=0/972, 3-31=1334/0, 2-31=207/0, 1-31=0/2131, 12-23=3142/0, 13-23=69/286, 14-23=0/2163, 14-22=1730/0, 18-20=137/1165, 18-21=1244/0, 17-21=166/0, 16-21=0/1562, 16-22=1183/0

NOTES

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are MT20 plates unless otherwise indicated.
- 3) All plates are 3x6 MT20 unless otherwise indicated.
- 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 522 lb uplift at joint 20.
- 5) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
- 6) CAUTION. Do not erect truss backwards.

LOAD CASE(S) Standard

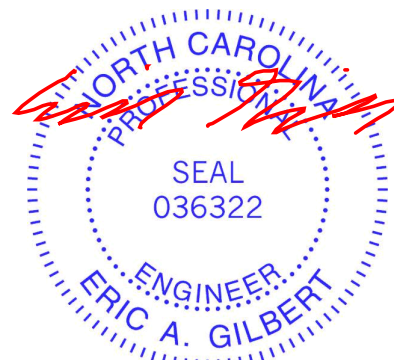

January 13, 2025



Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	F04	Floor	1	1	170700753
Job Reference (optional)					

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:38

Page: 1

ID:JW9eQQey?qiAdcuhiJPLzwhz7-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

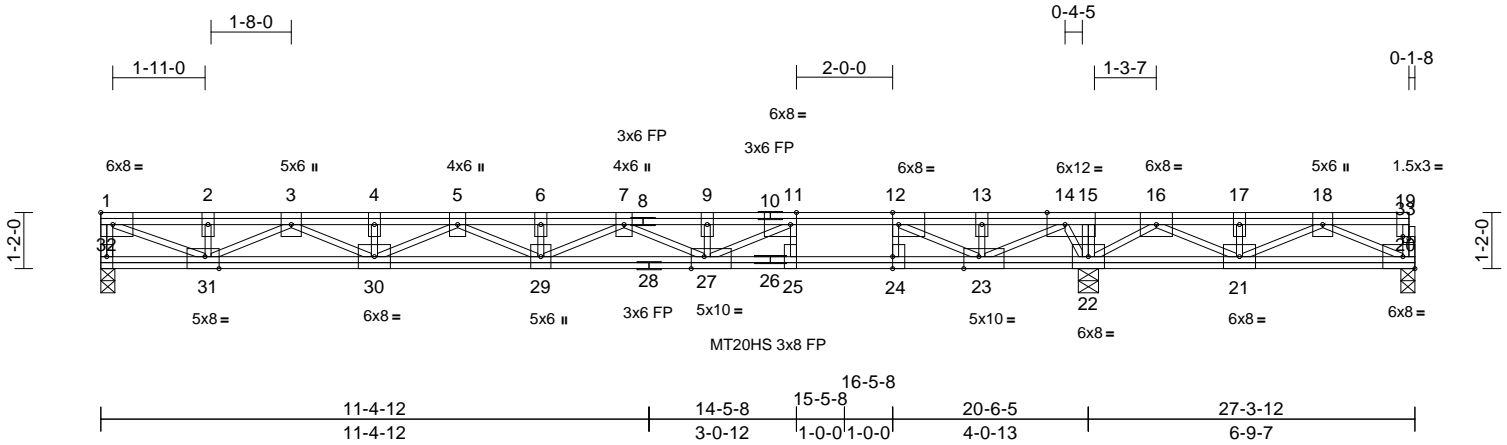

Scale = 1:47.9


Plate Offsets (X, Y): [11:0-1-8,Edge], [12:0-1-8,Edge], [15:0-4-8,Edge], [23:0-3-12,Edge], [24:0-3-0,Edge], [27:0-3-4,Edge], [31:0-3-8,Edge], [33:0-1-8,0-0-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.94	Vert(LL)	-0.33	27-29	>739	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.81	Vert(CT)	-0.45	27-29	>538	360	MT20HS	187/143
BCLL	0.0	Rep Stress Incr	YES	WB	0.99	Horz(CT)	0.03	22	n/a	n/a		
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MSH							Weight: 214 lb	FT = 20%F, 11%E

LUMBER	
TOP CHORD	2x4 SP No.2(flat)
BOT CHORD	2x4 SP No.2(flat) *Except* 28-20,26-20:2x4 SP No.1(flat)
WEBS	2x4 SP No.3(flat) *Except* 27-11,23-14:2x4 SP No.2(flat)
OTHERS	2x4 SP No.3(flat)
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 6-0-0 oc bracing: 22-23,21-22,20-21.
REACTIONS	
(size)	20=0-3-8, 22=0-5-1, 32=0-3-8
Max Uplift	20=-428 (LC 3)
Max Grav	20=200 (LC 4), 22=2201 (LC 1), 32=952 (LC 3)
FORCES	
(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-32=-932/0, 19-20=-72/0, 1-2=-1913/0, 2-3=-1913/0, 3-4=-3893/0, 4-5=-3893/0, 5-6=-4432/0, 6-7=-4432/0, 7-9=-3729/0, 9-11=-3729/0, 11-12=-1752/0, 12-13=0/1328, 13-14=0/1328, 14-15=0/3690, 15-16=0/3690, 16-17=-59/1775, 17-18=-59/1775, 18-19=0/0
BOT CHORD	31-32=0/0, 30-31=0/3064, 29-30=0/4327, 27-29=0/4185, 25-27=0/1752, 24-25=0/1752, 23-24=0/1752, 22-23=-3081/0, 21-22=-2802/0, 20-21=-854/211
WEBS	11-25=-642/0, 12-24=0/686, 15-22=-182/0, 11-27=0/2291, 9-27=-473/0, 7-27=-550/0, 7-29=0/316, 6-29=-181/0, 5-29=0/119, 5-30=-491/0, 4-30=-167/0, 3-30=0/938, 3-31=-1303/0, 2-31=-205/0, 1-31=0/2086, 12-23=-3217/0, 13-23=-58/301, 14-23=0/2139, 14-22=-1341/0, 18-20=-238/967, 18-21=-1043/0, 17-21=-176/0, 16-21=0/1357, 16-22=-1357/0

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) All plates are 3x6 MT20 unless otherwise indicated.
 - 4) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 428 lb uplift at joint 20.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 6) CAUTION, Do not erect truss backwards.

LOAD CASE(S) Standard

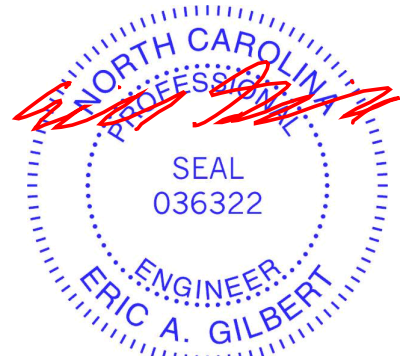

January 13,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	F05	Floor	2	1	I70700754
					Job Reference (optional)

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:38
ID:NPZJaYqMTRb2wwXZ4GXrWWzwhyu-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

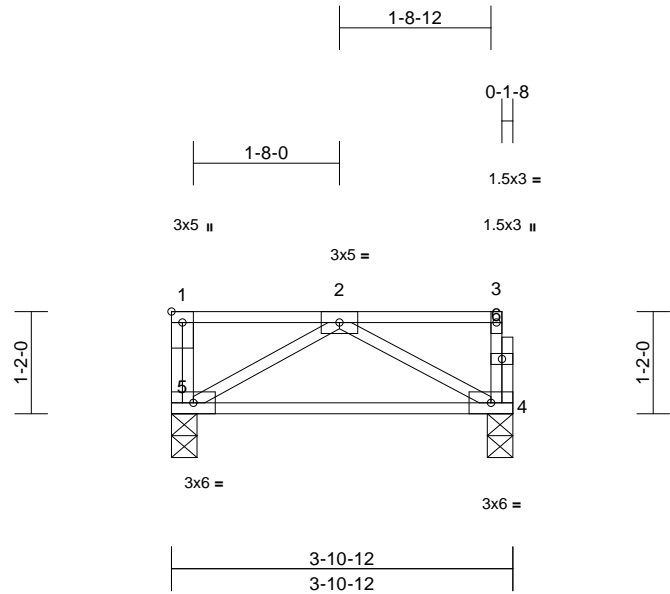

Scale = 1:26.3

Plate Offsets (X, Y): [1:Edge,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.55	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.27	Vert(CT)	-0.03	4-5	>999	360		
BCLL	0.0	Rep Stress Incr	NO	WB	0.14	Horz(CT)	0.00	4	n/a	n/a		
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MP							Weight: 22 lb	FT = 20%F, 11%E

LUMBER

TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP No.2(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING

TOP CHORD Structural wood sheathing directly applied or
3-10-12 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.

REACTIONS (size) 4=0-3-8, 5=0-3-8
Max Grav 4=458 (LC 1), 5=474 (LC 1)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 1-5=-171/0, 3-4=-171/0, 1-2=0/0, 2-3=-10/0
BOT CHORD 4-5=0/490
WEBS 2-5=-567/0, 2-4=-550/0

NOTES

- 1) Recommend 2x6 strongbacks, on edge, spaced at
10-00-00 oc and fastened to each truss with 3-10d
(0.131" X 3") nails. Strongbacks to be attached to walls
at their outer ends or restrained by other means.
- 2) CAUTION, Do not erect truss backwards.
- 3) In the LOAD CASE(S) section, loads applied to the face
of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- 1) Dead + Floor Live (balanced): Lumber Increase=1.00,
Plate Increase=1.00
Uniform Loads (lb/ft)
Vert: 4-5=-10, 1-3=-250 (F=-150)



January 13,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	F06	Floor	1	1	170700755
Job Reference (optional)					

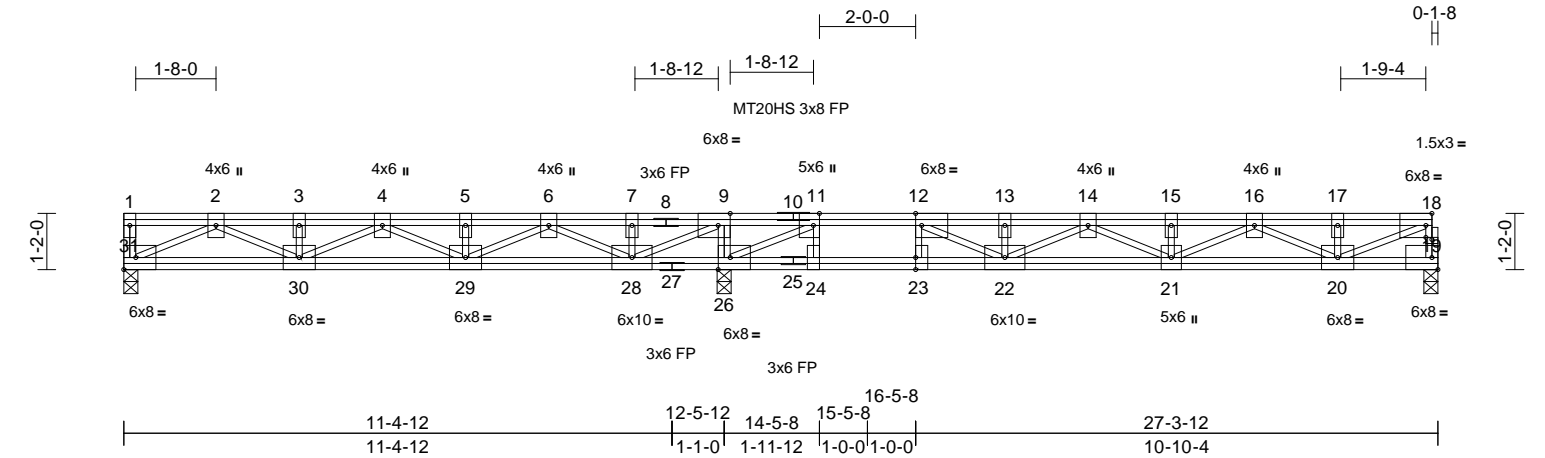

Scale = 1:47.9

Plate Offsets (X, Y): [9:0-3-0,Edge], [11:0-3-0,Edge], [12:0-1-8,Edge], [18:0-1-8,Edge], [18:0-1-8,0-0-8], [23:0-3-0,Edge], [26:0-3-0,Edge]												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.84	Vert(LL)	-0.17	22-23	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.78	Vert(CT)	-0.24	22-23	>741	360	MT20HS	187/143
BCLL	0.0	Rep Stress Incr	YES	WB	0.84	Horz(CT)	0.02	19	n/a	n/a		
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MSH							Weight: 214 lb	FT = 20%F, 11%E

LUMBER		2) All plates are MT20 plates unless otherwise indicated.
TOP CHORD	2x4 SP No.2(flat)	3) All plates are 3x6 MT20 unless otherwise indicated.
BOT CHORD	2x4 SP No.2(flat)	4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
WEBS	2x4 SP No.3(flat)	
OTHERS	2x4 SP No.3(flat)	5) CAUTION, Do not erect truss backwards.
BRACING		LOAD CASE(S) Standard
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.	
REACTIONS (size)		
19=0-3-8, 26=0-3-8, 31=0-3-8		
Max Grav 19=734 (LC 4), 26=1739 (LC 1), 31=595 (LC 3)		
FORCES (lb) - Maximum Compression/Maximum Tension		
TOP CHORD	1-31=-78/0, 18-19=-721/0, 1-2=0/0, 2-3=-1543/0, 3-4=-1543/0, 4-5=-1608/49, 5-6=-1608/49, 6-7=-248/658, 7-9=-248/658, 9-11=0/1795, 11-12=-1077/354, 12-13=-2487/0, 13-14=-2487/0, 14-15=-2562/0, 15-16=-2562/0, 16-17=-1350/0, 17-18=-1351/0	
BOT CHORD	30-31=0/974, 29-30=0/1744, 28-29=-320/1096, 26-28=-1795/0, 24-26=-354/1077, 23-24=-354/1077, 22-23=-354/1077, 21-22=0/2640, 20-21=0/2114, 19-20=0/0	
WEBS	9-26=-792/0, 11-24=0/481, 12-23=-487/0, 2-31=-1094/0, 2-30=0/644, 3-30=-161/0, 4-30=-228/90, 4-29=-262/0, 5-29=-166/0, 6-29=0/687, 6-28=-1063/0, 7-28=-196/0, 9-28=0/1650, 11-26=-2620/0, 12-22=0/1759, 13-22=-434/0, 14-22=-256/0, 14-21=-88/96, 15-21=-181/0, 16-21=0/507, 16-20=-865/0, 17-20=-186/0, 18-20=0/1484	

NOTES
1) Unbalanced floor live loads have been considered for this design.

January 13,2025


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	F07	Floor	3	1	170700756
Job Reference (optional)					

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:39

Page: 1


ID:ZPPSs?OvrOzbXuTYiasKrnwzwhws-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

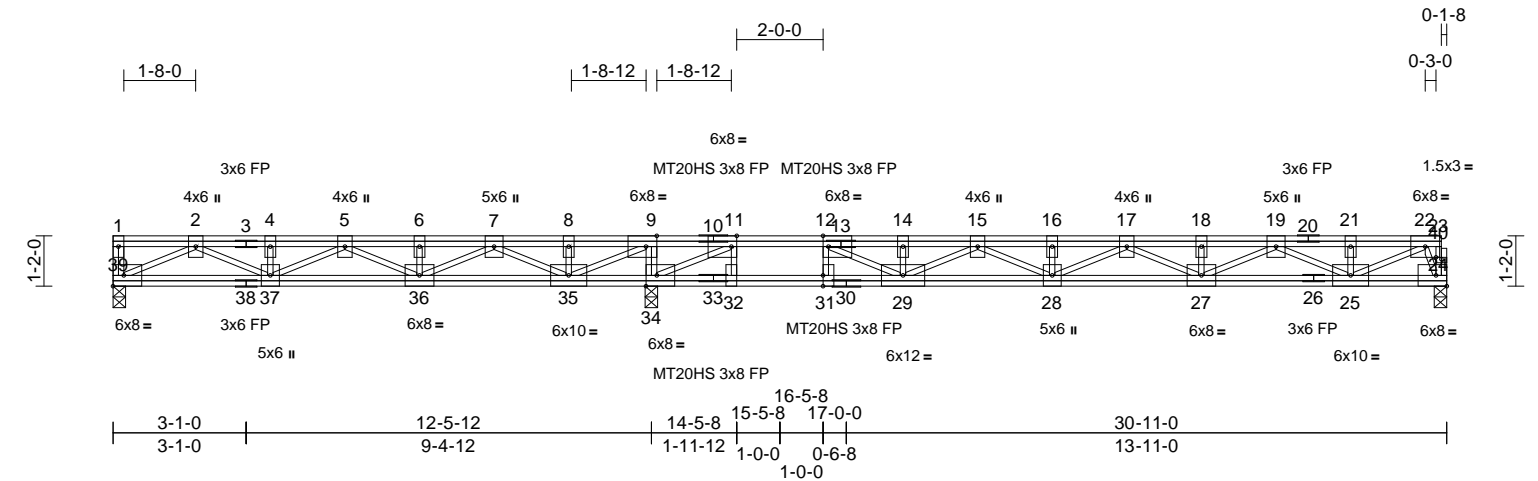

Scale = 1:53.4									
Plate Offsets (X, Y): [9:0-3-0,Edge], [11:0-1-8,Edge], [12:0-1-8,Edge], [31:0-3-0,Edge], [34:0-3-0,Edge], [40:0-1-8,0-0-8]									
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl
TCLL	40.0	Plate Grip DOL	1.00	TC	0.95	Vert(LL)	-0.28	28-29	>789
TCDL	10.0	Lumber DOL	1.00	BC	0.94	Vert(CT)	-0.38	28-29	>582
BCLL	0.0	Rep Stress Incr	YES	WB	0.89	Horz(CT)	0.03	24	n/a
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MSH					n/a
					Weight: 242 lb		FT = 20%F, 11%E		

LUMBER	
TOP CHORD	2x4 SP No.2(flat) *Except* 10-20,3-13:2x4 SP No.1(flat)
BOT CHORD	2x4 SP No.2(flat)
WEBS	2x4 SP No.3(flat) *Except* 29-12:2x4 SP No.2(flat)
OTHERS	2x4 SP No.3(flat)
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.
REACTIONS	
(size)	24=0-3-8, 34=0-3-8, 39=0-3-8
Max Grav	24=888 (LC 4), 34=2045 (LC 1), 39=576 (LC 3)
FORCES	
(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-39=-78/0, 23-24=0/83, 1-2=0/0, 2-4=-1473/133, 4-5=-1473/133, 5-6=-1471/670, 6-7=-1471/670, 7-8=-42/1583, 8-9=-42/1583, 9-11=0/2874, 11-12=-727/435, 12-14=-2926/0, 14-15=-2926/0, 15-16=-3821/0, 16-17=-3821/0, 17-18=-3491/0, 18-19=-3491/0, 19-21=-1722/0, 21-22=-1722/0, 22-23=0/0
BOT CHORD	37-39=-29/938, 36-37=-366/1639, 35-36=-1094/923, 34-35=-2874/0, 32-34=-435/727, 31-32=-435/727, 29-31=-435/727, 28-29=0/3458, 27-28=0/3815, 25-27=0/2773, 24-25=0/326

WEBS	
9-34=-794/0, 11-32=0/616, 12-31=-633/0, 2-39=-1054/32, 2-37=-118/605, 4-37=-162/0, 5-37=-188/263, 5-36=-429/0, 6-36=-167/0, 7-36=0/855, 7-35=-1227/0, 8-35=-205/0, 9-35=0/1860, 11-34=-3441/0, 12-29=0/2604, 14-29=-560/0, 15-29=-664/0, 15-28=0/480, 16-28=-190/0, 17-28=-67/7, 17-27=-367/0, 18-27=-169/0, 19-27=0/813, 19-25=-1190/0, 21-25=-159/0, 22-25=0/1580, 22-24=-1010/0	
NOTES	
1)	Unbalanced floor live loads have been considered for this design.
2)	All plates are MT20 plates unless otherwise indicated.
3)	All plates are 3x6 MT20 unless otherwise indicated.
4)	Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
5)	CAUTION, Do not erect truss backwards.
LOAD CASE(S) Standard	

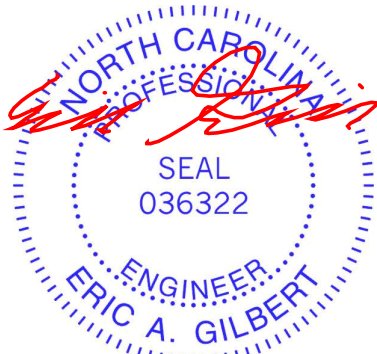

January 13,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)



818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	F08	Floor	1	1	I70700757
Job Reference (optional)					

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:39

Page: 1

ID:tNVfkGjHBti75fJvzbJuivzwhv9-RfC?PsB70Hq3NSgPqnL8w3uITxbGKwvCDoi7J4zJC?i

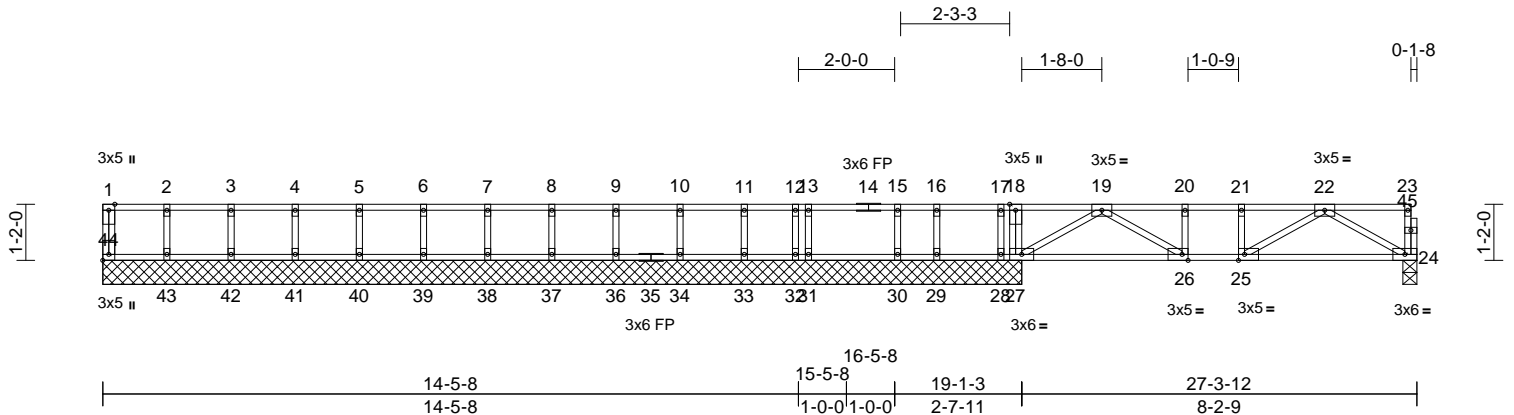

Scale = 1:47.9

Plate Offsets (X, Y): [25:0-1-8,Edge], [26:0-1-8,Edge], [44:Edge,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.17	Vert(LL)	-0.02	25-26	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.25	Vert(CT)	-0.04	24-25	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.17	Horz(CT)	0.01	24	n/a	n/a		
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MSH							Weight: 123 lb	FT = 20%F, 11%E

LUMBER
TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP No.2(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)


BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 24=0-3-8, 27=19-1-3, 28=19-1-3, 29=19-1-3, 30=19-1-3, 31=19-1-3, 32=19-1-3, 33=19-1-3, 34=19-1-3, 36=19-1-3, 37=19-1-3, 38=19-1-3, 39=19-1-3, 40=19-1-3, 41=19-1-3, 42=19-1-3, 43=19-1-3, 44=19-1-3
Max Uplift 28=141 (LC 4), 32=16 (LC 1)
Max Grav 24=439 (LC 4), 27=627 (LC 4), 28=70 (LC 3), 29=100 (LC 1), 30=161 (LC 3), 31=202 (LC 1), 32=6 (LC 4), 33=137 (LC 1), 34=149 (LC 3), 36=146 (LC 1), 37=147 (LC 3), 38=147 (LC 1), 39=147 (LC 1), 40=147 (LC 1), 41=147 (LC 1), 42=145 (LC 1), 43=156 (LC 1), 44=52 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-44=-47/0, 23-24=-68/0, 1-2=0/0, 2-3=0/0, 3-4=0/0, 4-5=0/0, 5-6=0/0, 6-7=0/0, 7-8=0/0, 8-9=0/0, 9-10=0/0, 10-11=0/0, 11-12=0/0, 12-13=0/0, 13-15=0/0, 15-16=0/0, 16-17=0/0, 17-18=0/0, 18-19=0/0, 19-20=-865/0, 20-21=-865/0, 21-22=-865/0, 22-23=-4/0

BOT CHORD 43-44=0/0, 42-43=0/0, 41-42=0/0, 40-41=0/0, 39-40=0/0, 38-39=0/0, 37-38=0/0, 36-37=0/0, 34-36=0/0, 33-34=0/0, 32-33=0/0, 31-32=0/0, 30-31=0/0, 29-30=0/0, 28-29=0/0, 27-28=0/0, 26-27=0/585, 25-26=0/865, 24-25=0/615
WEBS 12-32=0/12, 15-30=-147/0, 18-27=-205/0, 19-27=-677/0, 22-24=-707/0, 19-26=0/327, 22-25=0/292, 20-26=-152/0, 21-25=-123/0, 2-43=-142/0, 3-42=-131/0, 4-41=-134/0, 5-40=-133/0, 6-39=-133/0, 7-38=-133/0, 8-37=-134/0, 9-36=-133/0, 10-34=-136/0, 11-33=-124/0, 13-31=-181/0, 16-29=-89/0, 17-28=-103/89

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) N/A
 - 6) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 7) CAUTION, Do not erect truss backwards.
- LOAD CASE(S)** Standard

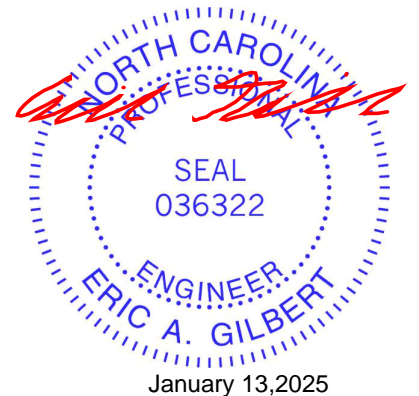


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate




818 Soundside Road
Edenton, NC 27932

Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:39 Page: 1
ID:twYWtv7cAK JAtv1a6ws44zwhud-RfC?PsB70Hg3NSaPqnL8w3ulTXbGKWCrDci7J4ZJC?f



Loading	(psf)	Spacing	1-4-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.80	Vert(LL)	-0.20	33-34	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.67	Vert(CT)	-0.27	33-34	>827	360	MT20HS	187/143
BCLL	0.0	Rep Stress Incr	YES	WB	0.83	Horz(CT)	0.02	28	n/a	n/a		
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MSH							Weight: 242 lb	FT = 20%F, 11%E

LOAD CASE(S) Standard




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	F10	Floor	8	1	I70700759
Job Reference (optional)					

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:39

Page: 1

ID:qaCisOMXi9NcyoshBbmJL5zwhuK-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

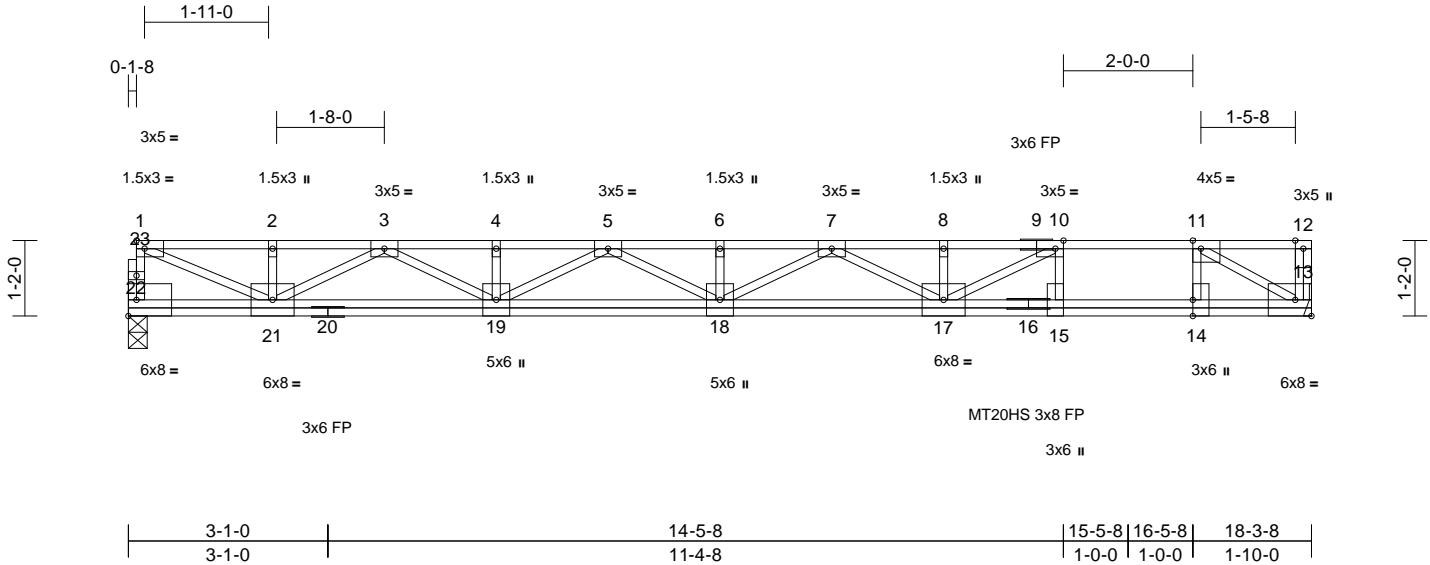

Scale = 1:35.6									
Plate Offsets (X, Y): [10:0-1-8,Edge], [11:0-1-8,Edge], [14:0-3-0,Edge]									
Loading	(psf)	Spacing	1-4-0	CSI		DEFL	in (loc)	l/defl	L/d
TCLL	40.0	Plate Grip DOL	1.00	TC	0.66	Vert(LL)	-0.28 17-18	>774	480
TCDL	10.0	Lumber DOL	1.00	BC	0.79	Vert(CT)	-0.38 17-18	>562	360
BCLL	0.0	Rep Stress Incr	YES	WB	0.64	Horz(CT)	0.03 13	n/a	n/a
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MSH					
Weight: 118 lb FT = 20%F, 11%E									

LUMBER
TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP No.2(flat) *Except* 20-13,16-13:2x4 SP No.1(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING
TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 13= Mechanical, 22=0-3-8
Max Grav 13=662 (LC 1), 22=657 (LC 1)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-22=-644/0, 12-13=-24/45, 1-2=-1260/0, 2-3=-1260/0, 3-4=-2588/0, 4-5=-2588/0, 5-6=-3009/0, 6-7=-3009/0, 7-8=-2660/0, 8-10=-2660/0, 10-11=-1523/0, 11-12=0/0
BOT CHORD 21-22=0/41, 19-21=0/2026, 18-19=0/2911, 17-18=0/2933, 15-17=0/1523, 14-15=0/1523, 13-14=0/1523
WEBS 10-15=-644/0, 11-14=0/659, 10-17=0/1313, 8-17=-170/0, 7-17=-321/0, 7-18=-14/95, 6-18=-105/0, 5-18=0/113, 5-19=-371/0, 4-19=-105/0, 3-19=0/645, 3-21=-881/0, 2-21=-139/0, 1-21=0/1352, 11-13=-1772/0

- NOTES**
- 1) Unbalanced floor live loads have been considered for this design.
 - 2) All plates are MT20 plates unless otherwise indicated.
 - 3) Refer to girder(s) for truss to truss connections.
 - 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
 - 5) CAUTION, Do not erect truss backwards.
- LOAD CASE(S)** Standard



January 13,2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:39 Page: 1
ID:4Cx49vpZUWSJTelhU3KX4zwhsK-RfC?PsB70Ha3NSaPqnL8w3uITXbGKWrCDoi7J4zJC?f



Loading	(psf)	Spacing	1-4-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.34	Vert(LL)	-0.07	10-11	>999	480	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.52	Vert(CT)	-0.10	10-11	>999	360		
BCLL	0.0	Rep Stress Incr	YES	WB	0.23	Horz(CT)	0.02	9	n/a	n/a		
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MSH							Weight: 64 lb	FT = 20%F, 11%E

TOP CHORD	2x4 SP No.2(flat)
BOT CHORD	2x4 SP No.2(flat)
WEBS	2x4 SP No.3(flat)

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

(size) 9=0-3-8, 14= Mechanical
Max Grav 9=443 (LC 1), 14=443 (LC 1)

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-14=-48/0, 8-9=-50/0, 1-2=0/0, 2-3=-1065/0,
3-4=-1065/0, 4-5=-1258/0, 5-6=-1081/0,
6-7=-1081/0, 7-8=0/0

BOT CHORD 13-14=0/662, 12-13=0/1258, 11-12=0/1258,
10-11=0/1258, 9-10=0/661

WEBS 7-9=-764/0, 2-14=-765/0, 7-10=0/491,
2-13=0/471, 6-10=-140/7, 3-13=-100/54,
5-10=-330/0, 4-13=-380/0, 4-12=-36/83,
5-11=-51/41

- 1) Unbalanced floor live loads have been considered for this design.
- 2) All plates are 3x5 MT20 unless otherwise indicated.
- 3) Refer to girder(s) for truss to truss connections.
- 4) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

 WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITER REFERENCE PAGE MIT-7473 Rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliat


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	FW09	Floor Supported Gable	1	1	I70700761
					Job Reference (optional)

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 17:18:39
ID:vAtehfa7?hMfDVFxyahL5zwhrR-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

Page: 1

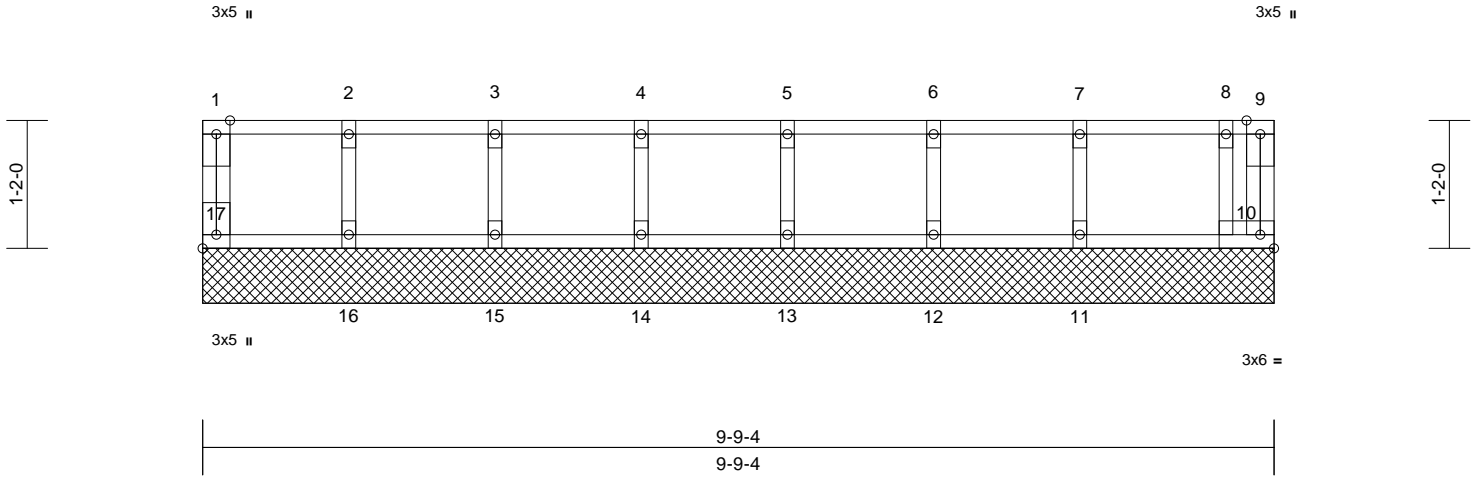

Scale = 1:21

Plate Offsets (X, Y): [17:Edge,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL	40.0	Plate Grip DOL	1.00	TC	0.09	Vert(LL)	n/a	-	n/a	999	MT20
TCDL	10.0	Lumber DOL	1.00	BC	0.03	Vert(TL)	n/a	-	n/a	999	244/190
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	10	n/a	n/a	
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MR							
										Weight: 44 lb	FT = 20%F, 11%E

LUMBER

TOP CHORD 2x4 SP No.2(flat)
BOT CHORD 2x4 SP No.2(flat)
WEBS 2x4 SP No.3(flat)
OTHERS 2x4 SP No.3(flat)

BRACING

TOP CHORD Structural wood sheathing directly applied or
6-0-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc
bracing.


REACTIONS (size) 10=9-9-4, 11=9-9-4, 12=9-9-4,
13=9-9-4, 14=9-9-4, 15=9-9-4,
16=9-9-4, 17=9-9-4
Max Grav 10=95 (LC 1), 11=161 (LC 1),
12=143 (LC 1), 13=148 (LC 1),
14=146 (LC 1), 15=150 (LC 1),
16=134 (LC 1), 17=70 (LC 1)

FORCES (lb) - Maximum Compression/Maximum
Tension

TOP CHORD 1-17=-60/0, 9-10=0/4, 1-2=-17/0, 2-3=-17/0,
3-4=-17/0, 4-5=-17/0, 5-6=-17/0, 6-7=-17/0,
7-8=-17/0, 8-9=0/0
BOT CHORD 16-17=0/17, 15-16=0/17, 14-15=0/17,
13-14=0/17, 12-13=0/17, 11-12=0/17,
10-11=0/17
WEBS 2-16=-126/0, 3-15=-135/0, 4-14=-133/0,
5-13=-134/0, 6-12=-131/0, 7-11=-143/0,
8-10=-96/0

NOTES

- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
- 2) Gable requires continuous bottom chord bearing.
- 3) Truss to be fully sheathed from one face or securely
braced against lateral movement (i.e. diagonal web).
- 4) Gable studs spaced at 1-4-0 oc.
- 5) Recommend 2x6 strongbacks, on edge, spaced at
10-00-00 oc and fastened to each truss with 3-10d
(0.131" X 3") nails. Strongbacks to be attached to walls
at their outer ends or restrained by other means.

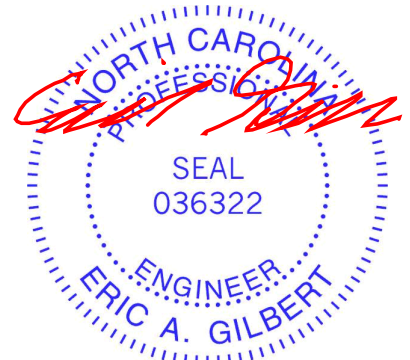

January 13, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	FW12	Floor Supported Gable	1	1	I70700762
Job Reference (optional)					

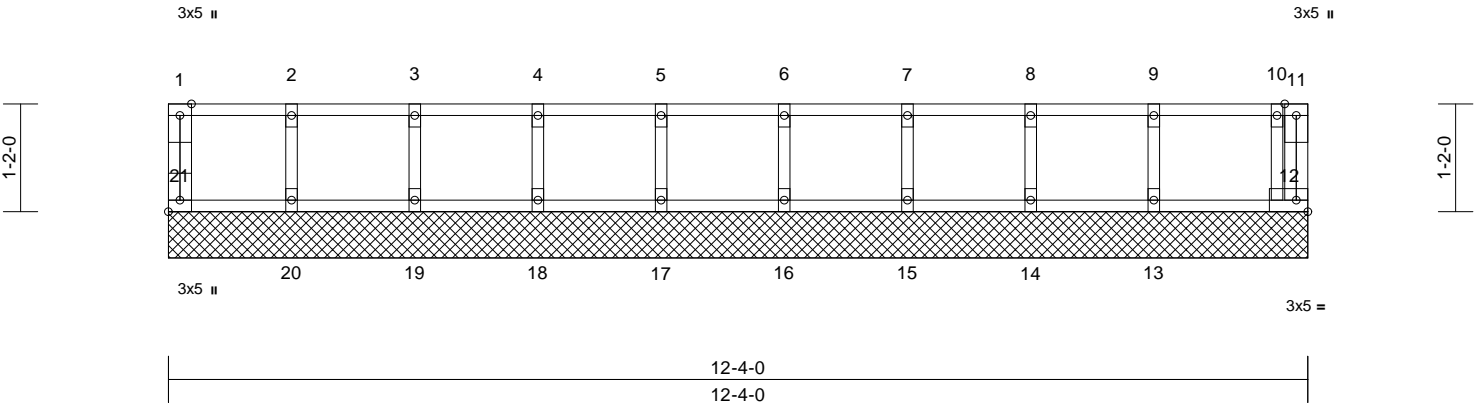

Scale = 1:24.9

Plate Offsets (X, Y): [21:Edge,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP	
TCLL	40.0	Plate Grip DOL	1.00	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20	244/190
TCDL	10.0	Lumber DOL	1.00	BC	0.02	Vert(TL)	n/a	-	n/a	999		
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	12	n/a	n/a		
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MR							Weight: 54 lb	FT = 20%F, 11%E


LUMBER		5) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.
TOP CHORD	2x4 SP No.2(flat)	LOAD CASE(S) Standard
BOT CHORD	2x4 SP No.2(flat)	
WEBS	2x4 SP No.3(flat)	
OTHERS	2x4 SP No.3(flat)	
BRACING		
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.	
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.	
REACTIONS (size)		
12=12-4-0, 13=12-4-0, 14=12-4-0, 15=12-4-0, 16=12-4-0, 17=12-4-0, 18=12-4-0, 19=12-4-0, 20=12-4-0, 21=12-4-0		
Max Grav		
12=86 (LC 1), 13=159 (LC 1), 14=143 (LC 1), 15=148 (LC 1), 16=146 (LC 1), 17=147 (LC 1), 18=146 (LC 1), 19=149 (LC 1), 20=136 (LC 1), 21=68 (LC 1)		
FORCES (lb) - Maximum Compression/Maximum Tension		
TOP CHORD		
1-21=-59/0, 11-12=0/13, 1-2=-15/0, 2-3=-15/0, 3-4=-15/0, 4-5=-15/0, 5-6=-15/0, 6-7=-15/0, 7-8=-15/0, 8-9=-15/0, 9-10=-15/0, 10-11=-3/0		
BOT CHORD		
20-21=0/15, 19-20=0/15, 18-19=0/15, 17-18=0/15, 16-17=0/15, 15-16=0/15, 14-15=0/15, 13-14=0/15, 12-13=0/15		
WEBS		
2-20=-127/0, 3-19=-135/0, 4-18=-133/0, 5-17=-133/0, 6-16=-133/0, 7-15=-134/0, 8-14=-131/0, 9-13=-142/0, 10-12=-94/0		
NOTES		

- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
- 2) Gable requires continuous bottom chord bearing.
- 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 4) Gable studs spaced at 1-4-0 oc.



January 13,2025

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-2nd Floor-Plan 10 GLH
25100038-A	FW18	Floor Supported Gable	1	1	I70700763
Job Reference (optional)					

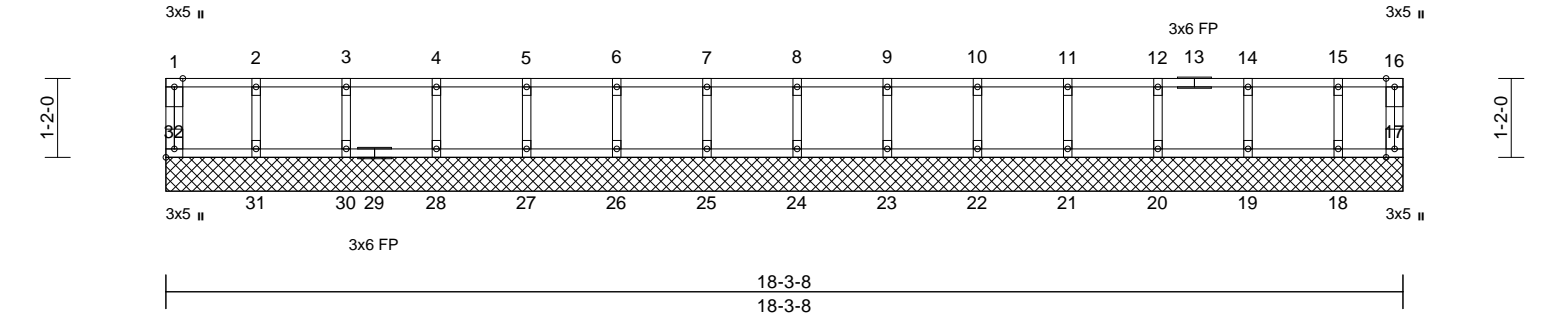


Scale = 1:34.1									
Plate Offsets (X, Y): [32:Edge,0-1-8]									
Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d
TCLL	40.0	Plate Grip DOL	1.00	TC	0.08	Vert(LL)	n/a	-	n/a
TCDL	10.0	Lumber DOL	1.00	BC	0.01	Vert(TL)	n/a	-	n/a
BCLL	0.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	17	n/a
BCDL	5.0	Code	IRC2021/TPI2014	Matrix-MR					
					PLATES		GRIP		
					MT20		244/190		
					Weight: 78 lb		FT = 20%F, 11%E		

LUMBER	
TOP CHORD	2x4 SP No.2(flat)
BOT CHORD	2x4 SP No.2(flat)
WEBS	2x4 SP No.3(flat)
OTHERS	2x4 SP No.3(flat)
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS (size)	
17=18-3-8, 18=18-3-8, 19=18-3-8, 20=18-3-8, 21=18-3-8, 22=18-3-8, 23=18-3-8, 24=18-3-8, 25=18-3-8, 26=18-3-8, 27=18-3-8, 28=18-3-8, 30=18-3-8, 31=18-3-8, 32=18-3-8	
Max Grav	17=40 (LC 1), 18=120 (LC 1), 19=152 (LC 1), 20=145 (LC 1), 21=147 (LC 1), 22=147 (LC 1), 23=147 (LC 1), 24=147 (LC 1), 25=147 (LC 1), 26=147 (LC 1), 27=147 (LC 1), 28=147 (LC 1), 30=147 (LC 1), 31=147 (LC 1), 32=59 (LC 1)
FORCES (lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-32=-55/0, 16-17=-34/0, 1-2=-7/0, 2-3=-7/0, 3-4=-7/0, 4-5=-7/0, 5-6=-7/0, 6-7=-7/0, 7-8=-7/0, 8-9=-7/0, 9-10=-7/0, 10-11=-7/0, 11-12=-7/0, 12-14=-7/0, 14-15=-7/0, 15-16=-7/0
BOT CHORD	31-32=0/7, 30-31=0/7, 28-30=0/7, 27-28=0/7, 26-27=0/7, 25-26=0/7, 24-25=0/7, 23-24=0/7, 22-23=0/7, 21-22=0/7, 20-21=0/7, 19-20=0/7, 18-19=0/7, 17-18=0/7
WEBS	2-31=-132/0, 3-30=-134/0, 4-28=-133/0, 5-27=-133/0, 6-26=-133/0, 7-25=-133/0, 8-24=-133/0, 9-23=-133/0, 10-22=-133/0, 11-21=-134/0, 12-20=-132/0, 14-19=-138/0, 15-18=-112/0

- NOTES
- 1) All plates are 1.5x3 MT20 unless otherwise indicated.
 - 2) Gable requires continuous bottom chord bearing.
 - 3) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
 - 4) Gable studs spaced at 1-4-0 oc.
 - 5) Recommend 2x6 strongbacks, on edge, spaced at 10-00-00 oc and fastened to each truss with 3-10d (0.131" X 3") nails. Strongbacks to be attached to walls at their outer ends or restrained by other means.

LOAD CASE(S) Standard

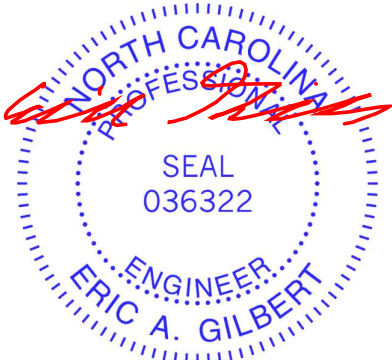

January 13,2025

Symbols

PLATE LOCATION AND ORIENTATION



* Plate location details available in MITek software or upon request.

PLATE SIZE

4 X 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

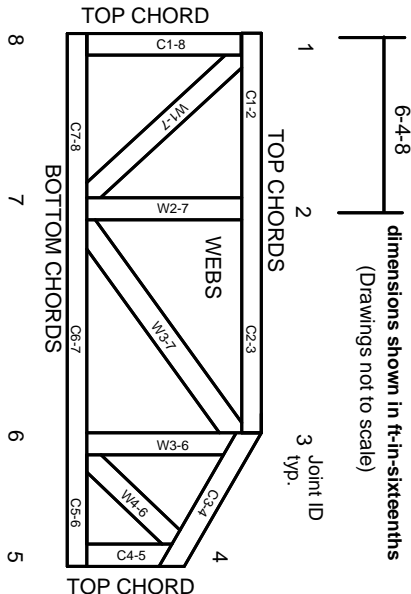

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek®

ENGINEERING BY
TRENCO
A MITek Affiliate

MITek Engineering Reference Sheet: MII-7473 rev. 1/2/2023




Client:
Project:
Address:

Date: 10/10/2025
Input by:
Job Name: 25100038 - A
Project #:

Page 1 of 2

FB2-4 2.1E RigidLam LVL SP 1.750" X 14.000" 4-Ply - PASSED

Level: Level

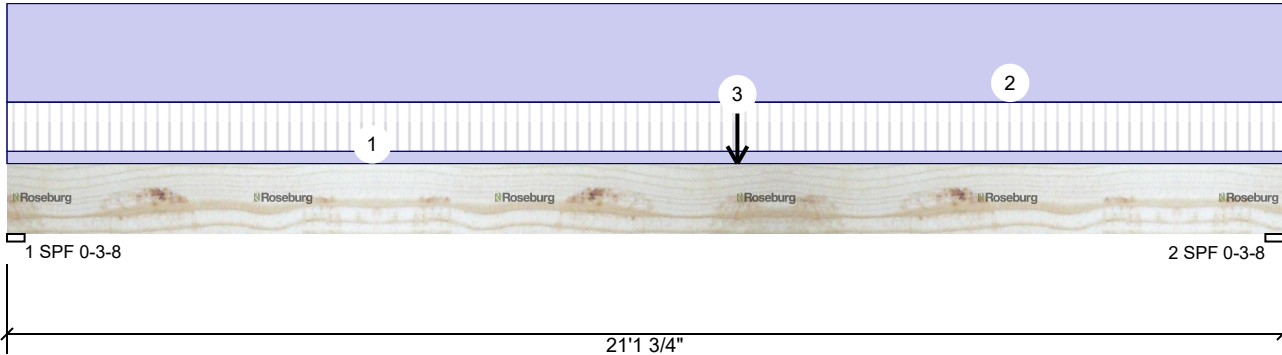

Member Information

Type:	Girder
Plies:	4
Moisture Condition:	Dry
Deflection LL:	480
Deflection TL:	240
Importance:	Normal - II
Temperature:	Temp <= 100°F

Application:	Floor
Design Method:	ASD
Building Code:	IBC/IRC 2015
Load Sharing:	Yes
Deck:	Not Checked

Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind	Const
1	Vertical	423	4236	0	0	0
2	Vertical	423	5272	0	0	0

Bearings

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	3.500"	Vert	45%	4236 / 423	4659	L	D+L
2 - SPF	3.500"	Vert	55%	5272 / 423	5695	L	D+L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	41614 ft-lb	12'1 1/4"	53613 ft-lb	78%	D	Uniform
Unbraced	43707 ft-lb	12'1 1/4"	43947 ft-lb	99%	D+L	L
Shear	5111 lb	19'8 1/4"	17052 lb	30%	D	Uniform
LL Defl inch	0.051 (L/4826)	10'6 15/16"	0.517 (L/480)	10%	L	L
TL Defl inch	0.884 (L/281)	11'1 1/8"	1.034 (L/240)	85%	D+L	L

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings.
- 2 Girders are designed to be supported on the bottom edge only.
- 3 Multiple plies must be fastened together as per manufacturer's details.
- 4 Top loads must be supported equally by all plies.
- 5 Top must be laterally braced at a maximum of 4'3 7/8" o.c.
- 6 Bottom must be laterally braced at end bearings.
- 7 Lateral slenderness ratio based on single ply width.

ID	Load Type	Location	Trib Width	Side	Dead 0.9	Live 1	Snow 1.15	Wind 1.6	Const. 1.25	Comments
1	Uniform		1-0-0	Near Face	10 PSF	40 PSF	0 PSF	0 PSF	0 PSF	standard
2	Uniform			Top	80 PLF	0 PLF	0 PLF	0 PLF	0 PLF	wall
3	Point	12-1-4		Top	7000 lb	0 lb	0 lb	0 lb	0 lb	girder above
	Bearing Length	0-3-8								
	Self Weight				29 PLF					

Notes

Calculated Structured Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 2/14/2027

Manufacturer Info

Roseburg Forest Products
3661 Gateway Street
Springfield, OR 97477
(541) 679-3311
www.roseburg.com
APA: PR-L289, ICC-ES: ESR-1210





Client:
Project:
Address:

Date: 10/10/2025
Input by:
Job Name: 25100038 - A
Project #:

Page 2 of 2

FB3-2 2.1E RigidLam LVL SP 1.750" X 14.000" 2-Ply - PASSED

Level: Level

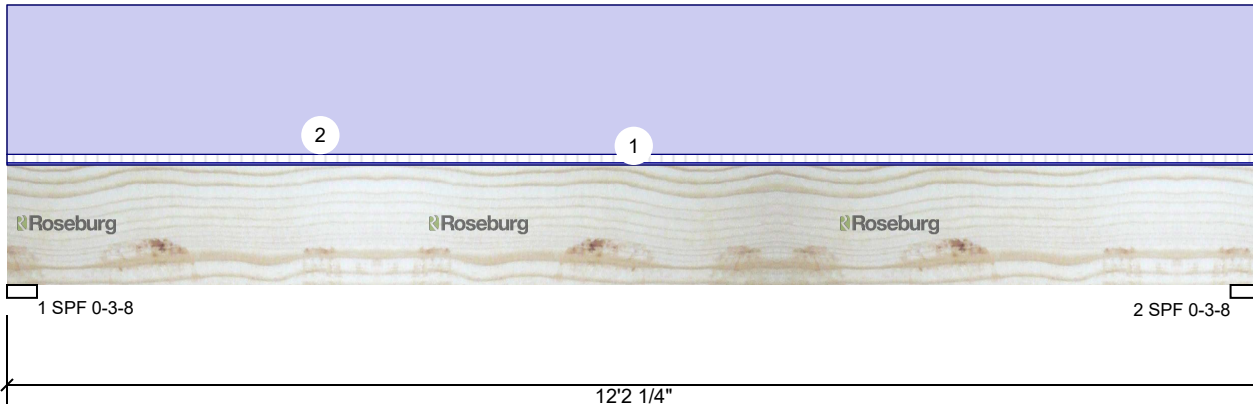

Member Information

Type:	Girder	Application:	Floor
Plies:	2	Design Method:	ASD
Moisture Condition:	Dry	Building Code:	IBC/IRC 2015
Deflection LL:	480	Load Sharing:	No
Deflection TL:	240	Deck:	Not Checked
Importance:	Normal - II		
Temperature:	Temp <= 100°F		

Reactions UNPATTERNED lb (Uplift)

Brg	Direction	Live	Dead	Snow	Wind	Const
1	Vertical	244	4414	0	0	0
2	Vertical	244	4414	0	0	0

Bearings

Bearing	Length	Dir.	Cap.	React D/L lb	Total	Ld. Case	Ld. Comb.
1 - SPF	3.500"	Vert	89%	4414 / 244	4657	L	D+L
2 - SPF	3.500"	Vert	89%	4414 / 244	4657	L	D+L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	12455 ft-lb	6'1 1/8"	25775 ft-lb	48%	D	Uniform
Unbraced	13143 ft-lb	6'1 1/8"	13160 ft-lb	100%	D+L	L
Shear	3357 lb	10'8 3/4"	8526 lb	39%	D	Uniform
LL Defl inch	0.012 (L/12056)	6'1 1/8"	0.293 (L/480)	4%	L	L
TL Defl inch	0.223 (L/631)	6'1 1/8"	0.586 (L/240)	38%	D+L	L

Design Notes

- 1 Provide support to prevent lateral movement and rotation at the end bearings.
- 2 Girders are designed to be supported on the bottom edge only.
- 3 Multiple plies must be fastened together as per manufacturer's details.
- 4 Top loads must be supported equally by all plies.
- 5 Top must be laterally braced at a maximum of 7'9 3/4" o.c.
- 6 Bottom must be laterally braced at end bearings.
- 7 Lateral slenderness ratio based on single ply width.

ID	Load Type	Location	Trib Width	Side	Dead 0.9	Live 1	Snow 1.15	Wind 1.6	Const. 1.25	Comments
1	Uniform		1-0-0	Top	10 PSF	40 PSF	0 PSF	0 PSF	0 PSF	
2	Uniform			Top	700 PLF	0 PLF	0 PLF	0 PLF	0 PLF	
	Self Weight				14 PLF					

Notes

Calculated Structural Designs is responsible only of the structural adequacy of this component based on the design criteria and loadings shown. It is the responsibility of the customer and/or the contractor to ensure the component suitability of the intended application, and to verify the dimensions and loads.

Lumber

1. Dry service conditions, unless noted otherwise
2. LVL not to be treated with fire retardant or corrosive

chemicals

Handling & Installation

1. LVL beams must not be cut or drilled
2. Refer to manufacturer's product information regarding installation requirements, multi-ply fastening details, beam strength values, and code approvals
3. Damaged Beams must not be used
4. Design assumes top edge is laterally restrained
5. Provide lateral support at bearing points to avoid lateral displacement and rotation

6. For flat roofs provide proper drainage to prevent ponding

This design is valid until 2/14/2027


Manufacturer Info

Roseburg Forest Products
3661 Gateway Street
Springfield, OR 97477
(541) 679-3311
www.roseburg.com
APA: PR-L289, ICC-ES: ESR-1210



Carter Sanford Component Plant
298 Harvey Faulk Rd
Sanford, NC 27332

Phone #:919-775-1450

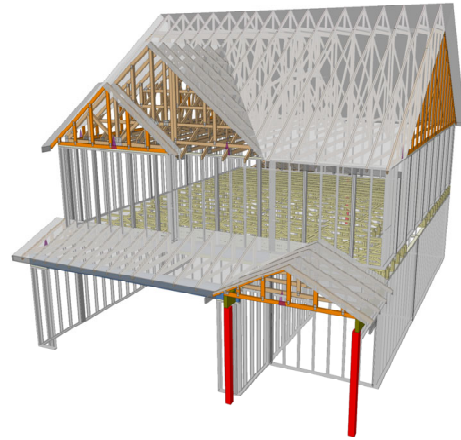

Builder: Wellco Contractor

**Model: 127 Hidden Lakes - Plan 10
GLH**

THE PLACEMENT PLAN NOTES:

1. The Placement Plan is a diagram for truss installation. It is not an engineered drawing and has not been reviewed by an engineer. The Owner/Building Designer is responsible for obtaining an engineer's review if one is required by the local jurisdiction.
2. The responsibilities of the Owner, Contractor, Building Designer, Component Designer and Component Manufacturer shall be as set forth in ANSI/TPI 1. Capitalized terms shall be as defined in ANSI/TP 1 unless otherwise indicated.
3. Each Component is designed as an individual component utilizing information provided by others. The Owner/Building Designer is responsible for reviewing all Component Submittal Packages and individual Component Design Drawings for compliance with the Construction Documents and compatibility with the overall Building design.
4. Contractor will not proceed with component installation until the Owner/Building Designer has reviewed the Component Submittal Package. Questions on the suitability of any Component will be resolved by the Building Designer.
5. The Building Designer and Contractor are responsible for all temporary and permanent bracing.
6. The Placement Plan assumes the building is dimensionally correct, structurally sound, and in a suitable condition to support each Component during installation and thereafter, including but not limited to installation of all bearing points. Proper design and construction of all structural components, including foundations, headers, beams, walls and columns are the responsibility of the Owner, Building Designer and Contractor.
7. Do not cut, drill, or modify any Component without first consulting the Component Manufacturer or Building Designer. Damaged Components shall not be installed unless directed by the Building Designer or approved by the Component Manufacturer.
8. Components must be handled and installed following all applicable safety standards and best practices, including but not limited to BCSI, OSHA, TPI and local codes. Failure to properly handle, brace or otherwise install Component can result in serious injury or death.
9. All uplift connectors shown within these documents are recommendations only. Per ANSI/TPI 1, all uplift connectors are the responsibility of the building designer and or contractor.

Approved By: _____

Date: _____

General Notes:


** CUTTING OR DRILLING OF COMPONENTS SHOULD NOT BE DONE WITHOUT CONTACTING COMPONENT SUPPLIER FIRST. CUSTOMER TAKES FULL RESPONSIBILITY FOR COMPONENTS IF CUT BEFORE AUTHORIZATION.

** ALL BEARING POINTS MUST BE INSTALLED PRIOR TO SETTING ANY COMPONENTS.

** FRAMER MUST REFER TO PLANS WHILE SETTING COMPONENTS.

** DAMAGED COMPONENTS SHOULD NOT BE INSTALLED UNLESS TOLD TO BY THE COMPONENT PLANT.

** TRUSS TO TRUSS CONNECTIONS ARE TOE-NAILED, UNLESS NOTED OTHERWISE.

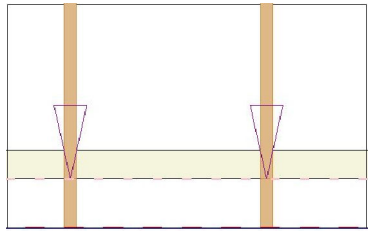


Truss Drawing Left
End Indicator

** TRIANGULAR SYMBOL NEAR END OF TRUSS INDICATES LEFT END OF TRUSS AS SHOWN ON INDIVIDUAL TRUSS DRAWINGS.

** PLUMBING DROPS NOTED ARE IN THE APPROXIMATE LOCATIONS PER PLAN. BUILDER TO VERIFY LOCATIONS BEFORE SETTING TRUSSES.

** REFER TO FINAL TRUSS ENGINEERING SHEETS FOR PLY TO PLY CONNECTIONS.

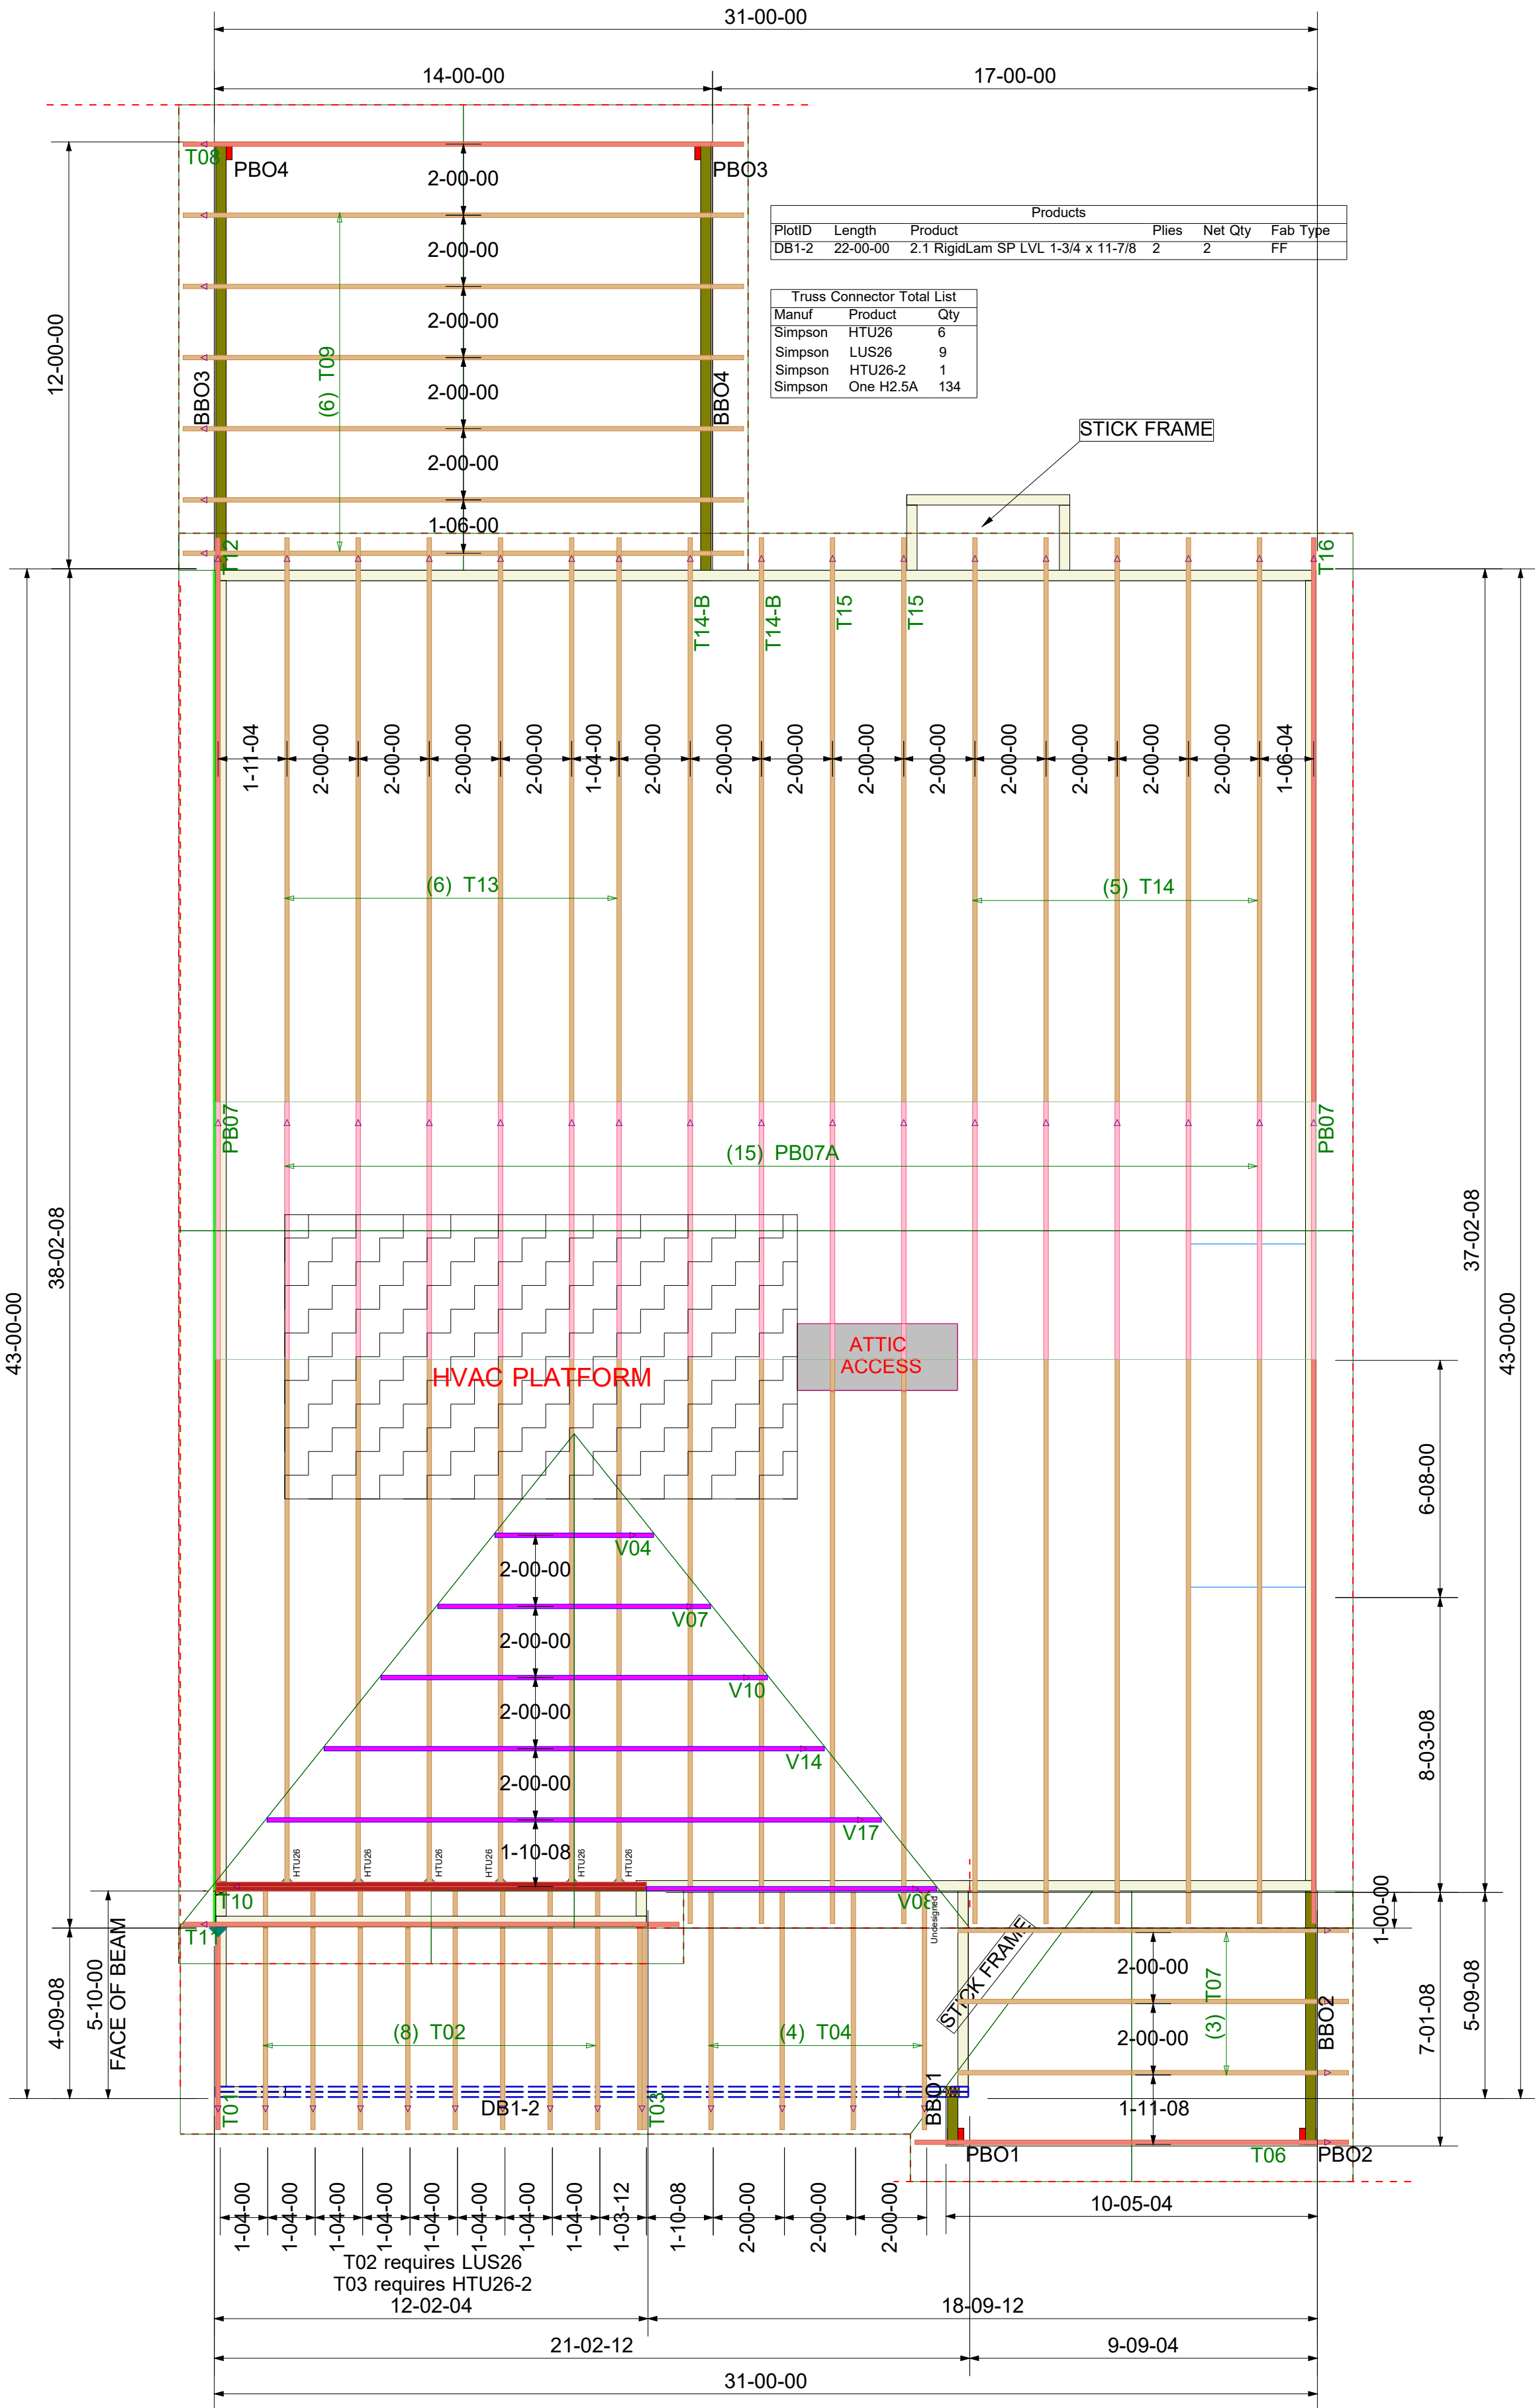

Products					
PlotID	Length	Product	Plies	Net Qty	Fab Type
DB1-2	22-00-00	2.1 RigidLam SP LVL 1-3/4 x 11-7/8	2	2	FF

Truss Connector Total List		
Manuf	Product	Qty
Simpson	HTU26	6
Simpson	LUS26	9
Simpson	HTU26-2	1
Simpson	One H2.5A	134

** GIRDERS MUST BE FULLY CONNECTED TOGETHER PRIOR TO ADDING ANY LOADS. DIMENSIONS ARE READ AS: FOOT-INCH-SIXTEENTH.

** All uplift connectors shown within these documents are recommendations only. Per ANS/ITPI 1, all uplift connectors are the responsibility of the bldg designer and or contractor.

Revisions	
00/00/00	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor systems and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding the bracing, consult "Bracing of Wood Truss" available from the Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53179



Wellco Contractor

29 Hidden Lakes
North-Roof-Plan 10 GLH

ROOF PLACEMENT PLAN

Scale: NTS

Date: 10/10/2025

Designer: Aaron Rogers

Project Number: 25100038-01

Sheet Number:

1/1

RE: 25100038-01
29 Hidden Lakes North-Roof-Plan 10 GLH

Trenco
818 Soundside Rd
Edenton, NC 27932

Site Information:

Customer: Wellco Contractor Project Name: 25100038-01
Lot/Block: 29 Model:
Address: Subdivision: Hidden Lakes North
City: State:

General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):

Design Code: IRC2021/TPI2014 Design Program: MiTek 20/20 8.7
Wind Code: ASCE 7-16 Wind Speed: 130 mph
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 24 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I70688890	V17	1/13/2025	21	I70688910	T02	1/13/2025
2	I70688891	V14	1/13/2025	22	I70688911	T01	1/13/2025
3	I70688892	V10	1/13/2025	23	I70688912	PB07A	1/13/2025
4	I70688893	V08	1/13/2025	24	I70688913	PB07	1/13/2025
5	I70688894	V07	1/13/2025				
6	I70688895	V04	1/13/2025				
7	I70688896	T16	1/13/2025				
8	I70688897	T15	1/13/2025				
9	I70688898	T14-B	1/13/2025				
10	I70688899	T14	1/13/2025				
11	I70688900	T13	1/13/2025				
12	I70688901	T12	1/13/2025				
13	I70688902	T11	1/13/2025				
14	I70688903	T10	1/13/2025				
15	I70688904	T09	1/13/2025				
16	I70688905	T08	1/13/2025				
17	I70688906	T07	1/13/2025				
18	I70688907	T06	1/13/2025				
19	I70688908	T04	1/13/2025				
20	I70688909	T03	1/13/2025				


The truss drawing(s) referenced above have been prepared by
Truss Engineering Co. under my direct supervision
based on the parameters provided by Carter Components (Sanford, NC)).

Truss Design Engineer's Name: Gilbert, Eric

My license renewal date for the state of North Carolina is December 31, 2025.

North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

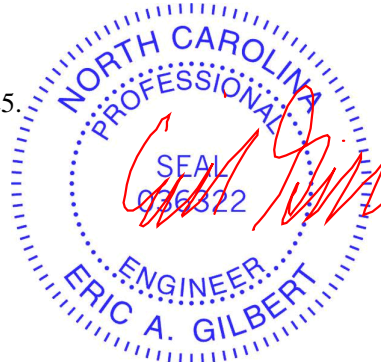

January 13, 2025


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688891
25100038-01	V14	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38

Page: 1

ID:Dvvc1cq1BxPh9x7QGxNimzwn7P-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

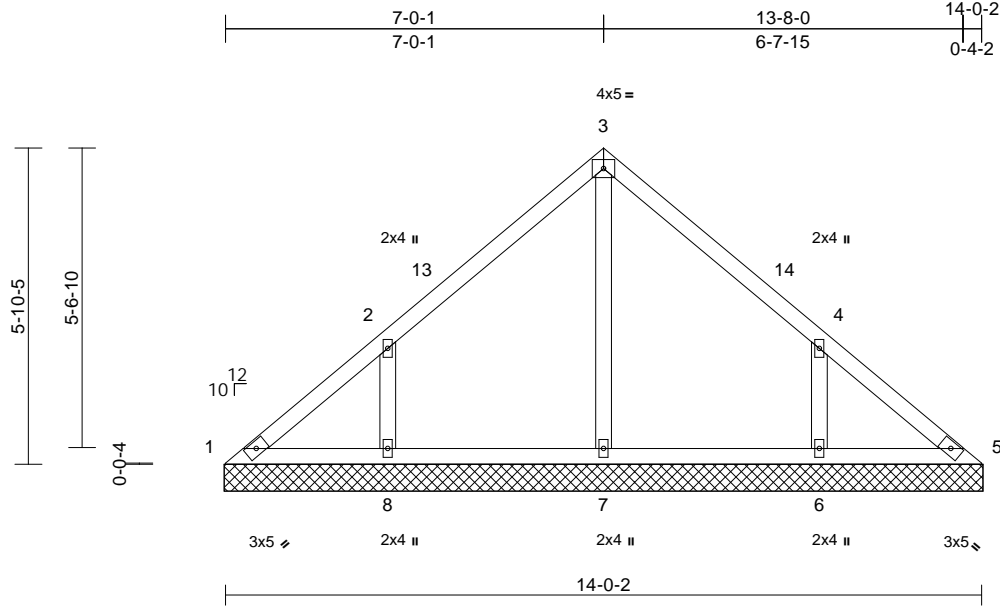

Scale = 1:42.7

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.11	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.13	Horiz(TL)	0.00	5	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 60 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size)	1=14-0-12, 5=14-0-12, 6=14-0-12, 7=14-0-12, 8=14-0-12
Max Horiz	1=-133 (LC 10)
Max Uplift	1=-25 (LC 10), 6=-150 (LC 15), 8=-153 (LC 14)
Max Grav	1=116 (LC 25), 5=92 (LC 24), 6=449 (LC 21), 7=296 (LC 20), 8=449 (LC 20)

FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-146/126, 2-3=-183/117, 3-4=-183/114, 4-5=-115/92
BOT CHORD	1-8=-54/117, 7-8=-54/94, 6-7=-54/94, 5-6=-54/94
WEBS	3-7=-215/0, 2-8=-374/194, 4-6=-374/192

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-6, Interior (1) 3-0-6 to 4-0-6, Exterior(2R) 4-0-6 to 10-0-6, Interior (1) 10-0-6 to 11-0-6, Exterior(2E) 11-0-6 to 14-0-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 1, 153 lb uplift at joint 8 and 150 lb uplift at joint 6.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 5.

LOAD CASE(S) Standard

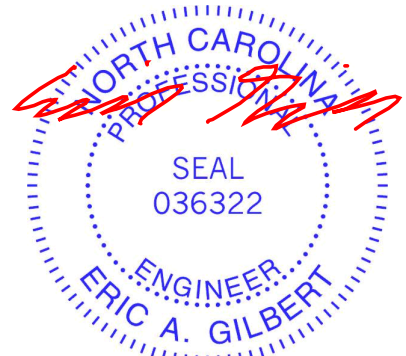

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688892
25100038-01	V10	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38

Page: 1

ID:Dvvc1cq1BXPh9x7QGxNimzwn7P-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

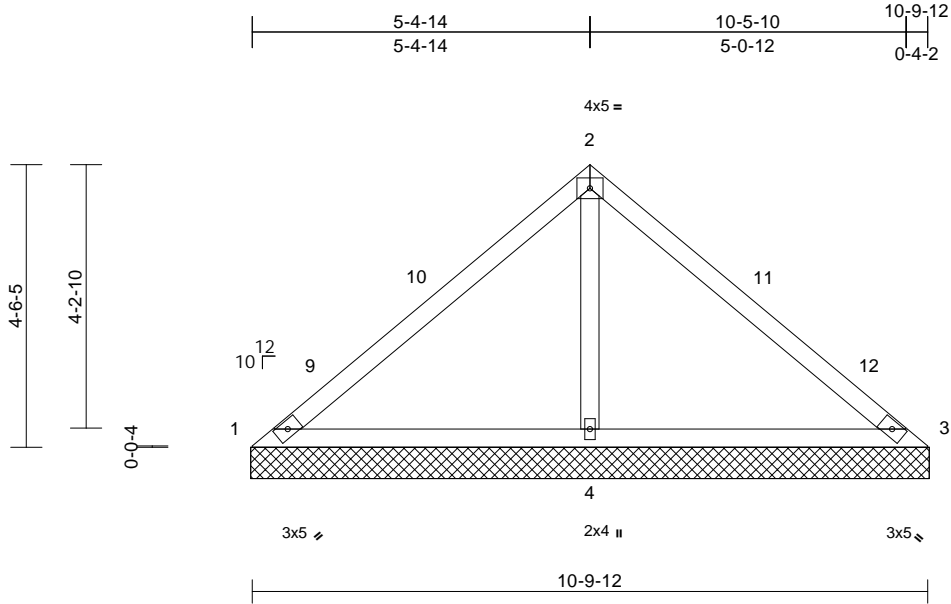

Scale = 1:36.9

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.51	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.27	Horiz(TL)	0.01	4	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 41 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size)	1=10-10-6, 3=10-10-6, 4=10-10-6
Max Horiz	1=-102 (LC 12)
Max Uplift	1=-81 (LC 21), 3=-81 (LC 20), 4=-139 (LC 14)
Max Grav	1=67 (LC 20), 3=67 (LC 21), 4=919 (LC 20)

FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-149/465, 2-3=-149/465
BOT CHORD	1-4=-316/202, 3-4=-316/202
WEBS	2-4=-788/320

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Exterior(2R) 3-0-0 to 7-10-6, Exterior(2E) 7-10-6 to 10-10-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 1, 81 lb uplift at joint 3 and 139 lb uplift at joint 4.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 3.

LOAD CASE(S) Standard

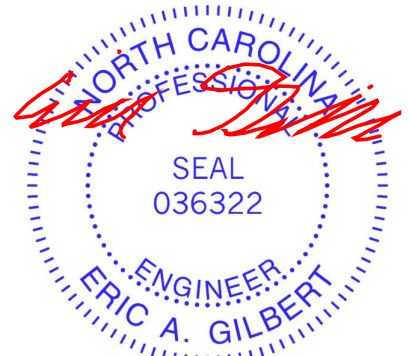

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH
25100038-01	V08	Valley	1	1	170688893
Job Reference (optional)					

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38

Page: 1

ID:Dvvc1cq1BXPh9x7QGxNimzwn7P-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

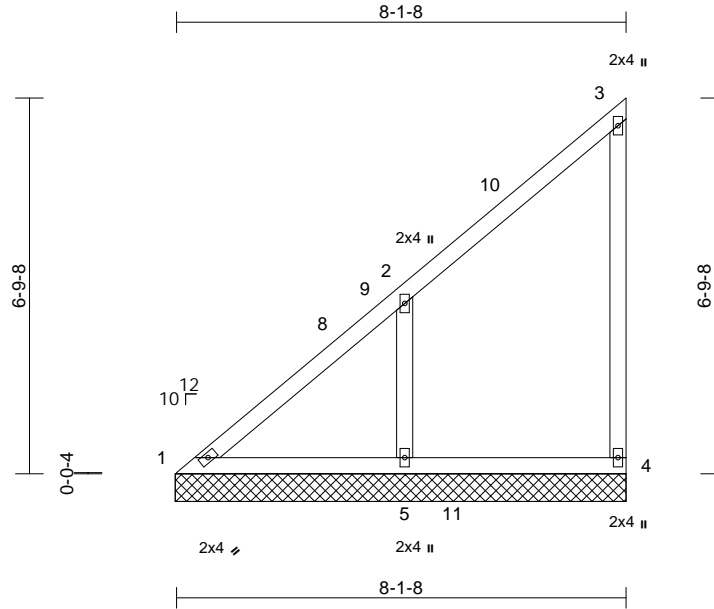

Scale = 1:41.6

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.68	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.19	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.10	Horiz(TL)	0.00	4	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0										
Weight: 41 lb FT = 20%											

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6'-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10'-0-0 oc bracing.

REACTIONS	(size)	1=8-1-13, 4=8-1-13, 5=8-1-13
	Max Horiz	1=223 (LC 11)
	Max Uplift	1=18 (LC 10), 4=56 (LC 11), 5=157 (LC 14)
	Max Grav	1=185 (LC 25), 4=196 (LC 5), 5=524 (LC 5)

FORCES	(lb) - Maximum Compression/Maximum Tension
---------------	--

TOP CHORD	1-2=-246/266, 2-3=-163/151, 3-4=-160/73
BOT CHORD	1-5=-78/212, 4-5=-78/113
WEBS	2-5=-402/309

NOTES

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior (1) 3-0-0 to 3-9-2, Exterior(2R) 3-9-2 to 8-0-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 4'-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3'-06-00 tall by 2'-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 56 lb uplift at joint 4, 18 lb uplift at joint 1 and 157 lb uplift at joint 5.
- 10) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1.

LOAD CASE(S) Standard



January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688894
25100038-01	V07	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38
ID:o7ulAWxTBLFIrFLHnz6txFzwn26-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

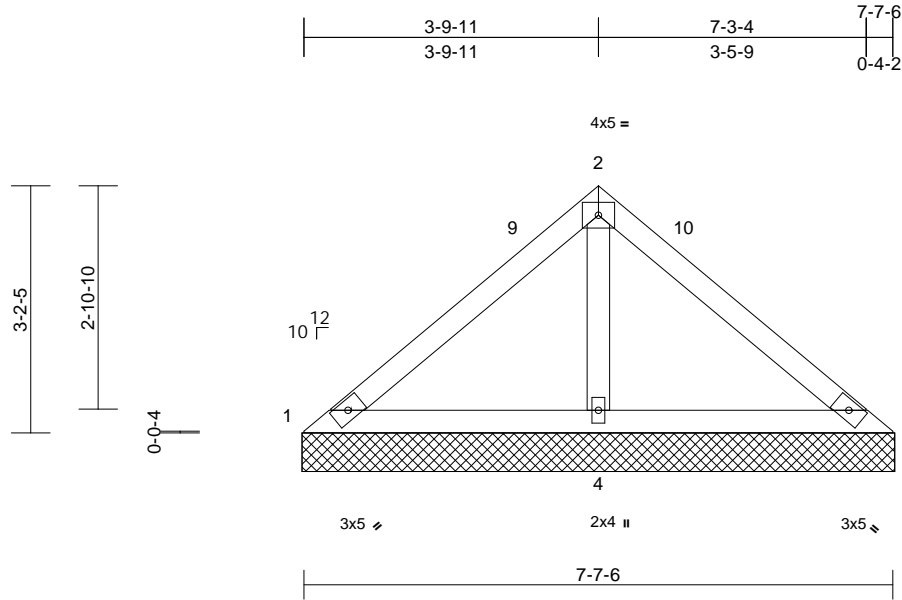

Scale = 1:29.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.30	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.10	Horiz(TL)	0.00	4	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 28 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 7-7-6 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size)	1=7-7-15, 3=7-7-15, 4=7-7-15
Max Horiz	1=-71 (LC 10)
Max Uplift	1=-29 (LC 21), 3=-29 (LC 20), 4=-83 (LC 14)
Max Grav	1=102 (LC 20), 3=102 (LC 21), 4=588 (LC 20)

FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-104/263, 2-3=-104/263
BOT CHORD	1-4=-205/165, 3-4=-205/165
WEBS	2-4=-472/222

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Exterior(2R) 3-0-0 to 4-7-15, Exterior(2E) 4-7-15 to 7-7-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 1, 29 lb uplift at joint 3 and 83 lb uplift at joint 4.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 3.

LOAD CASE(S) Standard

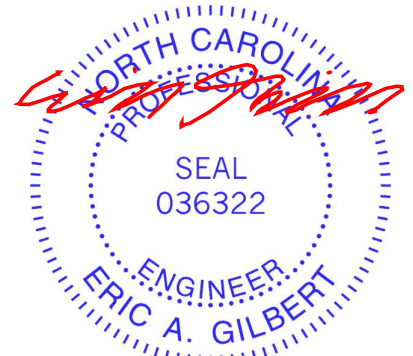

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688895
25100038-01	V04	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38
ID:o7ulAWxTBLFlrFLHnz6txFzwn26-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

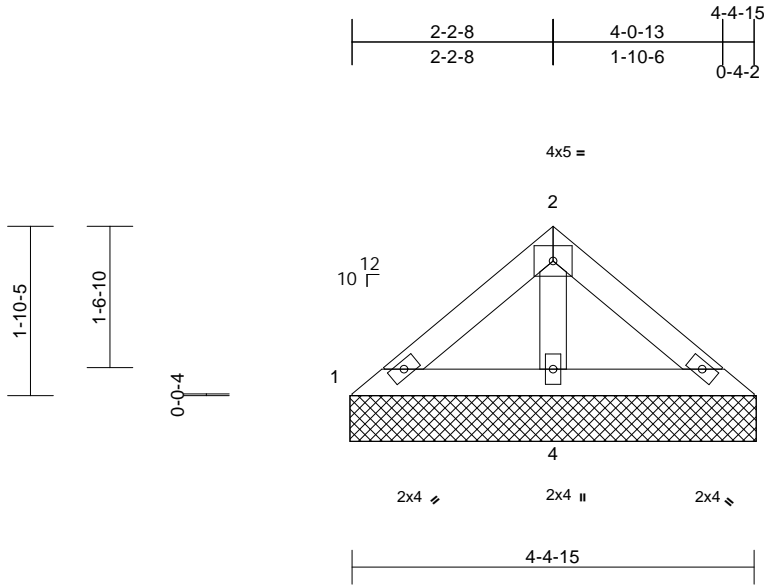

Scale = 1:25.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.07	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.09	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	4	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 16 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-4-15 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS

(size)	1=4-5-9, 3=4-5-9, 4=4-5-9
Max Horiz	1=-39 (LC 10)
Max Uplift	3=-7 (LC 15), 4=-28 (LC 14)
Max Grav	1=83 (LC 20), 3=83 (LC 21), 4=264 (LC 20)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD	1-2=-76/89, 2-3=-76/89
BOT CHORD	1-4=-73/77, 3-4=-73/77
WEBS	2-4=-181/80

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 7 lb uplift at joint 3 and 28 lb uplift at joint 4.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 3.

LOAD CASE(S) Standard

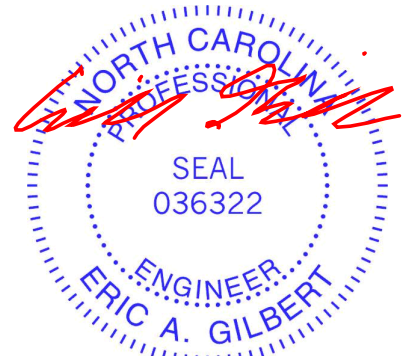

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688896
25100038-01	T16	Piggyback Base Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 E Nov 16 2023 Print: 8.730 E Nov 16 2023 MiTek Industries, Inc. Mon Jan 13 09:10:31
ID:1TBkY_oeWsuG414YKOK8E1zwmxq-pYdKIVL2VmQVNaJn8wFn9GF1ooT9t49EWvB5Yzw_xc

Page: 1

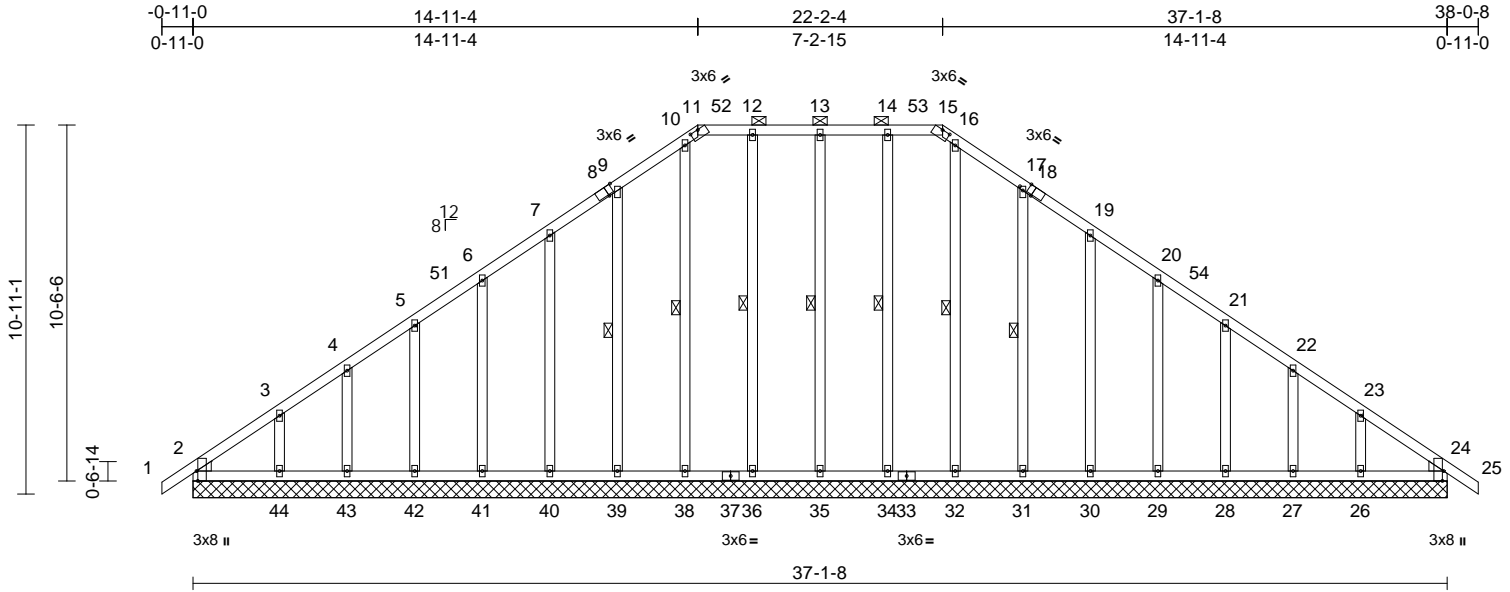

Scale = 1:68.2

Plate Offsets (X, Y): [2:0-3-8,Edge], [8:0-2-1,Edge], [9:0-1-8,0-1-0], [11:0-3-0,0-0-2], [15:0-3-0,0-0-2], [17:0-1-8,0-1-0], [18:0-2-1,Edge], [24:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	n/a	-	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.20	Horz(CT)	0.01	24	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
Weight: 288 lb FT = 20%											

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3
WEDGE Left: 2x4 SP No.3
Right: 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 11-15.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 13-35, 12-36, 10-38, 9-39, 14-34, 16-32, 17-31

REACTIONS

All bearings 37-1-8.
(lb) - Max Horiz 2=-249 (LC 12), 45=-249 (LC 12)
Max Uplift All uplift 100 (lb) or less at joint(s)
2, 24, 26, 27, 28, 29, 30, 31, 34, 35, 36, 38, 39, 40, 41, 42, 43, 45, 48 except 44=-109 (LC 14)
Max Grav All reactions 250 (lb) or less at joint (s) 2, 24, 26, 27, 28, 29, 30, 31, 32, 34, 35, 36, 38, 39, 40, 41, 42, 43, 44, 45, 48

FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 2-6-12, Exterior(2N) 2-6-12 to 11-2-12, Corner(3R) 11-2-12 to 25-10-12, Exterior(2N) 25-10-12 to 34-3-15, Corner(3E) 34-3-15 to 38-0-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- N/A

14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

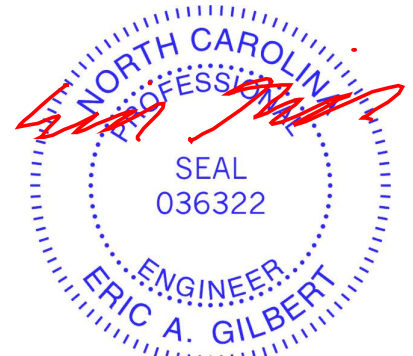

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688897
25100038-01	T15	Piggyback Base	2	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:37

Page: 1

ID:QOImBn4C6eyMxqFrVl9WoizwnQS-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrdCoI7J4zJC?f

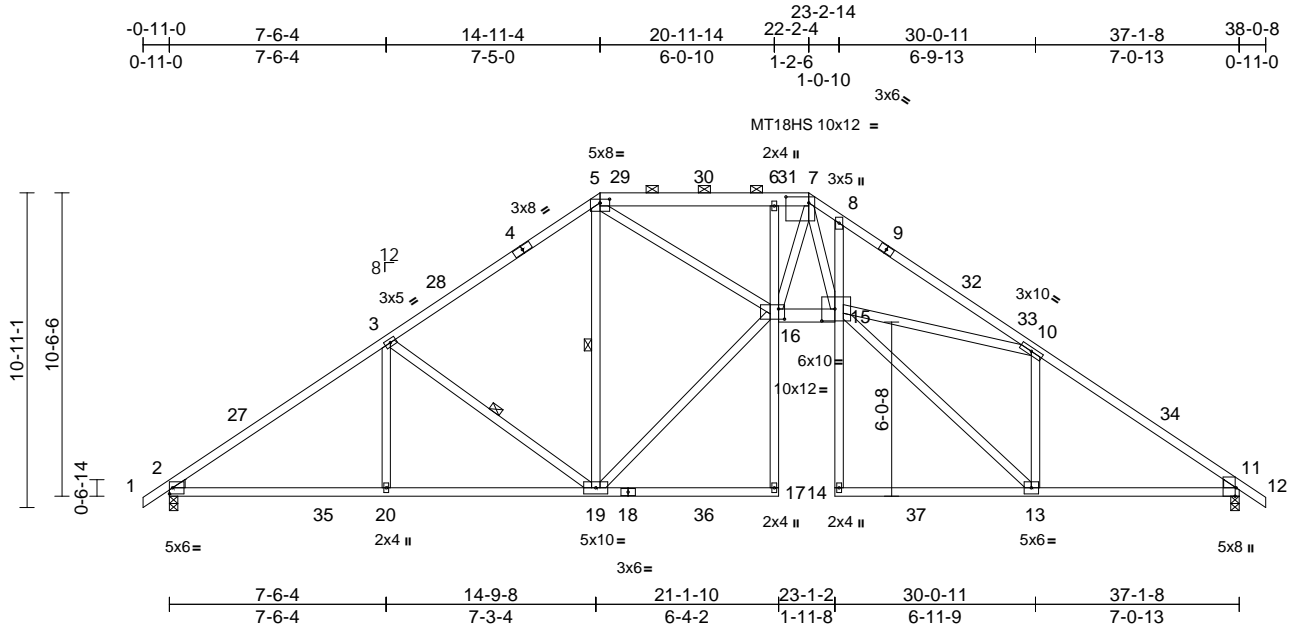

Scale = 1:80

Plate Offsets (X, Y): [5:0-4-0,0-1-9], [7:0-9-8,0-2-8], [11:0-3-8,Edge], [15:0-5-8,0-5-0], [16:0-2-8,0-4-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.74	Vert(LL)	-0.37	13-14	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.89	Vert(CT)	-0.64	13-14	>697	180	MT18HS	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.91	Horz(CT)	0.53	11	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 260 lb	FT = 20%

LUMBER		
TOP CHORD	2x4 SP 2400F 2.0E *Except* 5-7:2x6 SP No.2	
BOT CHORD	2x4 SP No.2 *Except* 17-6,8-14:2x4 SP No.3, 16-15:2x6 SP No.2	
WEBS	2x4 SP No.3 *Except*	
WEDGE	Left: 2x4 SP No.3 Right: 2x4 SP No.3	
BRACING		
TOP CHORD	Structural wood sheathing directly applied or 2-6-11 oc purlins, except 2-0-0 oc purlins (3-4-6 max.): 5-7. Rigid ceiling directly applied or 10-0-0 oc bracing.	
BOT CHORD		
WEBS	1 Row at midpt 3-19, 5-19	
REACTIONS		
(size)	2=0-3-8, 11=0-3-8	
Max Horiz	2=-248 (LC 12)	
Max Uplift	2=-158 (LC 14), 11=-158 (LC 15)	
Max Grav	2=1791 (LC 51), 11=1782 (LC 53)	
FORCES		
(lb) - Maximum Compression/Maximum Tension		
TOP CHORD	1-2=0/31, 2-3=-2899/224, 3-5=-2290/249, 5-6=-4324/225, 6-7=-4331/225, 7-8=-5992/330, 8-10=-6158/222, 10-11=-2909/220, 11-12=0/31	
BOT CHORD	2-20=-226/2318, 19-20=-226/2318, 17-19=0/16, 16-17=0/140, 6-16=-534/187, 15-16=0/4139, 14-15=0/164, 8-15=-372/231, 13-14=0/32, 11-13=-60/2324	

WEBS 3-20=0/319, 3-19=-780/231, 5-19=-949/63, 16-19=-57/2376, 5-16=0/3037, 7-16=-176/606, 7-15=-183/2981, 13-15=-86/3083, 10-15=0/2654, 10-13=-1814/134

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-9-9, Interior (1) 2-9-9 to 9-8-4, Exterior(2R) 9-8-4 to 27-5-4, Interior (1) 27-5-4 to 34-3-15, Exterior(2E) 34-3-15 to 38-0-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 11. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard



January 13, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:37 Page: 1
ID: A11MRIs5Zoo7wT5WXhZrnBzwn7N-RfC?PsB70Hg3NSgPqnL8w3uITXBGKwCDoi7J4zJC?f



LUMBER		WEBS	3-19=0/332, 3-18=-789/234, 5-18=-67/652, 8-11=0/249, 6-21=-43/965, 12-21=-154/770, 20-23=-623/0, 22-23=-623/0, 21-22=-623/0, 13-22=0/18, 15-23=0/9, 15-20=0/608, 13-21=0/573, 8-12=-677/255, 16-20=-216/154, 6-20=-85/305, 5-16=-56/302	8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads. 9) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf. 10) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to
TOP CHORD	2x4 SP 2400F 2.0E *Except* 5-6:2x6 SP No.2			
BOT CHORD	2x4 SP No.2			
WEBS	2x4 SP No.3 *Except* 6-12,16-6,16-5:2x4 SP No.1			
WEDGE	Left: 2x4 SP No.3 Right: 2x4 SP No.3	NOTES	1) Unbalanced roof live loads have been considered for	

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTEK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbccomponents.com)

ENGINEERING BY
TRENCO
A MITek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688899
25100038-01	T14	Piggyback Base	5	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:37
ID:8QQo8oYTTFF3pzWbURDtczmy9-RfC?PsB70Hq3NSgPqnL8w3uTXbGKWrCDoi7J4zJC?i

Page: 1

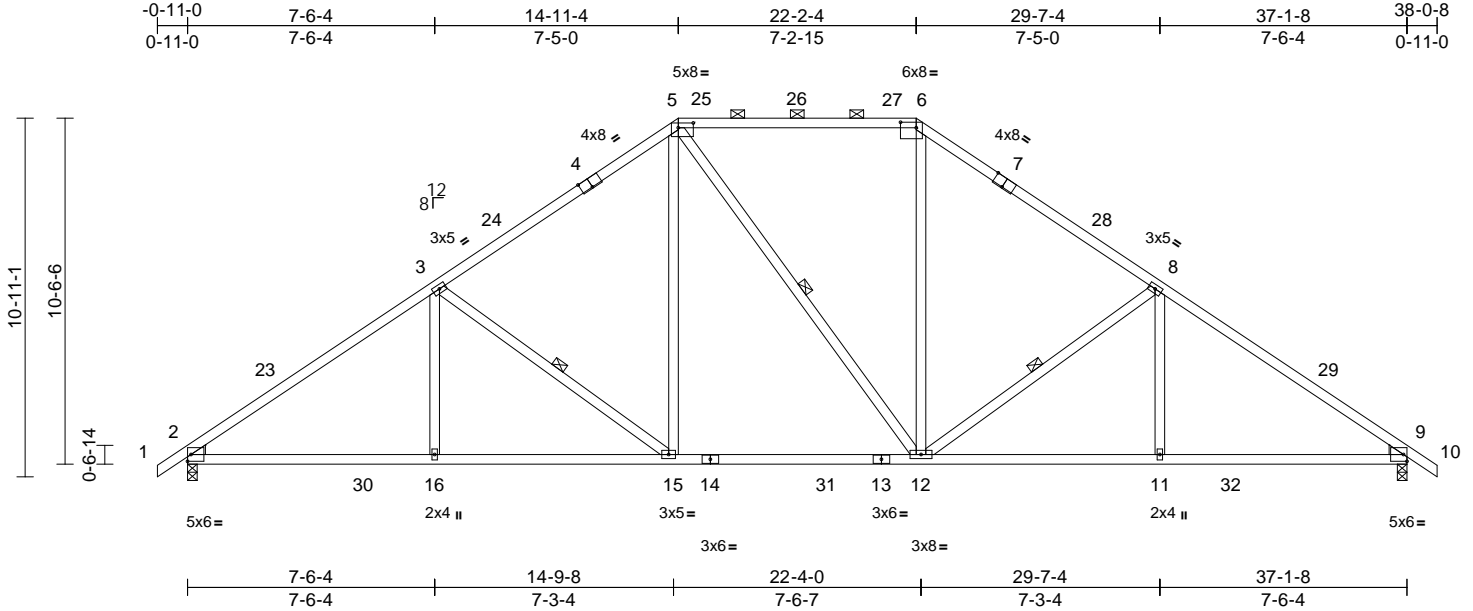

Scale = 1:70.1												
Plate Offsets (X, Y): [4:0-4-0,Edge], [5:0-5-8,0-1-12], [6:0-5-12,0-2-0], [7:0-4-0,Edge]												
Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	-0.20	12-15	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.91	Vert(CT)	-0.31	12-15	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.33	Horz(CT)	0.12	9	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 213 lb	FT = 20%

LUMBER
TOP CHORD 2x4 SP 2400F 2.0E
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3 *Except* 12-5:2x4 SP No.2
WEDGE Left: 2x4 SP No.3
Right: 2x4 SP No.3


BRACING
TOP CHORD Structural wood sheathing directly applied or 4-4-9 oc purlins, except 2-0-0 oc purlins (5-5-7 max.): 5-6.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 3-15, 5-12, 8-12
REACTIONS (size) 2=0-3-8, 9=0-3-8
Max Horiz 2=-249 (LC 12)
Max Uplift 2=-158 (LC 14), 9=-158 (LC 15)
Max Grav 2=1805 (LC 51), 9=1799 (LC 53)

FORCES (lb) - Maximum Compression/Maximum Tension
TOP CHORD 1-2=0/31, 2-3=-2923/224, 3-5=-2315/248, 5-6=-1790/266, 6-8=-2306/248, 8-9=-2914/225, 9-10=0/31
BOT CHORD 2-16=-227/2340, 15-16=-227/2340, 12-15=-37/1696, 11-12=-60/2332, 9-11=-60/2332
WEBS 3-16=0/309, 3-15=-792/234, 5-15=-45/781, 5-12=-208/210, 6-12=-28/759, 8-12=-793/234, 8-11=0/311

NOTES
1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-9-9, Interior (1) 2-9-9 to 9-8-4, Exterior(2R) 9-8-4 to 27-5-4, Interior (1) 27-5-4 to 34-3-15, Exterior(2E) 34-3-15 to 38-0-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) Provide adequate drainage to prevent water ponding.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 9. This connection is for uplift only and does not consider lateral forces.
- 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

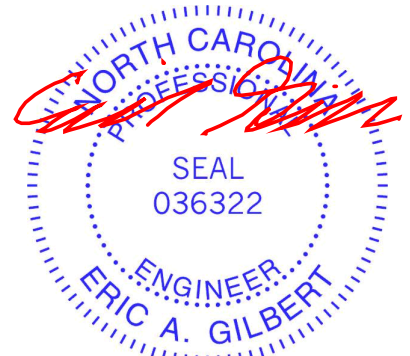

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688900
25100038-01	T13	Piggyback Base	6	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36

Page: 1

ID:u9RQCydAlZqeYqRbuo?8bzwnCq-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

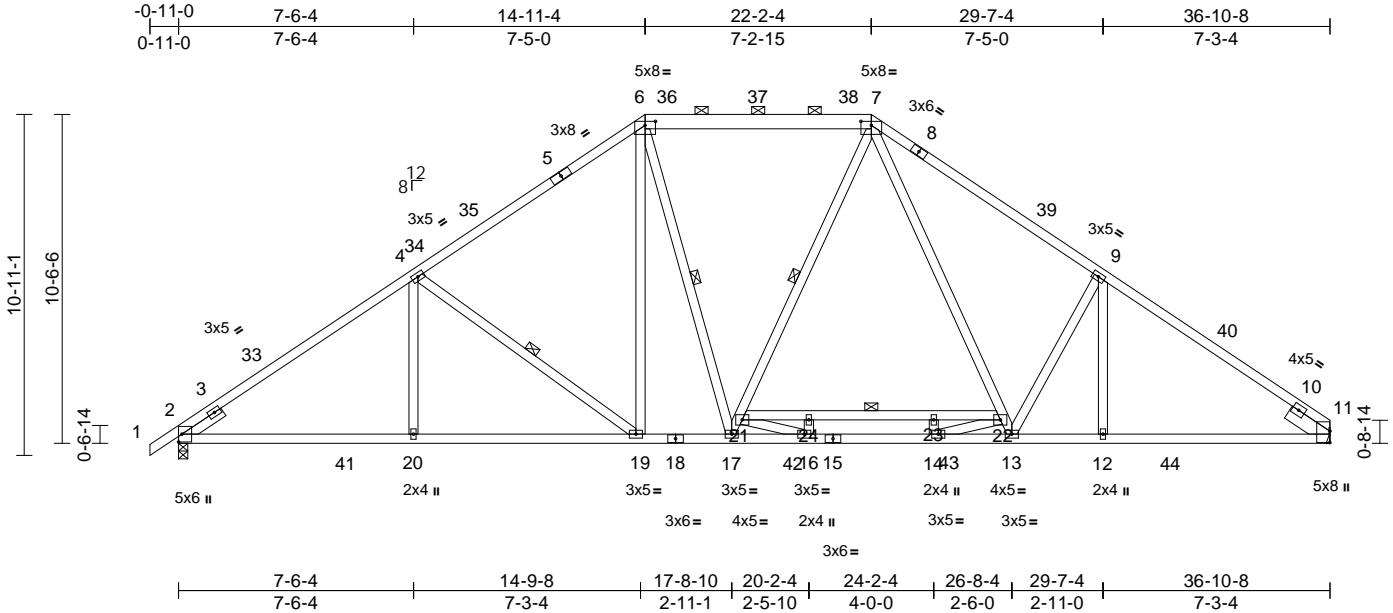

Scale = 1:73.8

Plate Offsets (X, Y): [6:0-4-0,0-1-9], [7:0-4-0,0-1-9], [11:0-4-6,0-0-1]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	-0.13	19-20	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.51	Vert(CT)	-0.26	19-20	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.41	Horz(CT)	0.10	11	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 251 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP 2400F 2.0E *Except* 6-7:2x6 SP No.2, 7-8:2x4 SP No.1
BOT CHORD	2x4 SP 2400F 2.0E
WEBS	2x4 SP No.3 *Except* 17-7,7-13,17-6:2x4 SP No.2
SLIDER	Left 2x4 SP No.3 -- 1-6-0, Right 2x6 SP No.2 -- 1-6-0

BRACING

TOP CHORD	Structural wood sheathing directly applied, except 2-0-0 oc purlins (4-9-15 max.): 6-7.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 4-19, 7-17, 21-22, 6-17

REACTIONS

(size)	2=0-3-8, 11= Mechanical
Max Horiz	2=242 (LC 11)
Max Uplift	2=-79 (LC 14), 11=-17 (LC 15)
Max Grav	2=1838 (LC 51), 11=1819 (LC 47)

FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/35, 2-4=-2904/86, 4-6=-2336/111, 6-7=-1863/122, 7-9=-2730/112, 9-11=-2917/31
BOT CHORD	2-20=-124/2320, 19-20=-124/2320, 17-19=0/1722, 16-17=0/1734, 14-16=0/2227, 13-14=0/1785, 12-13=0/2330, 11-12=-92/2330
WEBS	4-20=0/315, 4-19=-741/232, 6-19=-66/629, 9-12=-11/191, 17-21=-207/153, 7-21=-78/303, 7-22=-41/916, 13-22=-149/728, 21-24=-609/0, 23-24=-609/0, 22-23=-609/0, 14-23=0/13, 16-24=0/9, 16-21=0/583, 14-22=0/550, 6-17=-52/294, 9-13=-584/261

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-9-4, Interior (1) 2-9-4 to 9-8-11, Exterior(2R) 9-8-11 to 27-4-13, Interior (1) 27-4-13 to 33-2-4, Exterior(2E) 33-2-4 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 200.0lb AC unit load placed on the bottom chord, 22-2-4 from left end, supported at two points, 5-0-0 apart.
- Provide adequate drainage to prevent water ponding.
- All plates are 3x5 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 11.

- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

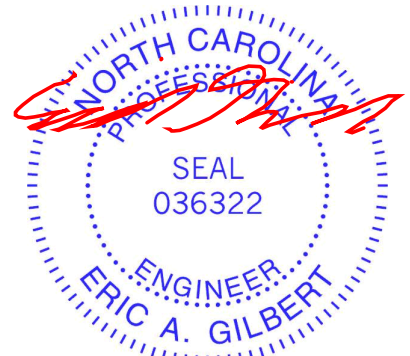

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688901
25100038-01	T12	Piggyback Base Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36

Page: 1

ID:bpWnkZYnOQxeDlt5gwAML7zwnCxRfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDdoI7J4zJC?f

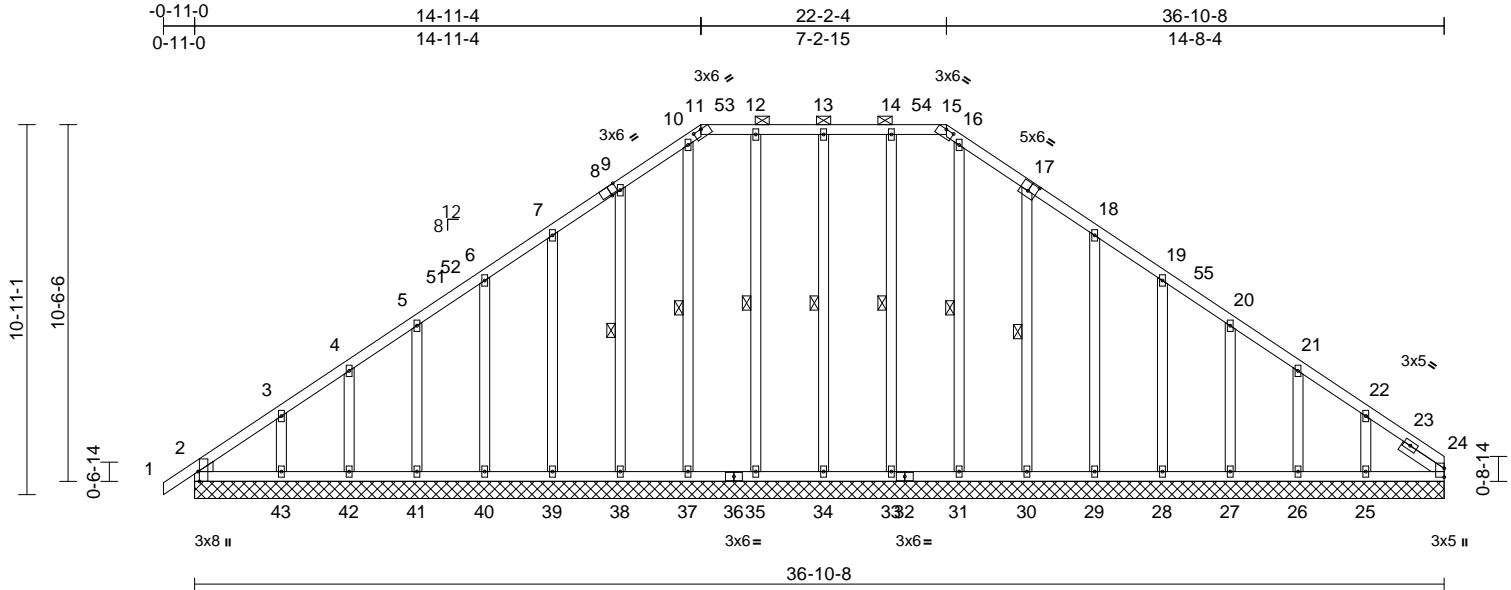

Scale = 1:68

Plate Offsets (X, Y): [2:0-3-8,Edge], [8:0-2-9,Edge], [11:0-3-0,0-0-2], [15:0-3-0,0-0-2], [17:0-3-0,0-3-0]

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.07	Vert(CT)	n/a	-	n/a	999	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.19	Horz(CT)	0.01	24	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
Weight: 287 lb FT = 20%											

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3
WEDGE Left: 2x4 SP No.3
SLIDER Right 2x4 SP No.3 -- 1-6-0

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 11-15.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS 1 Row at midpt 13-34, 12-35, 10-37, 9-38, 14-33, 16-31, 17-30

REACTIONS

(size) 2=36-10-8, 24=36-10-8, 25=36-10-8, 26=36-10-8, 27=36-10-8, 28=36-10-8, 29=36-10-8, 30=36-10-8, 31=36-10-8, 33=36-10-8, 34=36-10-8, 35=36-10-8, 37=36-10-8, 38=36-10-8, 39=36-10-8, 40=36-10-8, 41=36-10-8, 42=36-10-8, 43=36-10-8
Max Horiz 2=236 (LC 11)
Max Uplift 2=62 (LC 10), 24=13 (LC 13), 25=115 (LC 15), 26=40 (LC 15), 27=60 (LC 15), 28=56 (LC 15), 29=51 (LC 15), 30=70 (LC 15), 33=23 (LC 11), 34=32 (LC 10), 35=22 (LC 11), 37=6 (LC 11), 38=67 (LC 14), 39=55 (LC 14), 40=55 (LC 14), 41=60 (LC 14), 42=41 (LC 14), 43=105 (LC 14)

FORCES

TOP CHORD

(lb) - Maximum Compression/Maximum Tension
1-2=0/30, 2-3=-229/188, 3-4=-169/154, 4-5=-146/138, 5-6=-132/131, 6-7=-130/147, 7-9=-129/179, 9-10=-159/216, 10-11=-135/184, 11-12=-129/201, 12-13=-129/201, 13-14=-129/201, 14-15=-129/201, 15-16=-135/185, 16-18=-160/213, 18-19=-110/104, 19-20=-75/55, 20-21=-78/46, 21-22=-105/63, 22-24=-169/98

BOT CHORD

2-43=-109/159, 42-43=-75/159, 41-42=-75/159, 40-41=-75/159, 39-40=-75/159, 38-39=-75/159, 37-38=-75/159, 35-37=-75/159, 34-35=-75/159, 33-34=-75/159, 31-33=-75/159, 30-31=-75/159, 29-30=-74/158, 28-29=-74/158, 27-28=-74/158, 26-27=-74/158, 25-26=-74/158, 24-25=-74/158
13-34=-183/60, 12-35=-178/45, 10-37=-142/29, 9-38=-198/90, 7-39=-186/78, 6-40=-182/79, 5-41=-145/81, 4-42=-131/73, 3-43=-165/102, 14-33=-177/46, 16-31=-134/0, 17-30=-197/93, 18-29=-178/74, 19-28=-181/80, 20-27=-142/81, 21-26=-132/71, 22-25=-166/114

WEBS

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 2-6-12, Exterior(2N) 2-6-12 to 11-3-0, Corner(3R) 11-3-0 to 25-10-8, Exterior (2N) 25-10-8 to 33-2-4, Corner(3E) 33-2-4 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10



January 13, 2025

Continued on page 2

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH
25100038-01	T12	Piggyback Base Supported Gable	1	1	I70688901
Job Reference (optional)					

- 5) Unbalanced snow loads have been considered for this design.
- 6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 7) Provide adequate drainage to prevent water ponding.
- 8) All plates are 2x4 MT20 unless otherwise indicated.
- 9) Gable requires continuous bottom chord bearing.
- 10) Gable studs spaced at 2-0-0 oc.
- 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 12) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 13) N/A

- 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688902
25100038-01	T11	Common Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36

Page: 1

ID: ?addf8zgiguRNSCttrJ6P?zwnDh-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

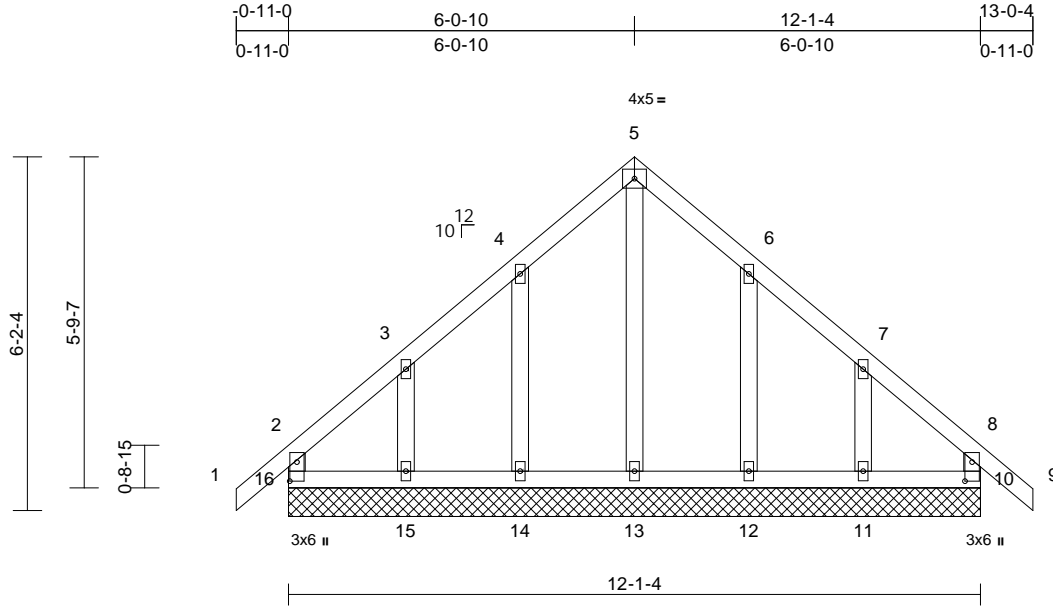

Scale = 1:40.3

Plate Offsets (X, Y): [10:0-4-0,0-1-8], [16:0-4-0,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.15	Vert(LL)	n/a	-	n/a	999	MT20
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.05	Vert(CT)	n/a	-	n/a	999	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.12	Horz(CT)	0.00	10	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR							
BCDL	10.0										
Weight: 71 lb FT = 20%											

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS (size)	10=12-1-4, 11=12-1-4, 12=12-1-4, 13=12-1-4, 14=12-1-4, 15=12-1-4, 16=12-1-4
Max Horiz	16=155 (LC 12)
Max Uplift	10=23 (LC 11), 11=103 (LC 15), 12=72 (LC 15), 14=71 (LC 14), 15=106 (LC 14), 16=42 (LC 10)
Max Grav	10=148 (LC 37), 11=188 (LC 22), 12=277 (LC 22), 13=175 (LC 28), 14=277 (LC 21), 15=188 (LC 21), 16=161 (LC 26)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD	2-16=-134/111, 1-2=0/41, 2-3=-101/90, 3-4=-74/121, 4-5=-118/225, 5-6=-118/224, 6-7=-72/122, 7-8=-81/66, 8-9=0/41, 8-10=-130/108
BOT CHORD	15-16=-66/139, 14-15=-66/139, 13-14=-66/139, 12-13=-66/139, 11-12=-66/139, 10-11=-66/139
WEBS	5-13=-205/50, 4-14=-236/137, 3-15=-163/156, 6-12=-236/136, 7-11=-160/160


NOTES

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 2-0-10, Exterior(2N) 2-0-10 to 3-0-10, Corner(3R) 3-0-10 to 9-0-10, Exterior (2N) 9-0-10 to 10-0-4, Corner(3E) 10-0-4 to 13-0-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 7) All plates are 2x4 MT20 unless otherwise indicated.
- 8) Gable requires continuous bottom chord bearing.
- 9) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 10) Gable studs spaced at 2-0-0 oc.
- 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 12) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 42 lb uplift at joint 16, 23 lb uplift at joint 10, 71 lb uplift at joint 14, 106 lb uplift at joint 15, 72 lb uplift at joint 12 and 103 lb uplift at joint 11.

LOAD CASE(S) Standard

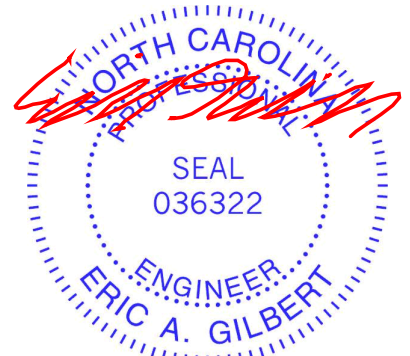

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688903
25100038-01	T10	Common Girder	1	2	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36

Page: 1

ID:hu8G0u_FZlKtF20oBp55zwn22-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

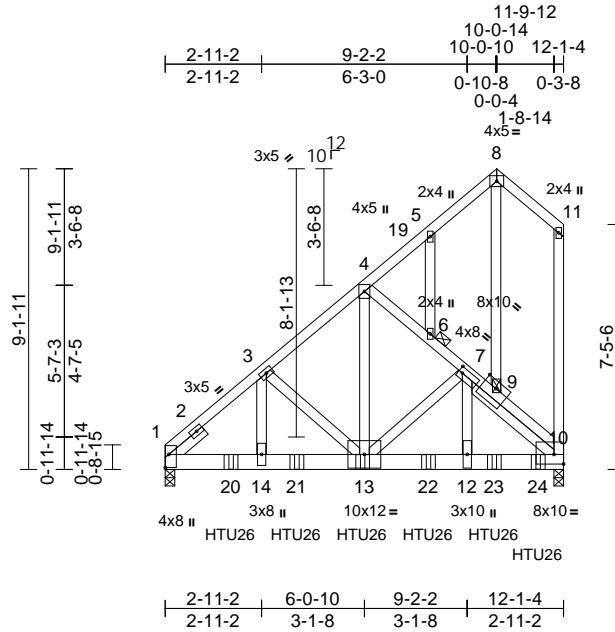

Scale = 1:70

Plate Offsets (X, Y): [1:Edge,0-1-5], [7:0-1-8,0-2-0], [9:0-5-0,0-2-8], [10:Edge,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.05	13-14	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.38	Vert(CT)	-0.09	13-14	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.65	Horz(CT)	0.01	10	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 242 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x6 SP 2400F 2.0E
WEBS	2x4 SP No.3 *Except* 4-13:2x4 SP No.2
OTHERS	2x4 SP No.3
SLIDER	Left 2x4 SP No.3 -- 1-3-11

BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-7-3 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
JOINTS	1 Brace at Jt(s): 6, 9

REACTIONS

(size)	1=0-3-8, 10=0-3-8
Max Horiz	1=282 (LC 11)
Max Uplift	1=-90 (LC 12), 10=-203 (LC 12)
Max Grav	1=5064 (LC 22), 10=6663 (LC 21)


FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-3=-5817/119, 3-4=-4469/116, 4-5=-229/130, 5-8=-196/121, 8-11=-223/108, 4-6=-4413/204, 6-7=-4489/253, 7-9=-6315/270, 9-10=-6320/224, 10-11=-236/79
BOT CHORD	1-14=-214/4424, 13-14=-214/4424, 12-13=-190/4809, 10-12=-194/5008
WEBS	5-6=-144/76, 8-9=-148/210, 4-13=-106/5318, 3-13=-1254/119, 3-14=-25/1756, 7-12=-52/2524, 7-13=-1768/41

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x6 - 3 rows staggered at 0-7-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc, Except member 4-13 2x4 - 1 row at 0-6-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1 and 10. This connection is for uplift only and does not consider lateral forces.
 - Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
 - Use Simpson Strong-Tie HTU26 (10-16d Girder, 14-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 2-0-0 from the left end to 11-4-0 to connect truss(es) to back face of bottom chord.
 - Fill all nail holes where hanger is in contact with lumber.
- LOAD CASE(S)** Standard
- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-4=-60, 4-8=-60, 8-11=-60, 10-15=-20
Concentrated Loads (lb)
Vert: 13=-1710 (B), 20=-1710 (B), 21=-1710 (B), 22=-1710 (B), 23=-1710 (B), 24=-1714 (B)

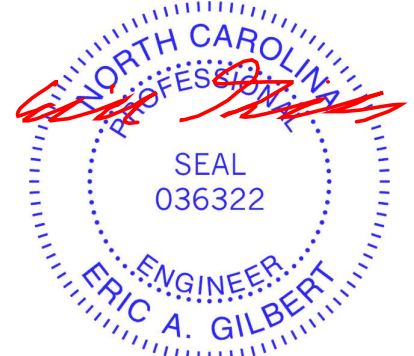

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688904
25100038-01	T09	Common	6	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36
ID:D8Rd?jQ0ceuTjs?TwgXKIDzwnFg-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

Page: 1

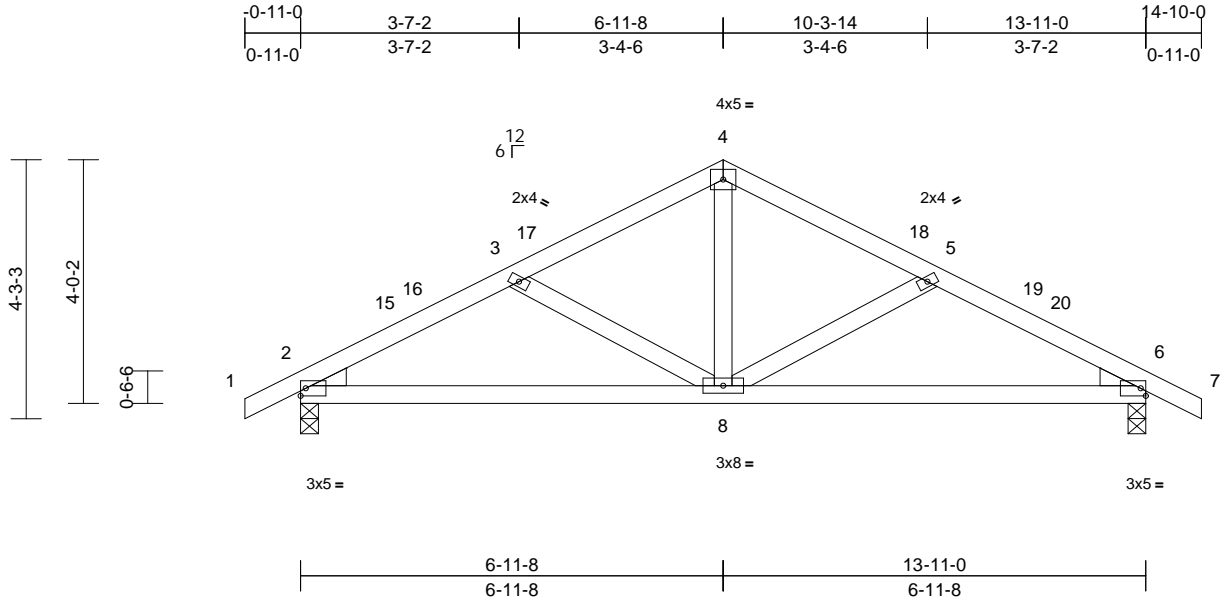

Scale = 1:37.9

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.23	Vert(LL)	-0.04	8-14	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.08	8-14	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.02	6	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 65 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3
WEDGE Left: 2x4 SP No.3
Right: 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-8-1 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=0-3-8, 6=0-3-8
Max Horiz 2=62 (LC 14)
Max Uplift 2=-71 (LC 14), 6=-71 (LC 15)
Max Grav 2=695 (LC 21), 6=695 (LC 22)

FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=0/25, 2-3=-1021/292, 3-4=-710/226,
4-5=-710/226, 5-6=-1021/292, 6-7=0/25
BOT CHORD 2-8=-178/864, 6-8=-178/864
WEBS 4-8=-50/374, 3-8=-343/150, 5-8=-343/150

NOTES

- 1) Unbalanced roof live loads have been considered for this design.
- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior (1) 2-1-0 to 3-11-8, Exterior(2R) 3-11-8 to 9-11-8, Interior (1) 9-11-8 to 11-10-0, Exterior(2E) 11-10-0 to 14-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- 4) Unbalanced snow loads have been considered for this design.
- 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 71 lb uplift at joint 2 and 71 lb uplift at joint 6.

LOAD CASE(S) Standard

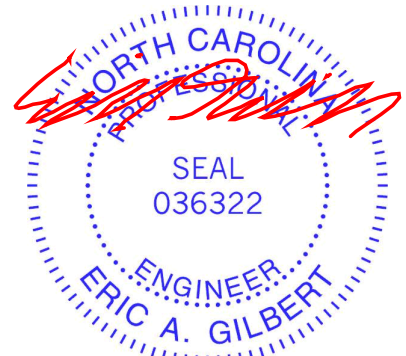

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688905
25100038-01	T08	Common Structural Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36
ID:Zqj4UdHURyNAH049D8KWGhzwF5-RfC?PsB70Hq3NSgPqnL8w3uITXbGKwRCDoi7J4zJC?f

Page: 1

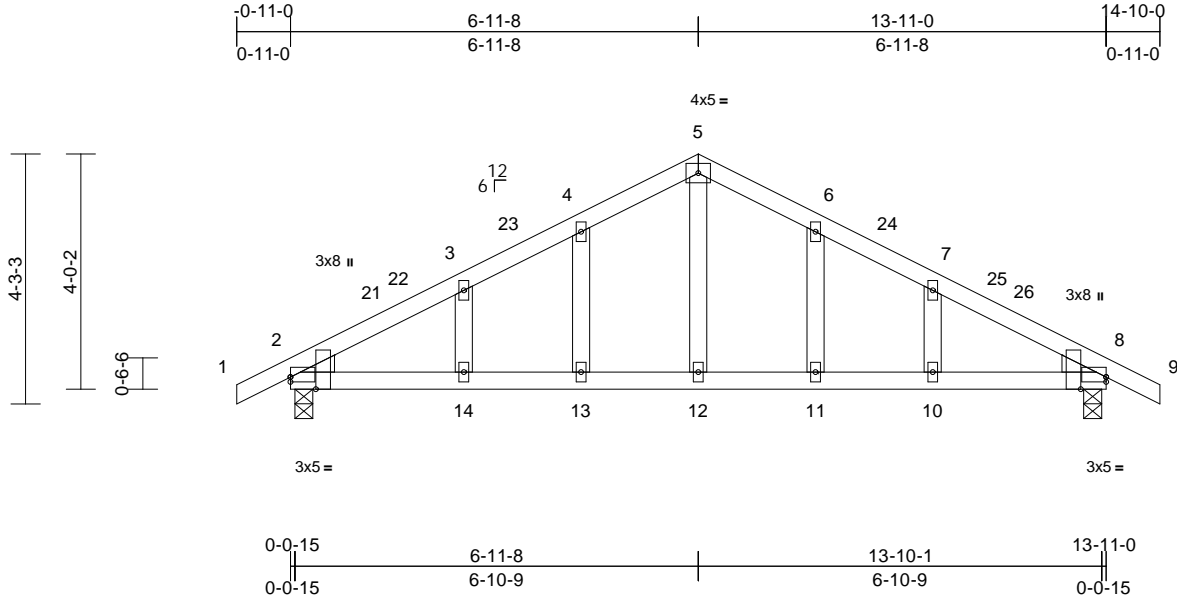

Scale = 1:39.3

Plate Offsets (X, Y): [2:Edge,0-1-0], [2:0-2-8,Edge], [8:Edge,0-1-0], [8:0-2-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.47	Vert(LL)	-0.16	13-14	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.72	Vert(CT)	-0.22	13-14	>769	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.02	2	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 66 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3
WEDGE	Left: 2x4 SP No.3 Right: 2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-8-12 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	2=0-3-11, 8=0-3-11
Max Horiz	2=62 (LC 14)
Max Uplift	2=-71 (LC 14), 8=-71 (LC 15)
Max Grav	2=695 (LC 21), 8=695 (LC 22)

FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/25, 2-3=-778/204, 3-4=-728/239, 4-5=-722/289, 5-6=-722/289, 6-7=-728/239, 7-8=-778/204, 8-9=0/25
BOT CHORD	2-14=-100/639, 13-14=-100/639, 12-13=-100/639, 11-12=-100/639, 10-11=-100/639, 8-10=-100/639
WEBS	5-12=-118/369, 4-13=-125/85, 3-14=-76/54, 6-11=-125/85, 7-10=-76/54

NOTES

- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior (1) 2-1-0 to 3-11-8, Exterior(2R) 3-11-8 to 9-11-8, Interior (1) 9-11-8 to 11-10-0, Exterior(2E) 11-10-0 to 14-10-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 8. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard

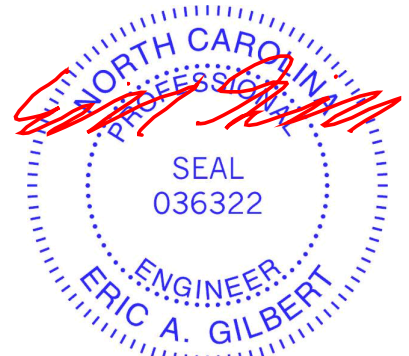

January 13,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688906
25100038-01	T07	Common	3	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35

Page: 1

ID:CtwBRvDLcQltAFBBrbkLZdzwnFx-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

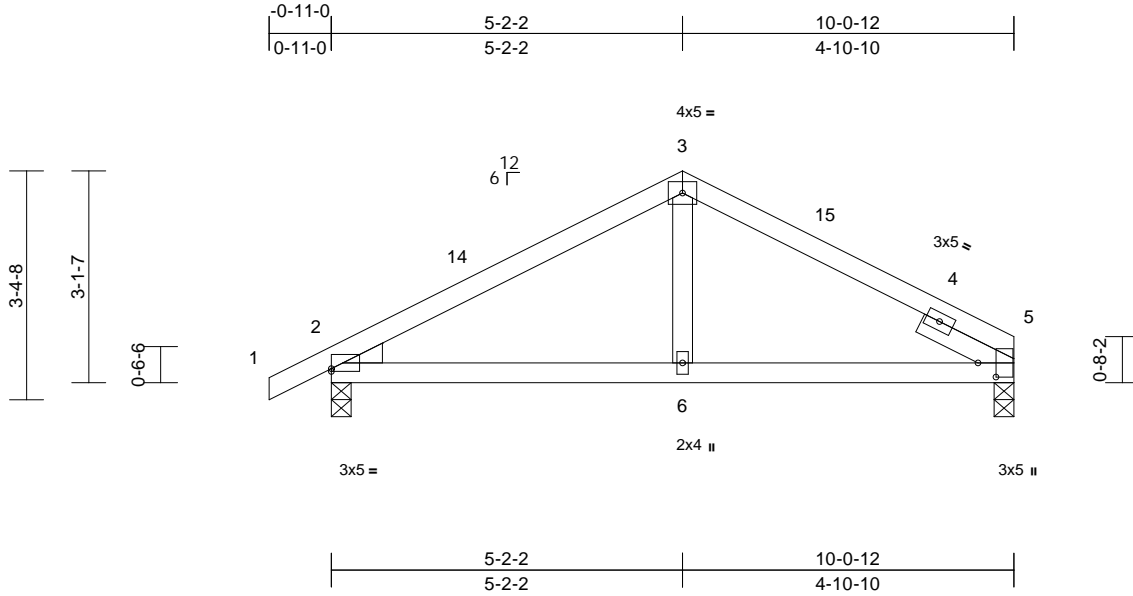

Scale = 1:34

Plate Offsets (X, Y): [2:Edge,0-0-8], [5:0-2-8,0-3-3]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.51	Vert(LL)	-0.03	6-13	>999	240	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.34	Vert(CT)	-0.05	6-13	>999	180	
TCDL	10.0	Rep Stress Incr	YES	WB	0.08	Horz(CT)	0.01	2	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
										Weight: 40 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
WEDGE	Left: 2x4 SP No.3
SLIDER	Right 2x4 SP No.3 -- 1-6-0

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	2=0-3-8, 5=0-3-8
Max Horiz	2=58 (LC 14)
Max Uplift	2=-57 (LC 14), 5=-37 (LC 15)
Max Grav	2=563 (LC 21), 5=495 (LC 22)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/25, 2-3=-592/227, 3-5=-499/234
BOT CHORD	2-6=-159/428, 5-6=-157/428
WEBS	3-6=0/213

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Exterior(2R) 2-1-0 to 7-0-12, Exterior(2E) 7-0-12 to 10-0-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 57 lb uplift at joint 2.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



January 13,2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688907
25100038-01	T06	Common Structural Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35
ID:wW?YzW8yGGstrA9rWd6in9zwnG2-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

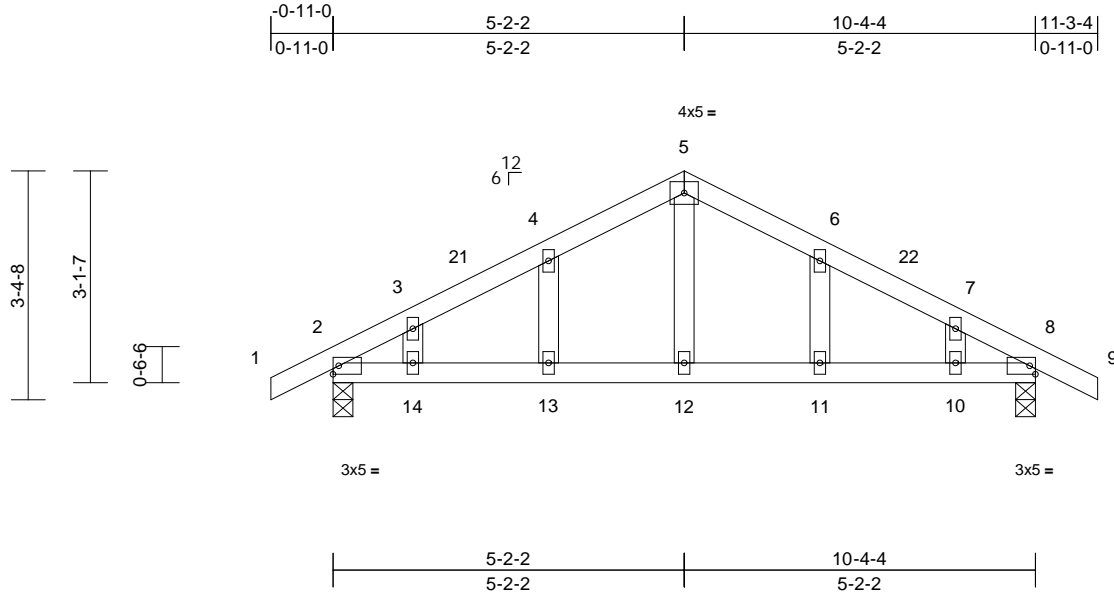

Scale = 1:34

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.28	Vert(LL)	-0.05	10-11	>999	240	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.07	10-11	>999	180	
TCDL	10.0	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.01	2	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
										Weight: 46 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	2=0-3-8, 8=0-3-8
Max Horiz	2=-48 (LC 15)
Max Uplift	2=-58 (LC 14), 8=-58 (LC 15)
Max Grav	2=572 (LC 21), 8=572 (LC 22)

FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/25, 2-3=-576/188, 3-4=-552/221, 4-5=-533/276, 5-6=-533/276, 6-7=-552/221, 7-8=-576/188, 8-9=0/25
BOT CHORD	2-14=-106/460, 13-14=-106/460, 12-13=-106/460, 11-12=-106/460, 10-11=-106/460, 8-10=-106/460
WEBS	5-12=-97/243, 4-13=-110/96, 3-14=-62/53, 6-11=-110/96, 7-10=-62/53

NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Exterior(2R) 2-1-0 to 8-3-4, Exterior(2E) 8-3-4 to 11-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 58 lb uplift at joint 2 and 58 lb uplift at joint 8.

LOAD CASE(S) Standard

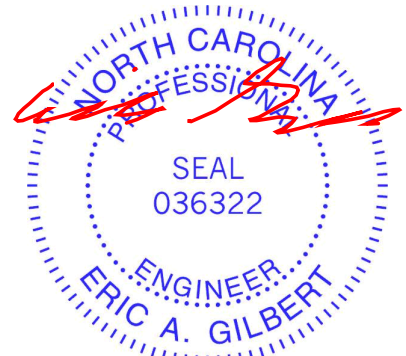

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688908
25100038-01	T04	Monopitch	4	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35
ID:bOhwYkAHy??dxWwmggCFMUzwnJt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

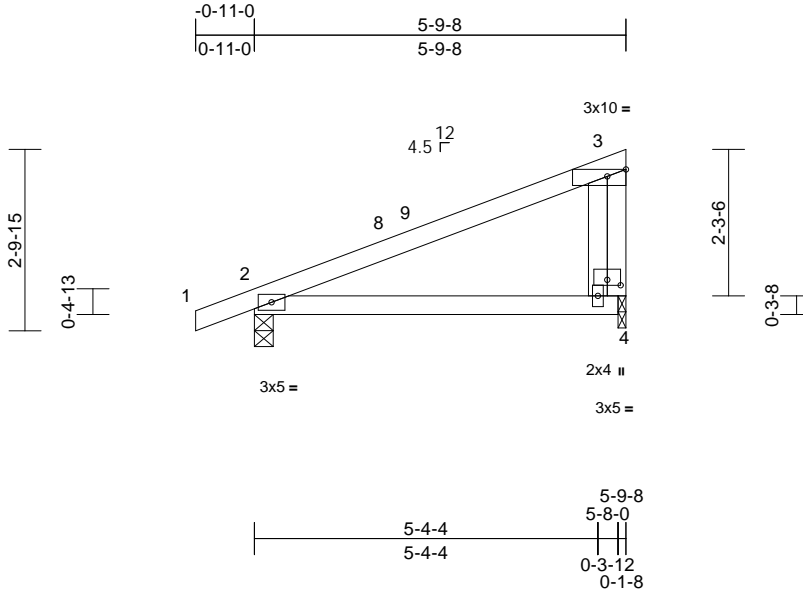

Scale = 1:35.9

Plate Offsets (X, Y): [3:Edge,0-1-5], [4:0-2-8,0-1-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	-0.07	4-7	>959	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.47	Vert(CT)	-0.12	4-7	>540	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	2	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP								
BCDL	10.0										Weight: 25 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size) 2=0-3-8, 4=0-1-8
	Max Horiz 2=92 (LC 13)
	Max Uplift 2=-57 (LC 10), 4=-41 (LC 14)
	Max Grav 2=395 (LC 21), 4=298 (LC 21)

FORCES


TOP CHORD	1-2=0/29, 2-3=-83/75, 3-4=-214/113
BOT CHORD	2-4=-28/114

NOTES

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust)
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-11-0 to 2-1-0, Interior (1) 2-1-0 to 2-6-0, Exterior(2E) 2-6-0 to 5-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.

- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 9) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 4. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard

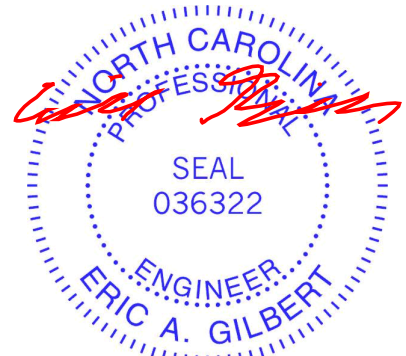

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688909
25100038-01	T03	Half Hip	1	2	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35
ID:MfeWfg3d4EsvM8k1eHY8UbwznK0-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?f

Page: 1

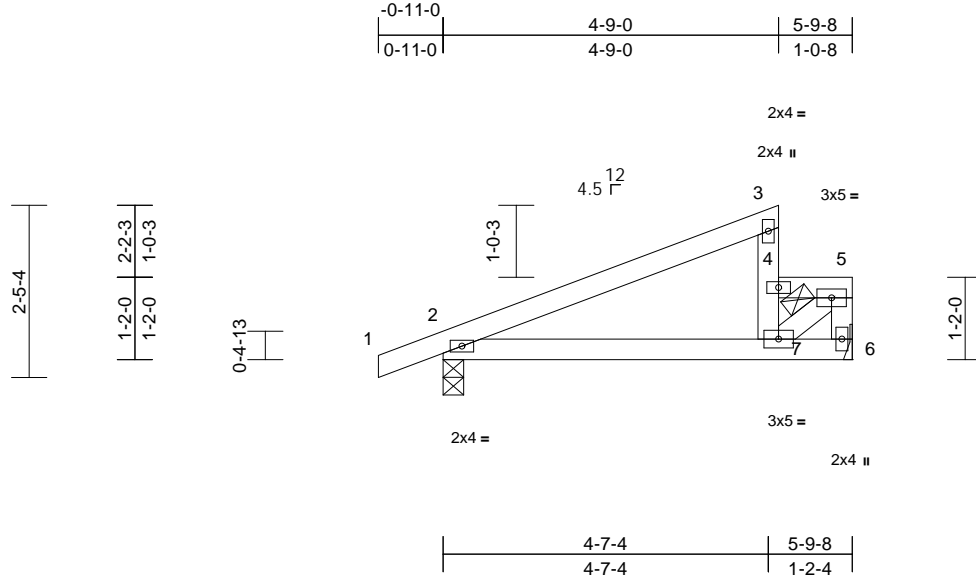

Scale = 1:32.6

Loading	(psf)	Spacing	1-4-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.33	Vert(LL)	-0.01	7-10	>999	240	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.12	Vert(CT)	-0.02	7-10	>999	180	
TCDL	10.0	Rep Stress Incr	NO	WB	0.10	Horz(CT)	0.00	2	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0										
										Weight: 48 lb	FT = 20%

LUMBER	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
BRACING	
TOP CHORD	Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 4-7, 4-5.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
REACTIONS	
(size)	2=0-3-8, 6= Mechanical
Max Horiz	2=62 (LC 14)
Max Uplift	2=7 (LC 10)
Max Grav	2=281 (LC 38), 6=352 (LC 38)
FORCES	
(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/18, 2-3=-225/0, 4-7=-120/43, 3-4=-51/77, 4-5=-375/0, 5-6=-388/0
BOT CHORD	2-7=0/194, 6-7=-7/11
WEBS	5-7=0/497

NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 5-7-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) . The design/selection of such connection device(s) is the responsibility of others.

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-40, 4-5=-140 (F=-100), 6-8=-13
Concentrated Loads (lb)
Vert: 7=-120 (F)



January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688910
25100038-01	T02	Half Hip	8	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35
ID:mhHo83hBNiyJ8Nt4KGVsk2zwnKV-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWfCDoi7J4zJC?f

Page: 1

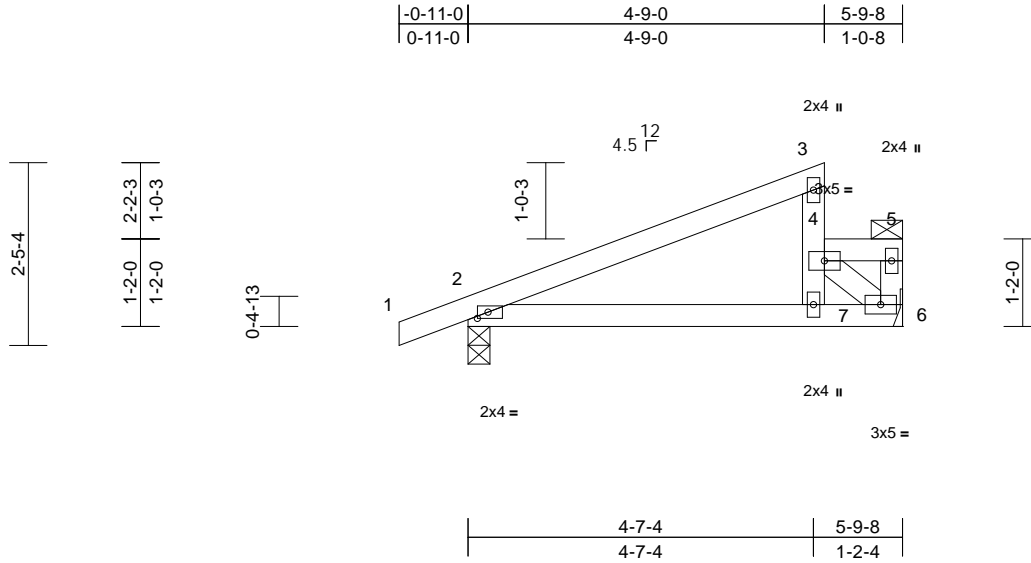

Scale = 1:30.7

Plate Offsets (X, Y): [2:0-1-11,0-1-0]

Loading	(psf)	Spacing	1-4-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.61	Vert(LL)	-0.02	7-10	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.04	7-10	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.08	Horz(CT)	0.00	2	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 24 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
WEBS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 4-7, 4-5.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS (size) 2=0-3-8, 6= Mechanical
Max Horiz 2=62 (LC 14)
Max Uplift 2=-16 (LC 10)
Max Grav 2=271 (LC 38), 6=257 (LC 38)

FORCES (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/18, 2-3=-203/0, 4-7=-18/98,
3-4=-58/69, 4-5=-7/11, 5-6=-30/18

BOT CHORD 2-7=-8/174, 6-7=0/344
WEBS 4-6=-442/0


NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 5-7-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.

- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15
Uniform Loads (lb/ft)
Vert: 1-3=-40, 4-5=-40, 6-8=-13
Concentrated Loads (lb)
Vert: 4=-120 (F)

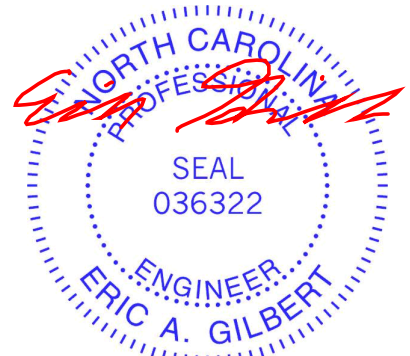

January 13, 2025


WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932

Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35 Page: 1
ID:2cEAv09akBQYscVdl1iYymzwnLB-RfC?PsB70Hq3NSqPanL8w3uITXbGKWrCDoI7J4zJC?f



LUMBER		4) T/CLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10	Concentrated Loads (lb)
TOP CHORD	2x4 SP No.2		Vert: 4=-120 (F)
BOT CHORD	2x4 SP No.2		
WEBS	2x4 SP No.3		
OTHERS	2x4 SP No.3		
BRACING			
TOP CHORD	Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 5-8, 5-6.		
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.		
REACTIONS		5) Unbalanced snow loads have been considered for this design.	
(size)	2=5-9-8, 7=5-9-8, 8=5-9-8, 9=5-9-8	6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.	
Max Horiz	2=62 (LC 14)	7) Provide adequate drainage to prevent water ponding.	
Max Uplift	2=-23 (LC 10), 7=-11 (LC 11), 9=-37 (LC 14)	8) Gable requires continuous bottom chord bearing.	
Max Grav	2=146 (LC 38), 7=43 (LC 37), 8=163 (LC 37), 9=197 (LC 38)	9) Gable studs spaced at 2-0-0 oc.	
FORCES		10) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.	
(lb) - Maximum Compression/Maximum Tension		11) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.	
TOP CHORD	1-2=0/18, 2-3=-65/41, 3-4=-32/9, 5-8=-151/0, 4-5=-151/0, 5-6=-7/14, 6-7=-30/27	12) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 23 lb uplift at joint 2, 37 lb uplift at joint 9, 11 lb uplift at joint 7 and 23 lb uplift at joint 2.	
BOT CHORD	2-9=-14/44, 8-9=-14/33, 7-8=-11/37	13) Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.	
WEBS	3-9=-159/148, 5-7=-34/9	14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.	
NOTES		15) Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s) 120 lb down at 4-7-4 on top chord. The design/selection of such connection device(s) is the responsibility of others.	
1) Unbalanced roof live loads have been considered for this design.		16) In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).	
2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TC DL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 5-7-12 zone; cantilever left and right exposed ; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60		LOAD CASE(S) Standard	
3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.		1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15	
		Uniform Loads (lb/ft)	
		Vert: 1-4=-40, 5-6=-40, 7-10=-13	



January 13, 2025



Design valid for use only with MiTeK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinet.org) and **BCSI Building Component Safety Information** available from the Structural Building Components Association (www.sbcacomponents.com)




818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688912
25100038-01	PB07A	Piggyback	15	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35
ID:3Ryt8403H6K4r2MujCZL5fzwnQX-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

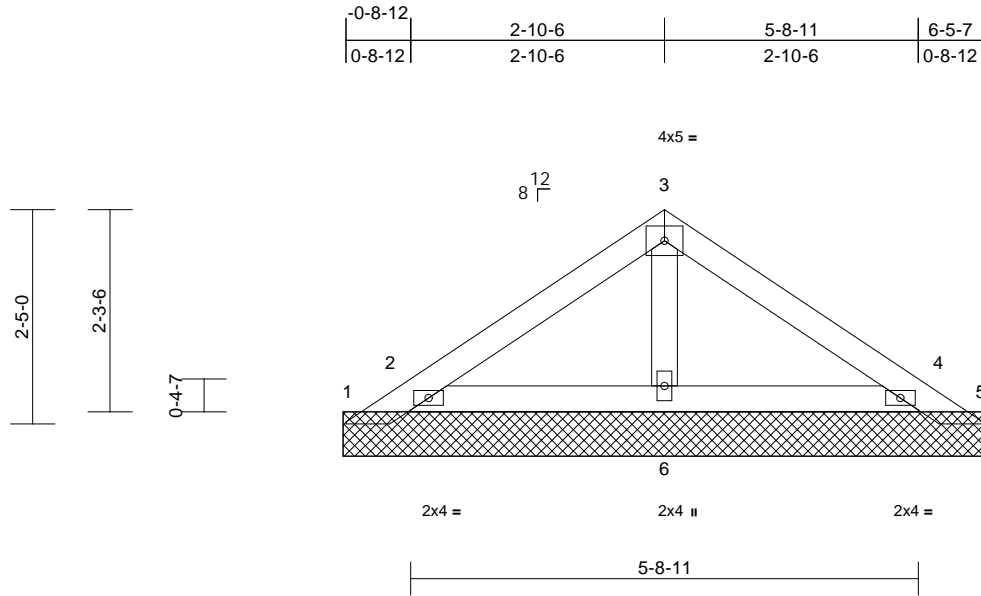

Scale = 1:26

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.07	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	4	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 24 lb	FT = 20%

LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size)	1=7-2-15, 2=7-2-15, 4=7-2-15, 5=7-2-15, 6=7-2-15
Max Horiz	1=-52 (LC 10)
Max Uplift	1=-144 (LC 21), 2=-94 (LC 14), 4=-86 (LC 15), 5=-141 (LC 22)
Max Grav	1=66 (LC 14), 2=413 (LC 21), 4=401 (LC 22), 5=46 (LC 15), 6=175 (LC 22)

FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-69/123, 2-3=-110/67, 3-4=-110/67, 4-5=-44/110
BOT CHORD	2-6=-44/41, 4-6=-44/41
WEBS	3-6=-91/21


NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-3-5 to 3-3-5, Exterior(2R) 3-3-5 to 3-11-10, Exterior(2E) 3-11-10 to 6-11-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 144 lb uplift at joint 1 and 141 lb uplift at joint 5.
- N/A

- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

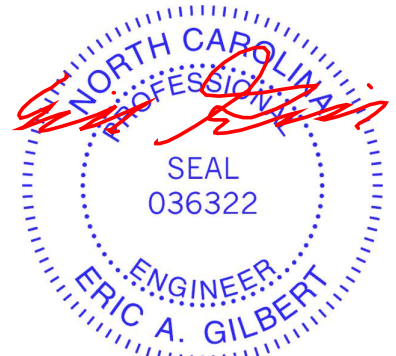

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate


818 Soundside Road
Edenton, NC 27932

Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688913
25100038-01	PB07	Piggyback	2	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:34
ID:wjKFBa?RoBnOpc07UozVw1zwnLO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

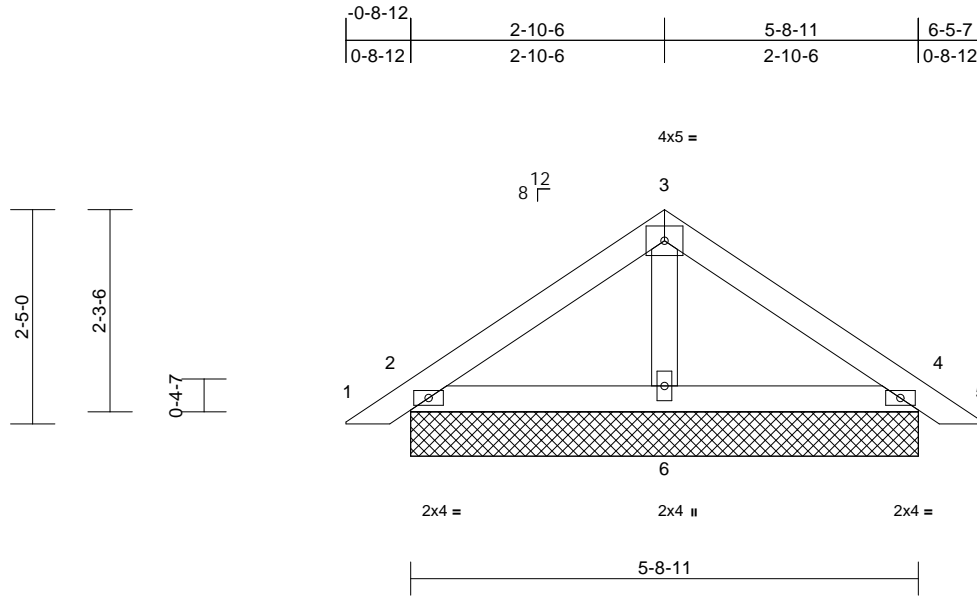

Scale = 1:26

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.14	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.15	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	2	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 24 lb	FT = 20%

LUMBER

TOP CHORD 2x4 SP No.2
BOT CHORD 2x4 SP No.2
OTHERS 2x4 SP No.3

BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS

(size) 2=5-8-11, 4=5-8-11, 6=5-8-11
Max Horiz 2=-51 (LC 12)
Max Uplift 2=-30 (LC 14), 4=-36 (LC 15)
Max Grav 2=218 (LC 21), 4=218 (LC 22), 6=200 (LC 22)

FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/24, 2-3=-114/74, 3-4=-114/74, 4-5=0/24

BOT CHORD 2-6=-13/48, 4-6=-3/48

WEBS 3-6=-87/18


NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-3-5 to 3-3-5, Exterior(2R) 3-3-5 to 3-11-10, Exterior(2E) 3-11-10 to 6-11-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- N/A

- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard

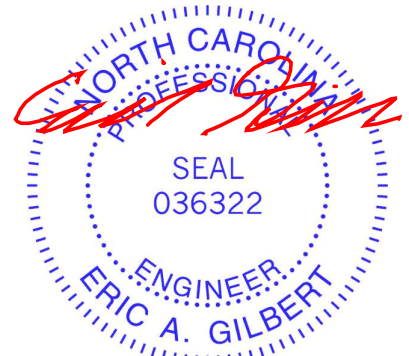

January 13, 2025

WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY
TRENCO
A MiTek Affiliate

818 Soundside Road
Edenton, NC 27932


Symbols

PLATE LOCATION AND ORIENTATION

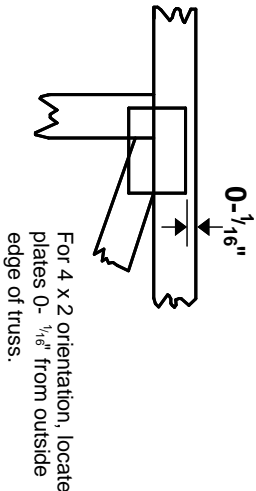


* Plate location details available in MITek software or upon request.


PLATE SIZE



LATERAL BRACING LOCATION




BEARING

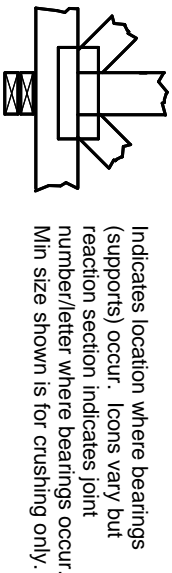

Industry Standards:
ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.
DSB-22: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

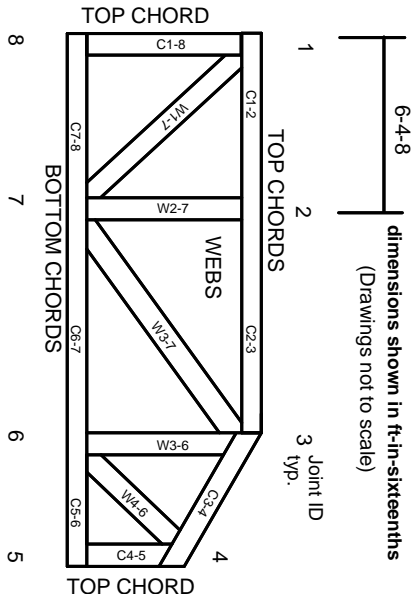

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

Product Code Approvals

ICC-ES Reports:
ESR-1988, ESR-2362, ESR-2685, ESR-3282
ESR-4722, ESL-1388

Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.
Lumber design values are in accordance with ANSI/TP1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

MITek®

ENGINEERING BY
TRENCO
A MITek Affiliate

MITek Engineering Reference Sheet: MII-7473 rev. 1/2/2023



Customer:
Street 1:
City:
Customer Ph...

Job Name: **01**
Level: **1st FLOOR**
Label: **DB1-2 - i52**
Type: **Beam**


2 Ply Member
2.1 RigidLam SP LVL 1-3/4
x 11-7/8

Status:
Design
Passed

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version
8.7.3.303.Update13.26

Report Version: 2023.09.18 10/10/2025 09:21

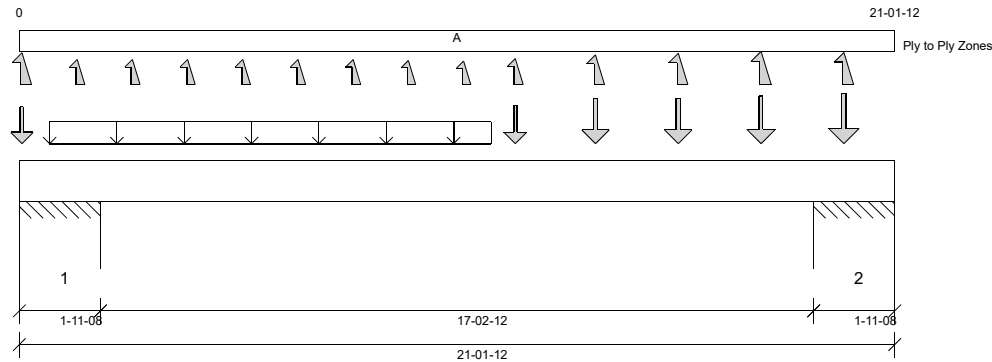

DESIGN INFORMATION a

Building Code: IRC 2021
Design Methodology: ASD
Risk Category: II (General Construction)
Residential
Service Condition: Dry
System Spacing: -
LL Deflection Limit: L/360, 0.75" (absolute)
TL Deflection Limit: L/240, 1.00" (absolute)

Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 1'- 10 1/2" Bottom: 20'- 6 3/4"

Bearing Stress of Support Material:

- 725 psi Wall @ 0'- 1 1/2"
- 725 psi Wall @ 1'- 10"
- 725 psi Wall @ 19'- 3 3/4"
- 725 psi Wall @ 21'- 1/4"

ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Max Pos. Moment:	10'- 8 3/4"	D + S	1.15	2378 lb ft	24315 lb ft	Passed - 10%
Max Neg. Moment:	19'- 3 3/4"	D + S	1.15	3973 lb ft	17567 lb ft	Passed - 23%
Max Shear:	18'- 2 3/8"	D + S	1.15	1380 lb	9241 lb	Passed - 15%
Live Load (LL) Pos. Defl.:	10'- 6 7/8"	S		0.051"	L/360	Passed - L/999
Total Load (TL) Pos. Defl.:	10'- 6 13/16"	D + S		0.090"	L/240	Passed - L/999

SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Downward Reaction	Uplift Reaction	Resistance of Member	Resistance of Support	Result
1	8-04	0.6D + 0.6W	1.60	436 lb		30130 lb	20934 lb	Passed - 2%
1	8-04	D + Lr	1.15		-2049 lb	-	-	
1	1-03-04	D + S	1.15	3872 lb		40031 lb	38697 lb	Passed - 10%
1	1-03-04	0.6D + 0.6W	1.60		-978 lb	-	-	
2	1-03-04	D + S	1.15	3967 lb		40031 lb	38697 lb	Passed - 10%
2	1-03-04	0.6D + 0.6W	1.60		-960 lb	-	-	
2	8-04	0.6D + 0.6W	1.60	536 lb		30130 lb	20934 lb	Passed - 3%
2	8-04	D + S	1.15		-2183 lb	-	-	

LOADING

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Roof Live (Lr)	Wind (W)
Self Weight	0'	21'- 1 3/4"	Self Weight	Top	11 lb/ft	-	-	-	-
Uniform	0'- 8 3/4"	11'- 4 3/4"	Smoothed Load	Top	66 lb/ft	-	54 lb/ft	78 lb/ft	23 lb/ft
Point	0'- 3/4"	0'- 3/4"	T01(c01)	Top	87 lb	-	84 lb	121 lb	36/-261 lb
Point	1'- 4 3/4"	1'- 4 3/4"	T02(c07)	Top	-	-	-	-	-171 lb
Point	2'- 8 3/4"	2'- 8 3/4"	T02(c04)	Top	-	-	-	-	-171 lb
Point	4'- 3/4"	4'- 3/4"	T02(c03)	Top	-	-	-	-	-171 lb
Point	5'- 4 3/4"	5'- 4 3/4"	T02(c05)	Top	-	-	-	-	-171 lb
Point	6'- 8 3/4"	6'- 8 3/4"	T02(c08)	Top	-	-	-	-	-171 lb
Point	8'- 3/4"	8'- 3/4"	T02(c01)	Top	-	-	-	-	-170 lb
Point	9'- 4 3/4"	9'- 4 3/4"	T02(c02)	Top	-	-	-	-	-157 lb
Point	10'- 8 3/4"	10'- 8 3/4"	T02(c06)	Top	-	-	-	-	-150 lb
Point	11'- 11 3/4"	11'- 11 3/4"	T03(c01)	Top	98 lb	-	85 lb	122 lb	36/-183 lb
Point	13'- 11"	13'- 11"	T04(c03)	Top	132 lb	-	107 lb	155 lb	46/-233 lb
Point	15'- 11"	15'- 11"	T04(c01)	Top	133 lb	-	108 lb	156 lb	46/-255 lb
Point	17'- 11"	17'- 11"	T04(c02)	Top	137 lb	-	114 lb	165 lb	49/-280 lb
Point	19'- 11"	19'- 11"	T04(c04)	Top	147 lb	-	126 lb	182 lb	54/-265 lb

UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Roof Live (Lr)	Wind (W)
1	0'	1'- 11 1/2"	E13(i23)	1804/-952 lb	-	1267/-650 lb	1986/-1095 lb	436 lb/-1755 lb
==>	0'- 1 1/2"	0'- 1 1/2"	E13(i23)	-952 lb	-	-650 lb	157/-1095 lb	-
==>	1'- 10"	1'- 10"	E13(i23)	1804 lb	-	1267 lb	1829 lb	-
2	19'- 2 1/4"	21'- 1 3/4"	E5(i4)	1836/-1019 lb	-	1300/-719 lb	1938/-1098 lb	436 lb/-1755 lb
==>	19'- 3 3/4"	19'- 3 3/4"	E5(i4)	1836 lb	-	1300 lb	1877 lb	-
==>	21'- 1/4"	21'- 1/4"	E5(i4)	-1019 lb	-	-719 lb	61/-1098 lb	-

DESIGN NOTES

- CAUTION: The maximum net analysis reaction exceeds the user-defined maximum uplift value at one or more supports.
- The dead loads used in the design of this member were applied to the structure as projected dead loads.
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.



Customer:
Street 1:
City:
Customer Ph...

Job Name: **01**
Level: **1st FLOOR**
Label: **DB1-2 - i52**
Type: **Beam**

2 Ply Member
2.1 RigidLam SP LVL 1-3/4
x 11-7/8

Status:
Design
Passed


DESIGN NOTES


- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (CL) = 0.99

PLY TO PLY CONNECTION

- Zone A: Factored load = 0 plf. Use 12d (0.148"x3.25") nails. LDF = 1.00. Qty = 44. Row = 2, Spacing = 12"
12d (0.148"x3.25") nails properties: D = 0.148" , L = 3.25". Fastener capacity = 128 lbs. X1 = 2.25" , Y1 = 0.75" , Y2 = 1.5"
Install fasteners from one face.
X1 = Minimum end distance, X2 = Minimum edge distance, Y2 = Minimum row spacing.



FASTENER INSTALLATION – 2 ROWS (FROM ONE FACE)

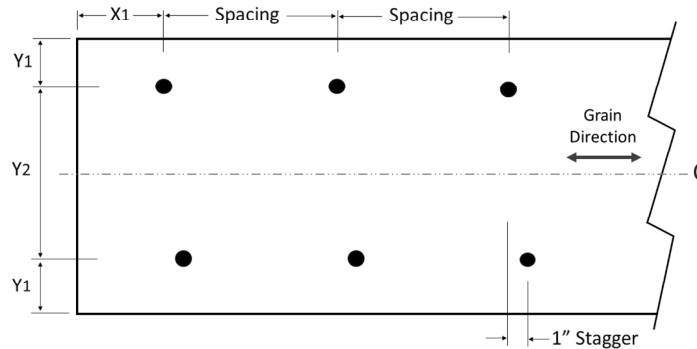

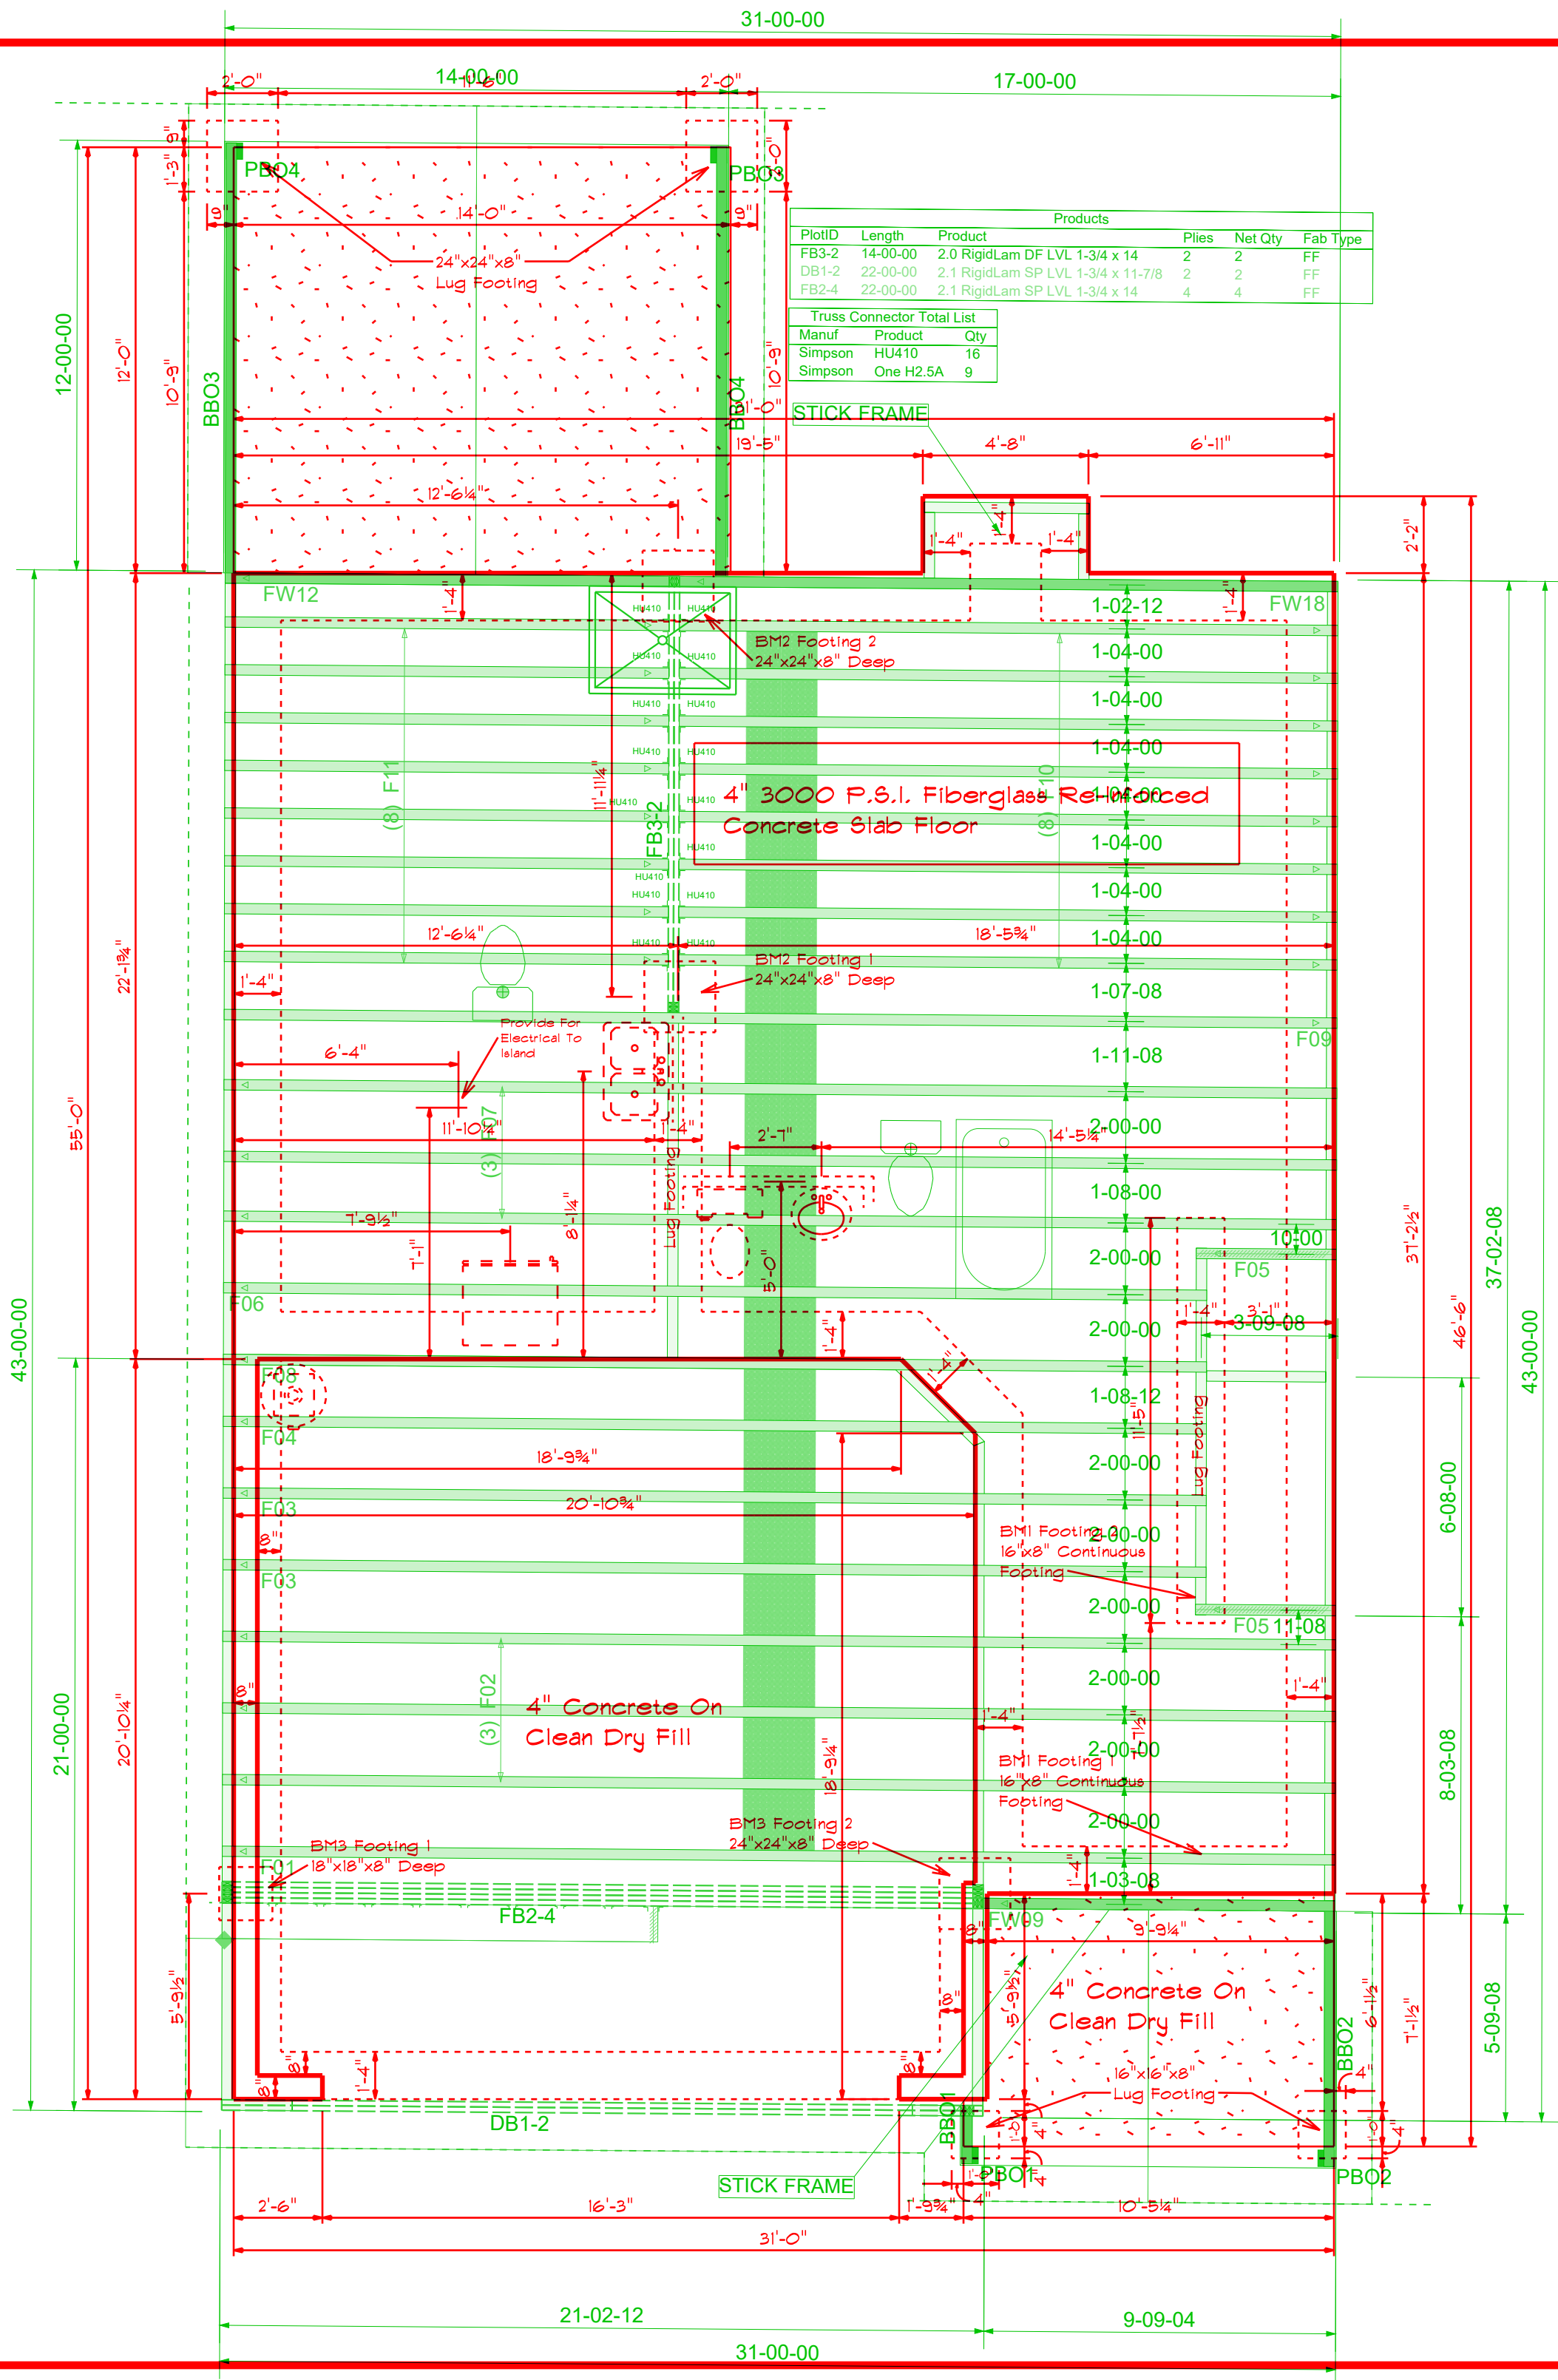

Products					
PlotID	Length	Product	Piles	Net Qty	Fab Type
FB3-2	14'-00-00	2.0 RigidLam DF LVL 1-3/4 x 14	2	2	FF
DB1-2	22'-00-00	2.1 RigidLam SP LVL 1-3/4 x 11-7/8	2	2	FF
FB2-4	22'-00-00	2.1 RigidLam SP LVL 1-3/4 x 14	4	4	FF

Truss Connector Total List		
Manuf	Product	Qty
Simpson	HU410	16
Simpson	One H2.5A	9

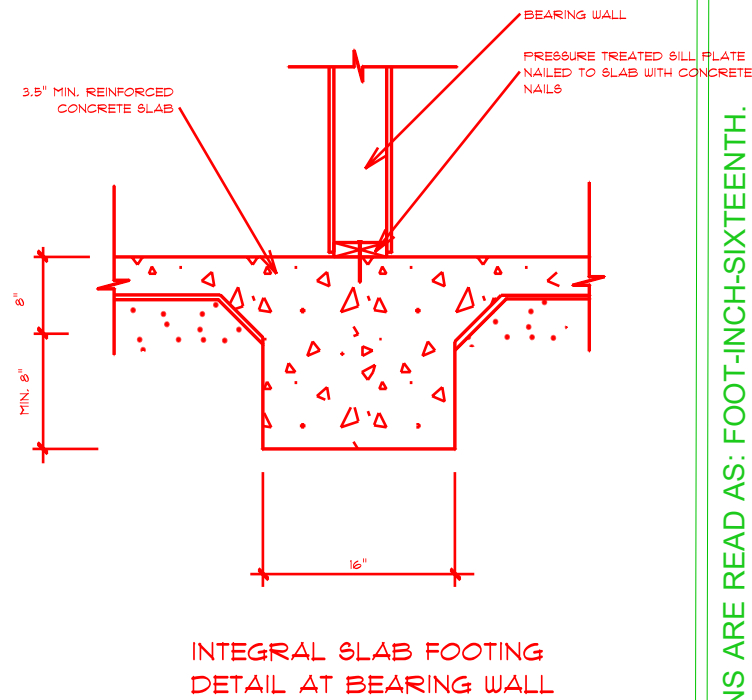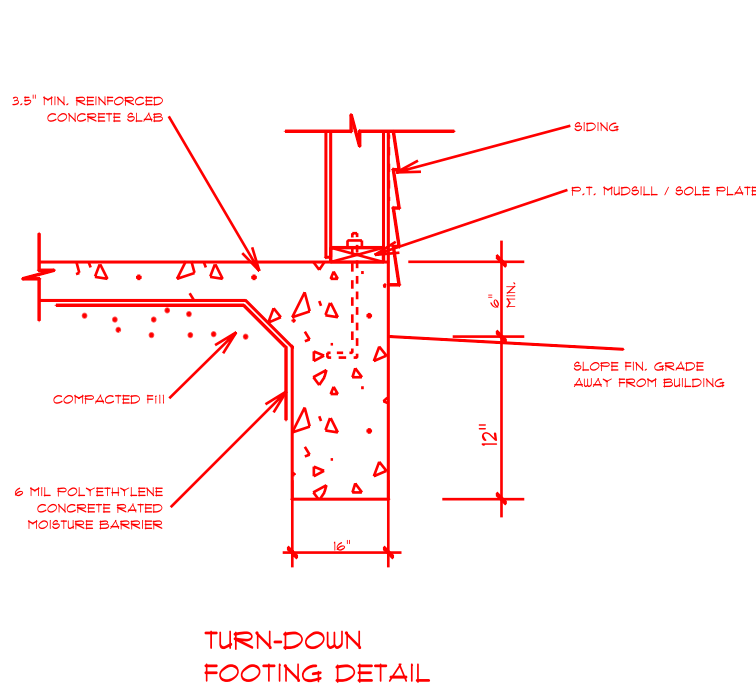

Foundation Plan
Scale: 1/4" = 1'-0"

TRUSS TO TRUSS CONNECTIONS ARE TOE-NAILED, UNLESS NOTED OTHERWISE.

DIMENSIONS ARE READ AS: FOOT-INCH-SIXTEENTH.

CONNECTED TOGETHER PRIOR TO ADDING ANY LOADS.

00/00/00	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor systems and for the overall structural design of the truss support structure including headers, beams, walls and columns is the responsibility of the building designer. For general guidance regarding the bracing consult "Bracing of Wood Truss" available from the Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53179.

CARTER®
Lumber

DRAWN BY
APPROVED

Wellco Contractor

28 Hidden Lakes North-2nd Floor-Plan 10 of 10

Wellco Contractors Inc.

FLOOR PLACEMENT PLAN

Scale:	NTS
Date:	

