




Carter Sanford Component Plant  
298 Harvey Faulk Rd  
Sanford, NC 27332

Phone #:919-775-1450

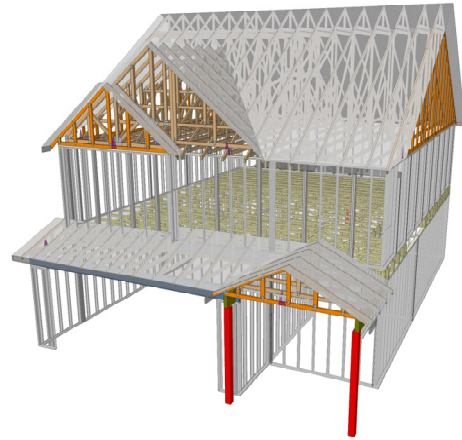

**Builder: Wellco Contractor**

**Model: 127 Hidden Lakes - Plan 10  
GLH**

**THE PLACEMENT PLAN NOTES:**

1. The Placement Plan is a diagram for truss installation. It is not an engineered drawing and has not been reviewed by an engineer. The Owner/Building Designer is responsible for obtaining an engineer's review if one is required by the local jurisdiction.
2. The responsibilities of the Owner, Contractor, Building Designer, Component Designer and Component Manufacturer shall be as set forth in ANSI/TPI 1. Capitalized terms shall be as defined in ANSI/TP 1 unless otherwise indicated.
3. Each Component is designed as an individual component utilizing information provided by others. The Owner/Building Designer is responsible for reviewing all Component Submittal Packages and individual Component Design Drawings for compliance with the Construction Documents and compatibility with the overall Building design.
4. Contractor will not proceed with component installation until the Owner/Building Designer has reviewed the Component Submittal Package. Questions on the suitability of any Component will be resolved by the Building Designer.
5. The Building Designer and Contractor are responsible for all temporary and permanent bracing.
6. The Placement Plan assumes the building is dimensionally correct, structurally sound, and in a suitable condition to support each Component during installation and thereafter, including but not limited to installation of all bearing points. Proper design and construction of all structural components, including foundations, headers, beams, walls and columns are the responsibility of the Owner, Building Designer and Contractor.
7. Do not cut, drill, or modify any Component without first consulting the Component Manufacturer or Building Designer. Damaged Components shall not be installed unless directed by the Building Designer or approved by the Component Manufacturer.
8. Components must be handled and installed following all applicable safety standards and best practices, including but not limited to BCSI, OSHA, TPI and local codes. Failure to properly handle, brace or otherwise install Component can result in serious injury or death.
9. All uplift connectors shown within these documents are recommendations only. Per ANSI/TPI 1, all uplift connectors are the responsibility of the building designer and or contractor.

**Approved By:** \_\_\_\_\_

**Date:** \_\_\_\_\_



General Notes:


\*\* CUTTING OR DRILLING OF COMPONENTS SHOULD NOT BE DONE WITHOUT CONTACTING COMPONENT SUPPLIER FIRST. CUSTOMER TAKES FULL RESPONSIBILITY FOR COMPONENTS IF CUT BEFORE AUTHORIZATION.

\*\* ALL BEARING POINTS MUST BE INSTALLED PRIOR TO SETTING ANY COMPONENTS.

\*\* FRAMER MUST REFER TO PLANS WHILE SETTING COMPONENTS.

\*\* DAMAGED COMPONENTS SHOULD NOT BE INSTALLED UNLESS TOLD TO BY THE COMPONENT PLANT.


\*\* TRUSS TO TRUSS CONNECTIONS ARE TOE-NAILED, UNLESS NOTED OTHERWISE.

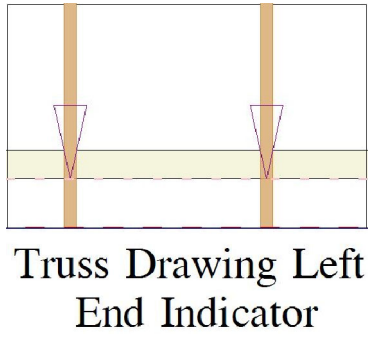

\*\* TRIANGULAR SYMBOL NEAR END OF TRUSS INDICATES LEFT END OF TRUSS AS SHOWN ON INDIVIDUAL TRUSS DRAWINGS.

\*\* PLUMBING DROPS NOTED ARE IN THE APPROXIMATE LOCATIONS PER PLAN. BUILDER TO VERIFY LOCATIONS BEFORE SETTING TRUSSES.

\*\* REFER TO FINAL TRUSS ENGINEERING SHEETS FOR PLY TO PLY CONNECTIONS.

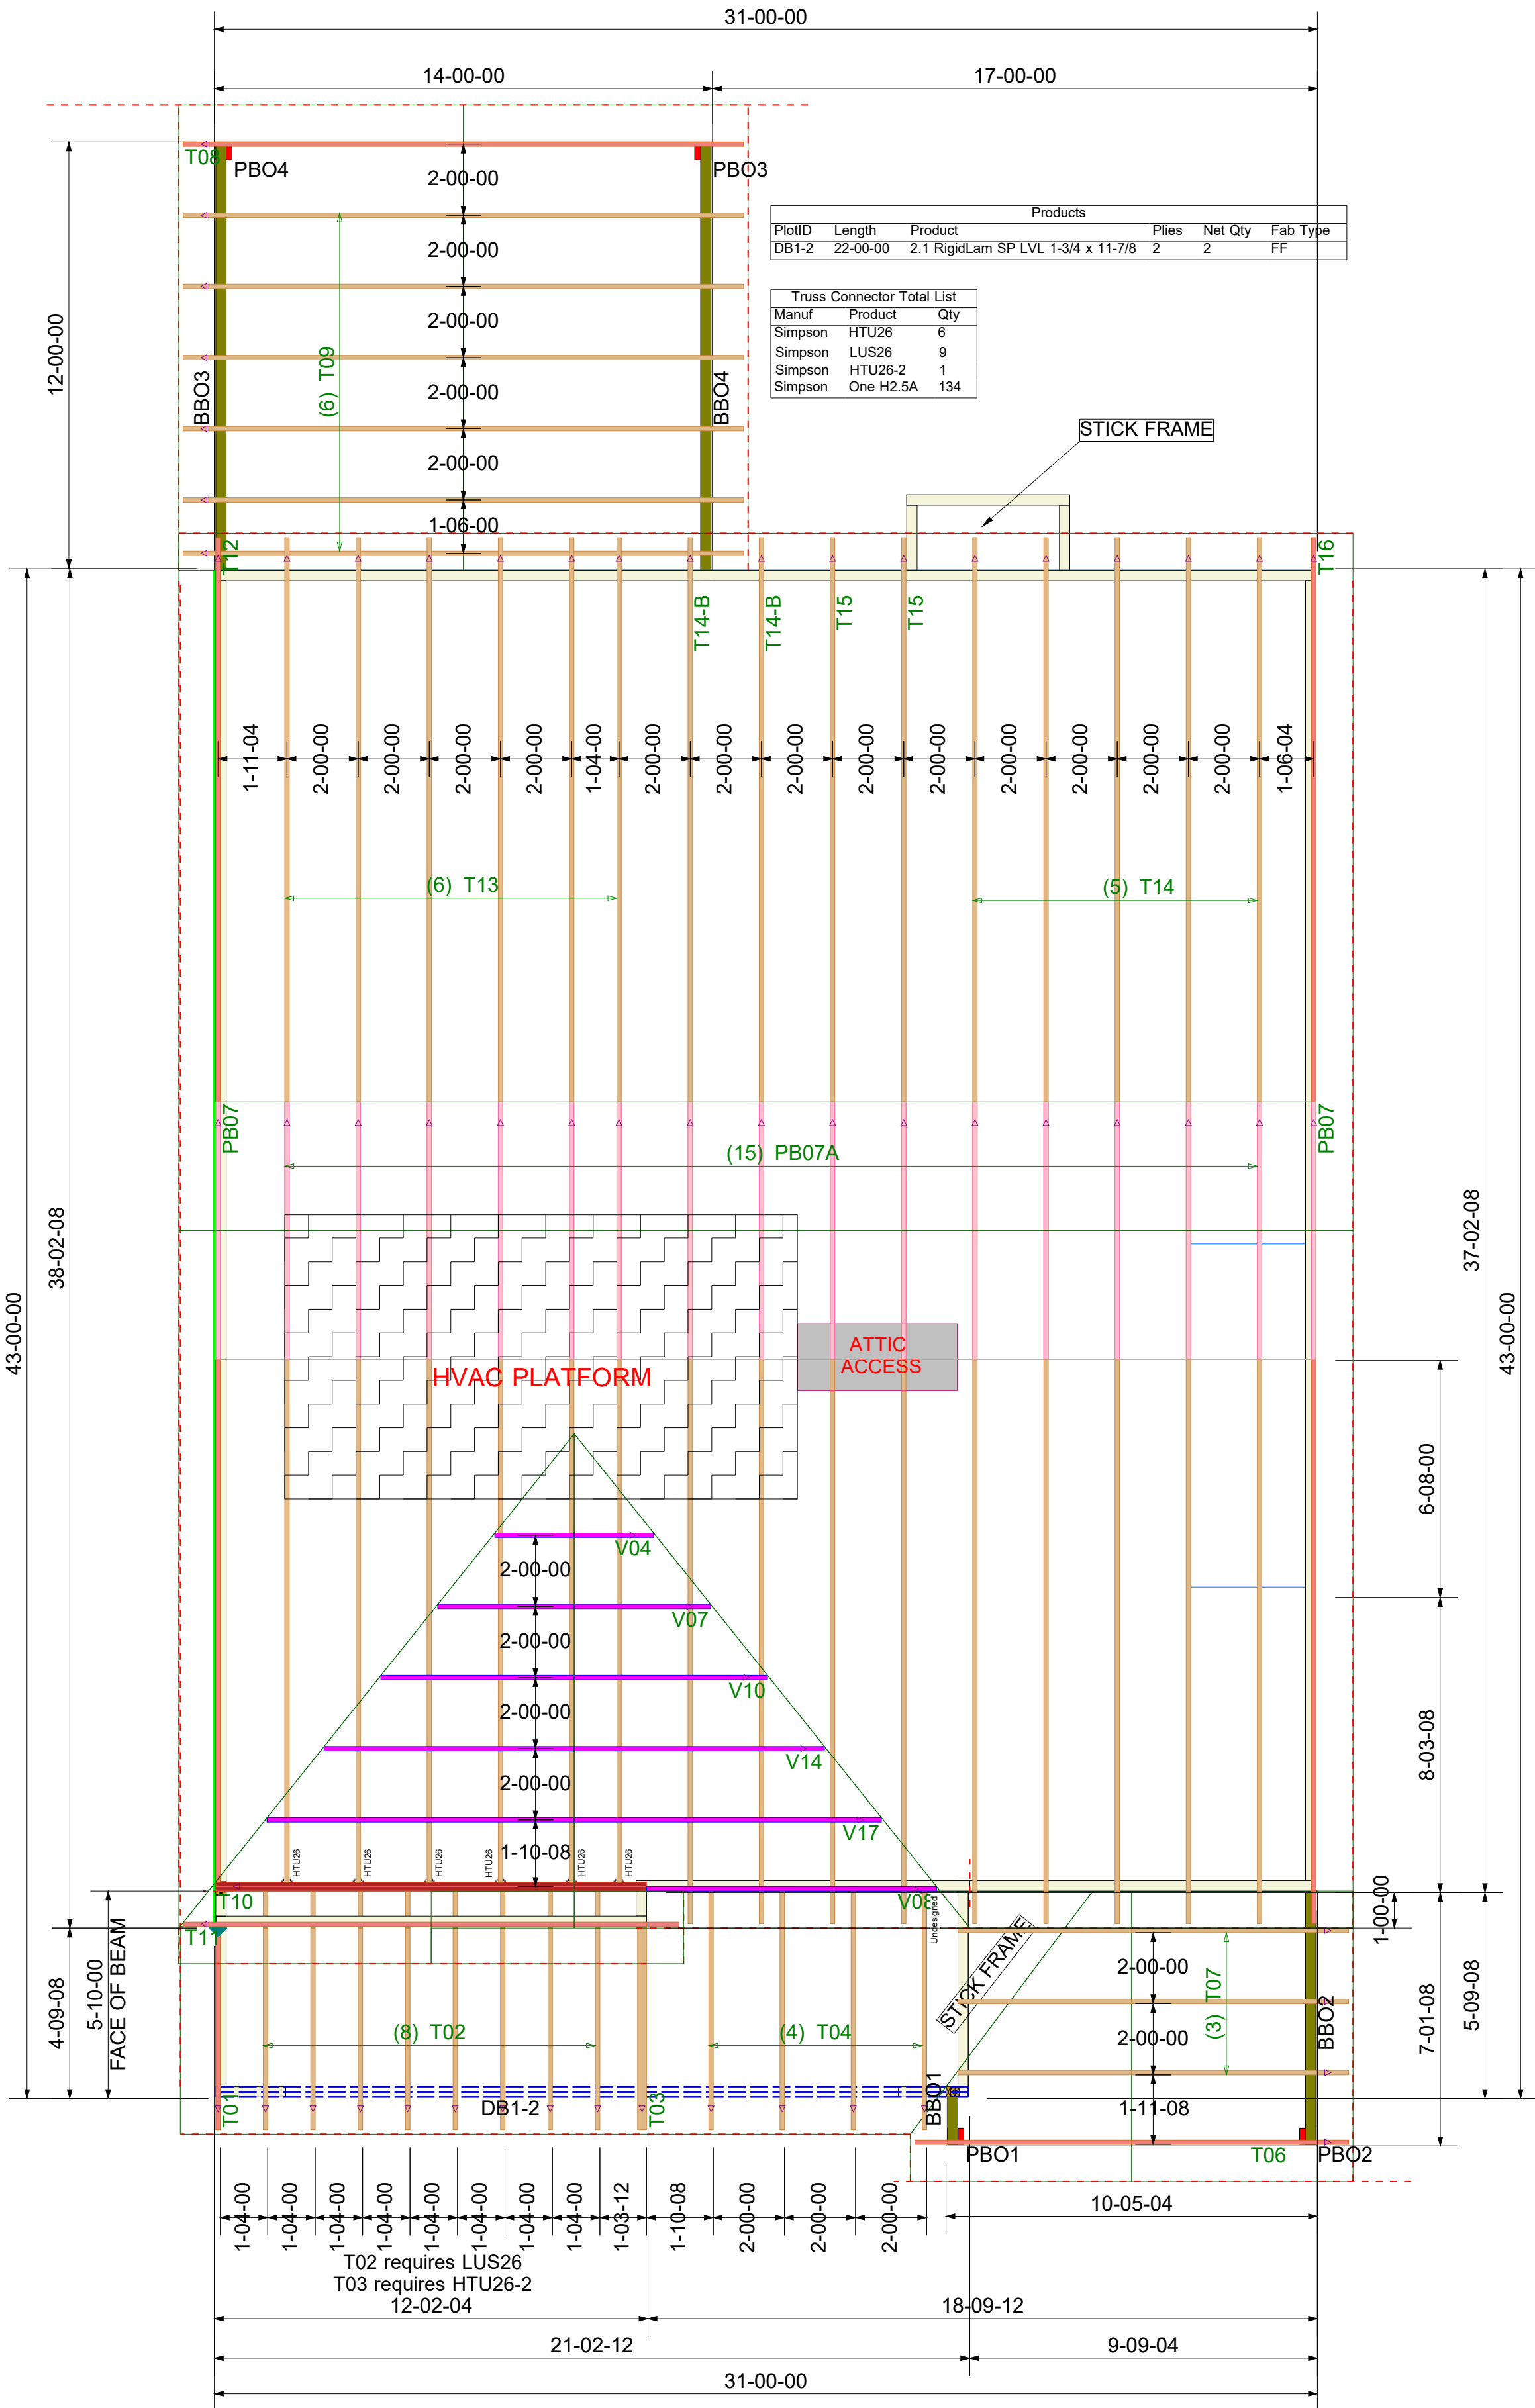

\*\* GIRDERS MUST BE FULLY CONNECTED TOGETHER PRIOR TO ADDING ANY LOADS.

\*\* DIMENSIONS ARE READ AS: FOOT-INCH-SIXTEENTH.

\*\* All uplift connectors shown within these documents are recommendations only. Per ANS/ITPI 1, all uplift connectors are the responsibility of the bldg designer and or contractor.

Revisions	
00/00/00	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name
00/00/00	Name

THIS IS A TRUSS PLACEMENT DIAGRAM ONLY. These trusses are designed as individual components to be incorporated into the building design at the specification of the building designer. See individual design sheets for each truss design identified on the placement drawing. The building designer is responsible for temporary and permanent bracing of the roof and floor systems and for the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer. For general guidance regarding the bracing, consult "Bracing of Wood Truss" available from the Truss Plate Institute, 583 D'Onofrio Drive, Madison, WI 53179



Wellco Contractor

29 Hidden Lakes  
North-Roof-Plan 10 GLH

ROOF PLACEMENT PLAN

Scale:  
NTS

Date:  
10/10/2025

Designer:  
Aaron Rogers

Project Number:  
25100038-01

Sheet Number:

1/1



RE: 25100038-01  
29 Hidden Lakes North-Roof-Plan 10 GLH

Trenco  
818 Soundside Rd  
Edenton, NC 27932

**Site Information:**

Customer: Wellco Contractor Project Name: 25100038-01  
Lot/Block: 29 Model:  
Address: Subdivision: Hidden Lakes North  
City: State:

**General Truss Engineering Criteria & Design Loads (Individual Truss Design Drawings Show Special Loading Conditions):**

Design Code: IRC2021/TPI2014 Design Program: MiTek 20/20 8.7  
Wind Code: ASCE 7-16 Wind Speed: 130 mph  
Roof Load: 40.0 psf Floor Load: N/A psf

This package includes 24 individual, dated Truss Design Drawings and 0 Additional Drawings.

No.	Seal#	Truss Name	Date	No.	Seal#	Truss Name	Date
1	I70688890	V17	1/13/2025	21	I70688910	T02	1/13/2025
2	I70688891	V14	1/13/2025	22	I70688911	T01	1/13/2025
3	I70688892	V10	1/13/2025	23	I70688912	PB07A	1/13/2025
4	I70688893	V08	1/13/2025	24	I70688913	PB07	1/13/2025
5	I70688894	V07	1/13/2025				
6	I70688895	V04	1/13/2025				
7	I70688896	T16	1/13/2025				
8	I70688897	T15	1/13/2025				
9	I70688898	T14-B	1/13/2025				
10	I70688899	T14	1/13/2025				
11	I70688900	T13	1/13/2025				
12	I70688901	T12	1/13/2025				
13	I70688902	T11	1/13/2025				
14	I70688903	T10	1/13/2025				
15	I70688904	T09	1/13/2025				
16	I70688905	T08	1/13/2025				
17	I70688906	T07	1/13/2025				
18	I70688907	T06	1/13/2025				
19	I70688908	T04	1/13/2025				
20	I70688909	T03	1/13/2025				


The truss drawing(s) referenced above have been prepared by  
Truss Engineering Co. under my direct supervision  
based on the parameters provided by Carter Components (Sanford, NC)).

Truss Design Engineer's Name: Gilbert, Eric

My license renewal date for the state of North Carolina is December 31, 2025.

North Carolina COA: C-0844

IMPORTANT NOTE: The seal on these truss component designs is a certification that the engineer named is licensed in the jurisdiction(s) identified and that the designs comply with ANSI/TPI 1. These designs are based upon parameters shown (e.g., loads, supports, dimensions, shapes and design codes), which were given to TRENCO. Any project specific information included is for TRENCO customers file reference purpose only, and was not taken into account in the preparation of these designs. TRENCO has not independently verified the applicability of the design parameters or the designs for any particular building. Before use, the building designer should verify applicability of design parameters and properly incorporate these designs into the overall building design per ANSI/TPI 1, Chapter 2.

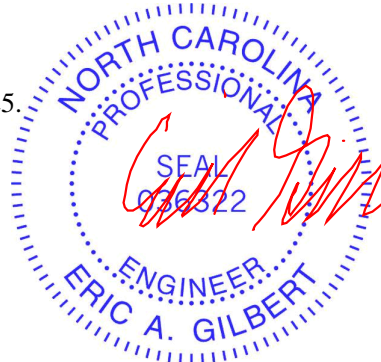

January 13, 2025




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688890
25100038-01	V17	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38

Page: 1

ID: TamHZwblSeR3hNASvmFIWzzwnCt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

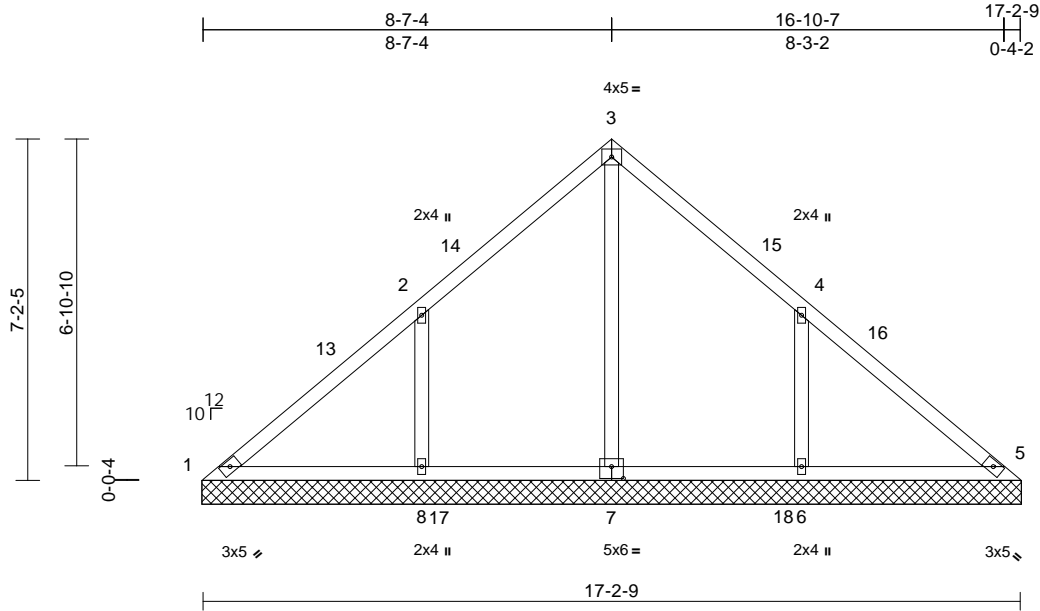

Scale = 1:48.5

Plate Offsets (X, Y): [7:0-3-0,0-3-0]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.36	Vert(LL)	n/a	-	n/a	999	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.20	Vert(TL)	n/a	-	n/a	999	
TCDL	10.0	Rep Stress Incr	YES	WB	0.24	Horiz(TL)	0.00	5	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
										Weight: 77 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

**REACTIONS** (size) 1=17-3-2, 5=17-3-2, 6=17-3-2, 7=17-3-2, 8=17-3-2  
Max Horiz 1=164 (LC 11)  
Max Uplift 1=-21 (LC 10), 6=-193 (LC 15), 8=-190 (LC 14)  
Max Grav 1=159 (LC 25), 5=123 (LC 36), 6=522 (LC 25), 7=447 (LC 24), 8=541 (LC 24)

**FORCES** (lb) - Maximum Compression/Maximum Tension


TOP CHORD 1-2=-201/219, 2-3=-137/160, 3-4=-149/141, 4-5=-97/162  
BOT CHORD 1-8=-93/169, 6-8=-93/127, 5-6=-93/127  
WEBS 3-7=-267/0, 2-8=-402/224, 4-6=-393/225

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior (1) 3-0-0 to 5-7-9, Exterior(2R) 5-7-9 to 11-7-9, Interior (1) 11-7-9 to 13-10-5, Exterior(2E) 13-10-5 to 16-10-5 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 21 lb uplift at joint 1, 190 lb uplift at joint 8 and 193 lb uplift at joint 6.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1.

**LOAD CASE(S)** Standard

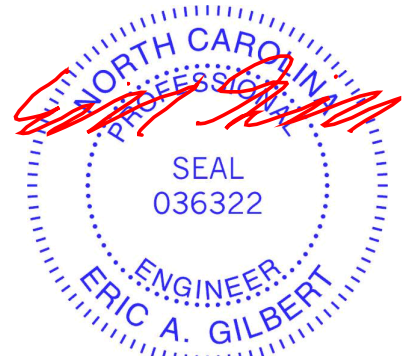

January 13,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688891
25100038-01	V14	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38

Page: 1

ID:Dvvc1cq1BxPh9x7QGxNimzwn7P-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

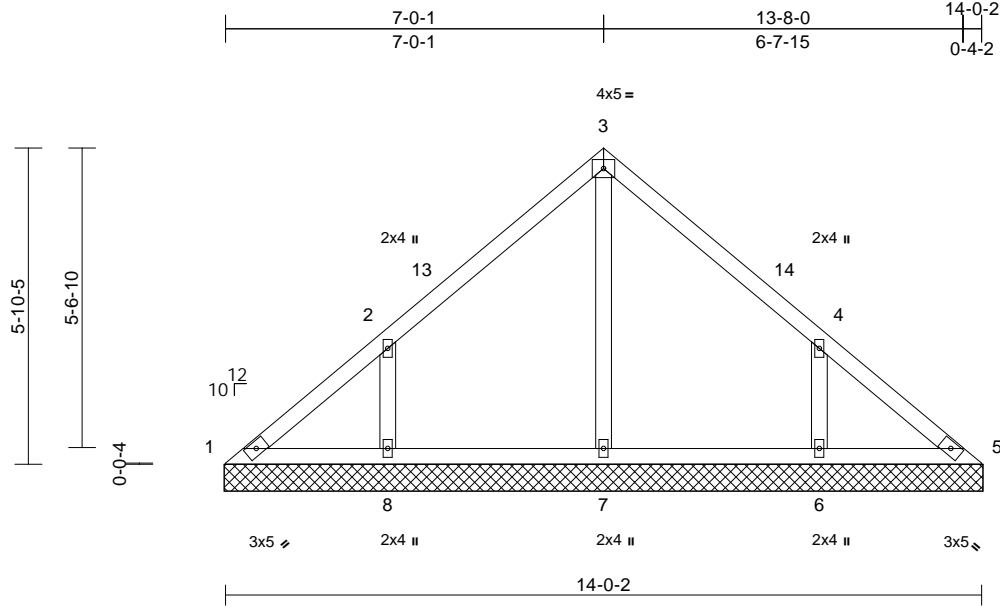

Scale = 1:42.7

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.34	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.11	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.13	Horiz(TL)	0.00	5	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 60 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS

(size)	1=14-0-12, 5=14-0-12, 6=14-0-12, 7=14-0-12, 8=14-0-12
Max Horiz	1=-133 (LC 10)
Max Uplift	1=-25 (LC 10), 6=-150 (LC 15), 8=-153 (LC 14)
Max Grav	1=116 (LC 25), 5=92 (LC 24), 6=449 (LC 21), 7=296 (LC 20), 8=449 (LC 20)

#### FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-146/126, 2-3=-183/117, 3-4=-183/114, 4-5=-115/92
BOT CHORD	1-8=-54/117, 7-8=-54/94, 6-7=-54/94, 5-6=-54/94
WEBS	3-7=-215/0, 2-8=-374/194, 4-6=-374/192

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-6, Interior (1) 3-0-6 to 4-0-6, Exterior(2R) 4-0-6 to 10-0-6, Interior (1) 10-0-6 to 11-0-6, Exterior(2E) 11-0-6 to 14-0-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 25 lb uplift at joint 1, 153 lb uplift at joint 8 and 150 lb uplift at joint 6.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 5.

LOAD CASE(S) Standard

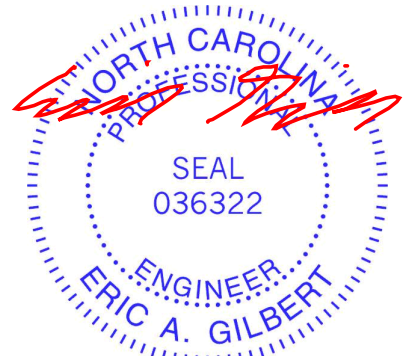

January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacompnents.com](http://www.sbcacompnents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688892
25100038-01	V10	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38

Page: 1

ID:Dvvc1cq1BXPh9x7QGxNimzwn7P-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrcDoi7J4zJC?f

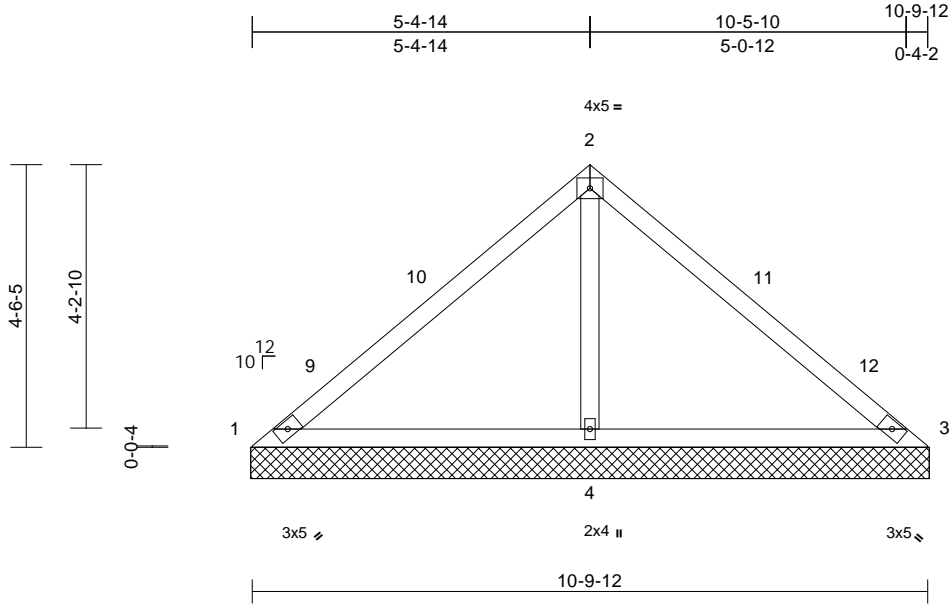

Scale = 1:36.9

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.58	Vert(LL)	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.51	Vert(TL)	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.27	Horiz(TL)	0.01	4	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 41 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 10-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS

(size)	1=10-10-6, 3=10-10-6, 4=10-10-6
Max Horiz	1=-102 (LC 12)
Max Uplift	1=-81 (LC 21), 3=-81 (LC 20), 4=-139 (LC 14)
Max Grav	1=67 (LC 20), 3=67 (LC 21), 4=919 (LC 20)

#### FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-149/465, 2-3=-149/465
BOT CHORD	1-4=-316/202, 3-4=-316/202
WEBS	2-4=-788/320

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Exterior(2R) 3-0-0 to 7-10-6, Exterior(2E) 7-10-6 to 10-10-6 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 81 lb uplift at joint 1, 81 lb uplift at joint 3 and 139 lb uplift at joint 4.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 3.

**LOAD CASE(S)** Standard



January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688893
25100038-01	V08	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38

Page: 1

ID:Dvvc1cq1BXPh9x7QGxNimzwn7P-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

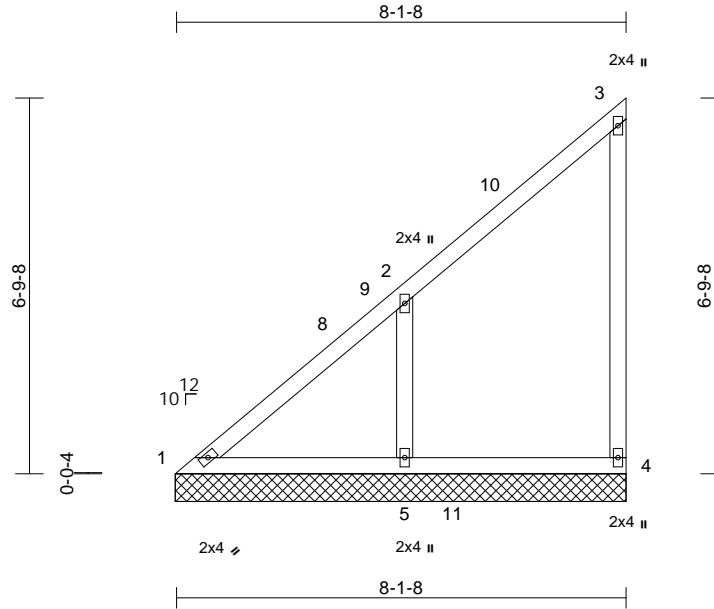

Scale = 1:41.6

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.68	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.19	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.10	Horiz(TL)	0.00	4	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 41 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

<b>REACTIONS</b>	(size)	1=8-1-13, 4=8-1-13, 5=8-1-13
	Max Horiz	1=223 (LC 11)
	Max Uplift	1=18 (LC 10), 4=56 (LC 11), 5=157 (LC 14)
	Max Grav	1=185 (LC 25), 4=196 (LC 5), 5=524 (LC 5)

<b>FORCES</b>	(lb) - Maximum Compression/Maximum Tension
---------------	--

TOP CHORD	1-2=-246/266, 2-3=-163/151, 3-4=-160/73
BOT CHORD	1-5=-78/212, 4-5=-78/113
WEBS	2-5=-402/309

#### NOTES

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Interior (1) 3-0-0 to 3-9-2, Exterior(2R) 3-9-2 to 8-0-1 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- 3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 4) Unbalanced snow loads have been considered for this design.
- 5) Gable requires continuous bottom chord bearing.
- 6) Gable studs spaced at 4-0-0 oc.
- 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 56 lb uplift at joint 4, 18 lb uplift at joint 1 and 157 lb uplift at joint 5.
- 10) Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1.

**LOAD CASE(S)** Standard



January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688894
25100038-01	V07	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38  
ID:o7ulAWxTBLFIrFLHnz6txFzwn26-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

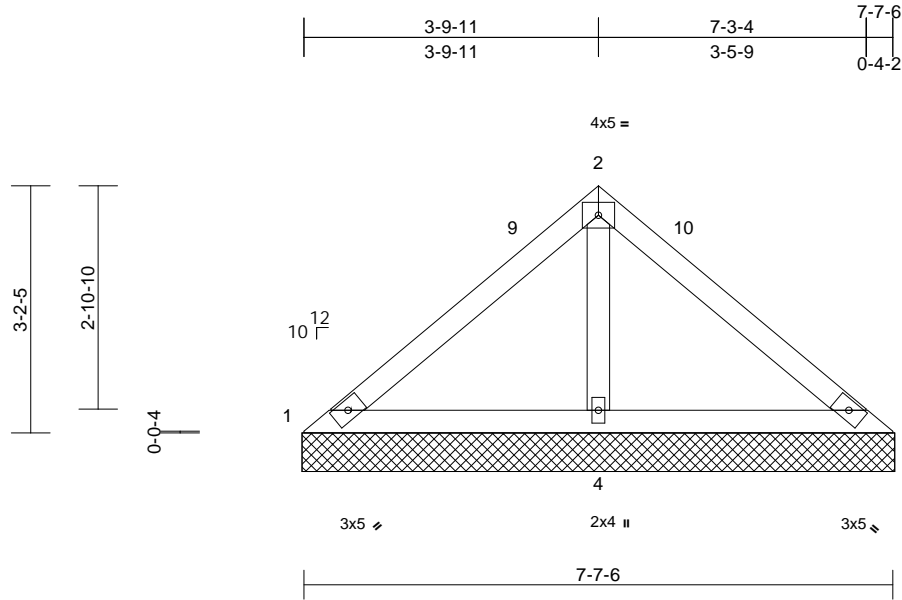

Scale = 1:29.8

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.30	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.30	Vert(TL)	n/a	-	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.10	Horiz(TL)	0.00	4	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 28 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 7-7-6 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS

(size)	1=7-7-15, 3=7-7-15, 4=7-7-15
Max Horiz	1=-71 (LC 10)
Max Uplift	1=-29 (LC 21), 3=-29 (LC 20), 4=-83 (LC 14)
Max Grav	1=102 (LC 20), 3=102 (LC 21), 4=588 (LC 20)

#### FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-104/263, 2-3=-104/263
BOT CHORD	1-4=-205/165, 3-4=-205/165
WEBS	2-4=-472/222

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-0-0 to 3-0-0, Exterior(2R) 3-0-0 to 4-7-15, Exterior(2E) 4-7-15 to 7-7-15 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 29 lb uplift at joint 1, 29 lb uplift at joint 3 and 83 lb uplift at joint 4.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 3.

LOAD CASE(S) Standard

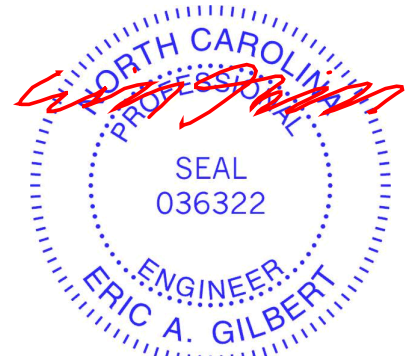

January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacompnents.com](http://www.sbcacompnents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688895
25100038-01	V04	Valley	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:38  
ID:o7ulAWxTBLFlrFLHnz6txFzwn26-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

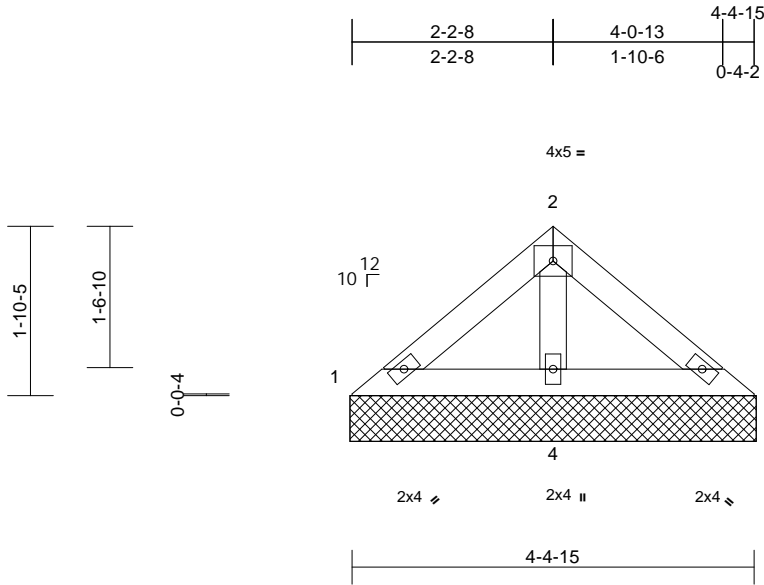

Scale = 1:25.3

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.07	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.09	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.03	Horiz(TL)	0.00	4	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 16 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-4-15 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

#### REACTIONS

(size)	1=4-5-9, 3=4-5-9, 4=4-5-9
Max Horiz	1=-39 (LC 10)
Max Uplift	3=-7 (LC 15), 4=-28 (LC 14)
Max Grav	1=83 (LC 20), 3=83 (LC 21), 4=264 (LC 20)

#### FORCES

(lb) - Maximum Compression/Maximum Tension


TOP CHORD	1-2=-76/89, 2-3=-76/89
BOT CHORD	1-4=-73/77, 3-4=-73/77
WEBS	2-4=-181/80

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 7 lb uplift at joint 3 and 28 lb uplift at joint 4.
- Beveled plate or shim required to provide full bearing surface with truss chord at joint(s) 1, 3.

LOAD CASE(S) Standard

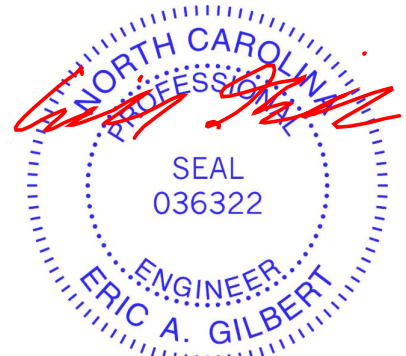

January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH
25100038-01	T16	Piggyback Base Supported Gable	1	1	170688896
Job Reference (optional)					

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 E Nov 16 2023 Print: 8.730 E Nov 16 2023 MiTek Industries, Inc. Mon Jan 13 09:10:31  
ID:1TBkY\_oeWsuG414YKOK8E1zwmxq-pYdKIVL2VmQVNaJn8wFn9GF1ooT9t49EWvB5Yzw\_xc

Page: 1

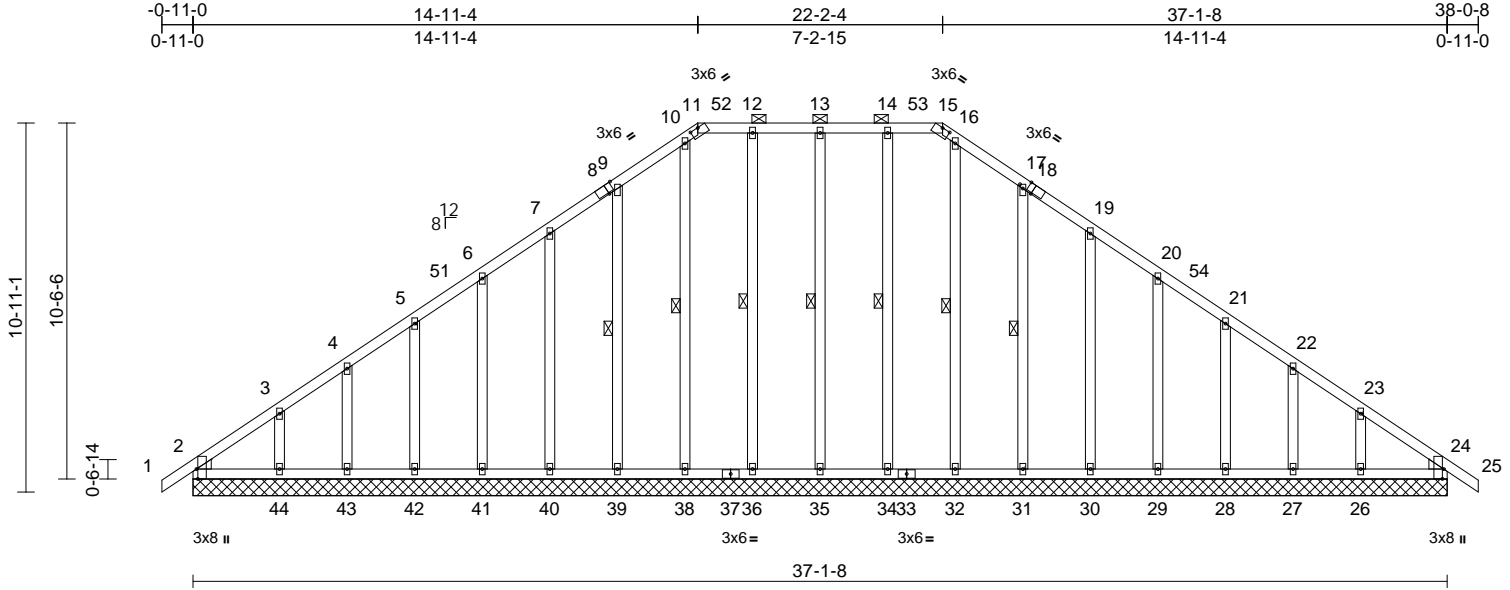

Scale = 1:68.2

Plate Offsets (X, Y): [2:0-3-8,Edge], [8:0-2-1,Edge], [9:0-1-8,0-1-0], [11:0-3-0,0-0-2], [15:0-3-0,0-0-2], [17:0-1-8,0-1-0], [18:0-2-1,Edge], [24:0-3-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.09	Vert(LL)	n/a	-	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.08	Vert(CT)	n/a	-	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.20	Horz(CT)	0.01	24	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
Weight: 288 lb FT = 20%											

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3  
WEDGE Left: 2x4 SP No.3  
Right: 2x4 SP No.3

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 11-15.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 13-35, 12-36, 10-38, 9-39, 14-34, 16-32, 17-31

#### REACTIONS

All bearings 37-1-8.  
(lb) - Max Horiz 2=-249 (LC 12), 45=-249 (LC 12)  
Max Uplift All uplift 100 (lb) or less at joint(s)  
2, 24, 26, 27, 28, 29, 30, 31, 34, 35, 36, 38, 39, 40, 41, 42, 43, 45, 48 except 44=-109 (LC 14)  
Max Grav All reactions 250 (lb) or less at joint (s) 2, 24, 26, 27, 28, 29, 30, 31, 32, 34, 35, 36, 38, 39, 40, 41, 42, 43, 44, 45, 48

#### FORCES

(lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.


#### NOTES

1) Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 2-6-12, Exterior(2N) 2-6-12 to 11-2-12, Corner(3R) 11-2-12 to 25-10-12, Exterior(2N) 25-10-12 to 34-3-15, Corner(3E) 34-3-15 to 38-0-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- N/A

14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

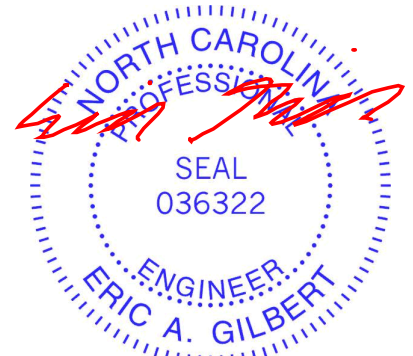

January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see ANSI/TPI1 Quality Criteria and DSB-22 available from Truss Plate Institute (www.tpinst.org) and BCSI Building Component Safety Information available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688897
25100038-01	T15	Piggyback Base	2	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:37

Page: 1

ID:QOImBn4C6eyMxqFrVl9WoizwnQS-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrdCoI7J4zJC?f

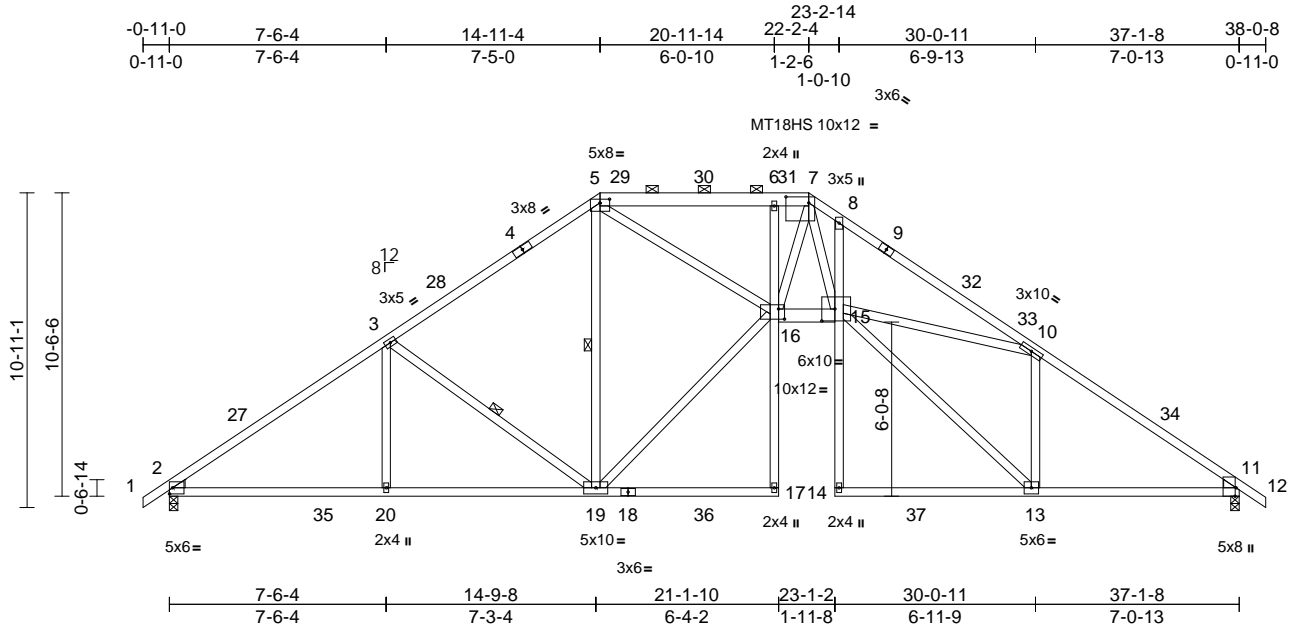

Scale = 1:80

Plate Offsets (X, Y): [5:0-4-0,0-1-9], [7:0-9-8,0-2-8], [11:0-3-8,Edge], [15:0-5-8,0-5-0], [16:0-2-8,0-4-4]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.74	Vert(LL)	-0.37	13-14	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.89	Vert(CT)	-0.64	13-14	>697	180	MT18HS	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.91	Horz(CT)	0.53	11	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 260 lb	FT = 20%

<b>LUMBER</b>		
TOP CHORD	2x4 SP 2400F 2.0E *Except* 5-7:2x6 SP No.2	
BOT CHORD	2x4 SP No.2 *Except* 17-6,8-14:2x4 SP No.3, 16-15:2x6 SP No.2	
WEBS	2x4 SP No.3 *Except*	
WEDGE	Left: 2x4 SP No.3 Right: 2x4 SP No.3	
<b>BRACING</b>		
TOP CHORD	Structural wood sheathing directly applied or 2-6-11 oc purlins, except 2-0-0 oc purlins (3-4-6 max.): 5-7. Rigid ceiling directly applied or 10-0-0 oc bracing.	
BOT CHORD		
WEBS	1 Row at midpt 3-19, 5-19	
<b>REACTIONS</b>		
(size)	2=0-3-8, 11=0-3-8	
Max Horiz	2=-248 (LC 12)	
Max Uplift	2=-158 (LC 14), 11=-158 (LC 15)	
Max Grav	2=1791 (LC 51), 11=1782 (LC 53)	
<b>FORCES</b>		
(lb) - Maximum Compression/Maximum Tension		
TOP CHORD	1-2=0/31, 2-3=-2899/224, 3-5=-2290/249, 5-6=-4324/225, 6-7=-4331/225, 7-8=-5992/330, 8-10=-6158/222, 10-11=-2909/220, 11-12=0/31	
BOT CHORD	2-20=-226/2318, 19-20=-226/2318, 17-19=0/16, 16-17=0/140, 6-16=-534/187, 15-16=0/4139, 14-15=0/164, 8-15=-372/231, 13-14=0/32, 11-13=-60/2324	

**WEBS** 3-20=0/319, 3-19=-780/231, 5-19=-949/63, 16-19=-57/2376, 5-16=0/3037, 7-16=-176/606, 7-15=-183/2981, 13-15=-86/3083, 10-15=0/2654, 10-13=-1814/134

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-9-9, Interior (1) 2-9-9 to 9-8-4, Exterior(2R) 9-8-4 to 27-5-4, Interior (1) 27-5-4 to 34-3-15, Exterior(2E) 34-3-15 to 38-0-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- All plates are MT20 plates unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.

- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 11. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard



January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688898
25100038-01	T14-B	Piggyback Base	2	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:37

Page: 1

ID:AI1MRIs5Zoo7wT5WxhZrnBzwn7N-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

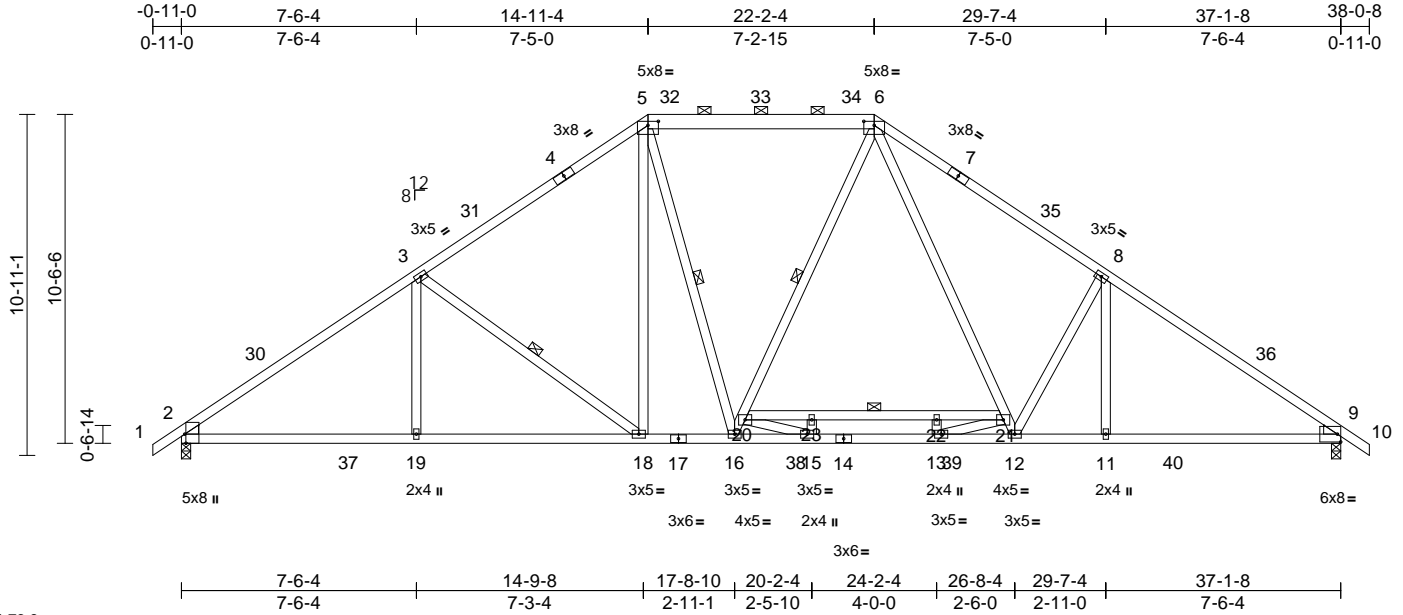

Scale = 1:73.8

Plate Offsets (X, Y): [2:0-3-8,Edge], [5:0-4-0,0-1-9], [6:0-4-0,0-1-9]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.68	Vert(LL)	-0.15	18-19	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.97	Vert(CT)	-0.29	18-19	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.47	Horz(CT)	0.12	9	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 249 lb	FT = 20%

**LUMBER**  
TOP CHORD 2x4 SP 2400F 2.0E \*Except\* 5-6:2x6 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3 \*Except\* 6-12,16-6,16-5:2x4 SP No.1  
WEDGE Left: 2x4 SP No.3  
Right: 2x4 SP No.3

**BRACING**  
TOP CHORD Structural wood sheathing directly applied or 3-11-4 oc purlins, except 2-0-0 oc purlins (4-9-8 max.): 5-6.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing, Except: 2-2-0 oc bracing: 2-19,9-11.  
WEBS 1 Row at midpt 3-18, 20-21, 6-16, 5-16

**REACTIONS** (size) 2=0-3-8, 9=0-3-8  
Max Horiz 2=248 (LC 13)  
Max Uplift 2=-77 (LC 14), 9=-38 (LC 15)  
Max Grav 2=1848 (LC 51), 9=1887 (LC 53)

**FORCES** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/31, 2-3=-3000/86, 3-5=-2382/109, 5-6=-1900/121, 6-8=-2807/114, 8-9=-3051/26, 9-10=0/31  
BOT CHORD 2-19=-137/2400, 18-19=-112/2400, 16-18=0/1760, 15-16=0/1763, 13-15=0/2280, 12-13=0/1818, 11-12=0/2444, 9-11=-1/2444

**WEBS** 3-19=0/332, 3-18=-789/234, 5-18=-67/652, 8-11=0/249, 6-21=-43/965, 12-21=-154/770, 20-23=-623/0, 22-23=-623/0, 21-22=-623/0, 13-22=0/18, 15-23=0/9, 15-20=0/608, 13-21=0/573, 8-12=-677/255, 16-20=-216/154, 6-20=-85/305, 5-16=-56/302

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-9-9, Interior (1) 2-9-9 to 9-8-4, Exterior(2R) 9-8-4 to 27-5-4, Interior (1) 27-5-4 to 34-3-15, Exterior(2E) 34-3-15 to 38-0-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 200.0lb AC unit load placed on the bottom chord, 22-2-4 from left end, supported at two points, 5-0-0 apart.
- Provide adequate drainage to prevent water ponding.

- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 9. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

**LOAD CASE(S)** Standard



January 13,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**


Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932



Carter Components (Sanford, NC), Sanford, NC - 27332, Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:37 Page: 1  
ID:8QQo8oYTPFF3pzWbURDtcwmy9-RfC?PsB70Hg3NSgPqnL8w3ulTXbGKWCDoi7J4zJC?f



<b>LUMBER</b> TOP CHORD 2x4 SP 2400F 2.0E BOT CHORD 2x4 SP No.2 WEBS 2x4 SP No.3 *Except* 12-5:2x4 SP No.2 WEDGE Left: 2x4 SP No.3 Right: 2x4 SP No.3	3) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-9-9, Interior (1) 2-9-9 to 9-8-4, Exterior(2R) 9-8-4 to 27-5-4, Interior (1) 27-5-4 to 34-3-15, Exterior(2E) 34-3-15 to 38-0-8 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
<b>BRACING</b> TOP CHORD Structural wood sheathing directly applied or 4-4-9 oc purlins, except 2-0-0 oc purlins (5-5-7 max.): 5-6. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.	3) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
<b>REACTIONS</b> WEBS 1 Row at midpt 3-15, 5-12, 8-12 (size) 2=0-3-8, 9=0-3-8 Max Horiz 2=-249 (LC 12) Max Uplift 2=-158 (LC 14), 9=-158 (LC 15) Max Grav 2=1805 (LC 51), 9=1799 (LC 53)	4) Unbalanced snow loads have been considered for this design. 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
<b>FORCES</b> TOP CHORD (lb) - Maximum Compression/Maximum Tension 1-2=0/31, 2-3=-2923/224, 3-5=-2315/248, 5-6=-1790/266, 6-8=-2306/248, 8-9=-2914/225, 9-10=0/31 BOT CHORD 2-16=-227/2340, 15-16=-227/2340, 12-15=-37/1696, 11-12=-60/2332, 9-11=-60/2332 WEBS 3-16=0/309, 3-15=-792/234, 5-15=-45/781, 5-12=-208/210, 6-12=-28/759, 8-12=-793/234, 8-11=0/311	6) Provide adequate drainage to prevent water ponding. 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads. 8) * This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
<b>NOTES</b> 1) Unbalanced roof live loads have been considered for this design.	9) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 9. This connection is for uplift only and does not consider lateral forces. 10) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

January 13, 2025

WARNING – Verify design parameters and READ NOTES ON THIS AND INCLUDED MITTEL REFERENCE PAGE MIT-TR-17-0169, 1/12/2023 BEFORE USE.

Design valid for use only with MiTeK® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TP1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Components Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))

**TRENCO** ENGINEERING BY  
A MITek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688900
25100038-01	T13	Piggyback Base	6	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36

Page: 1

ID:u9RQCydAlZqeYqvRbuo?8bzwnCq-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDoi7J4zJC?f

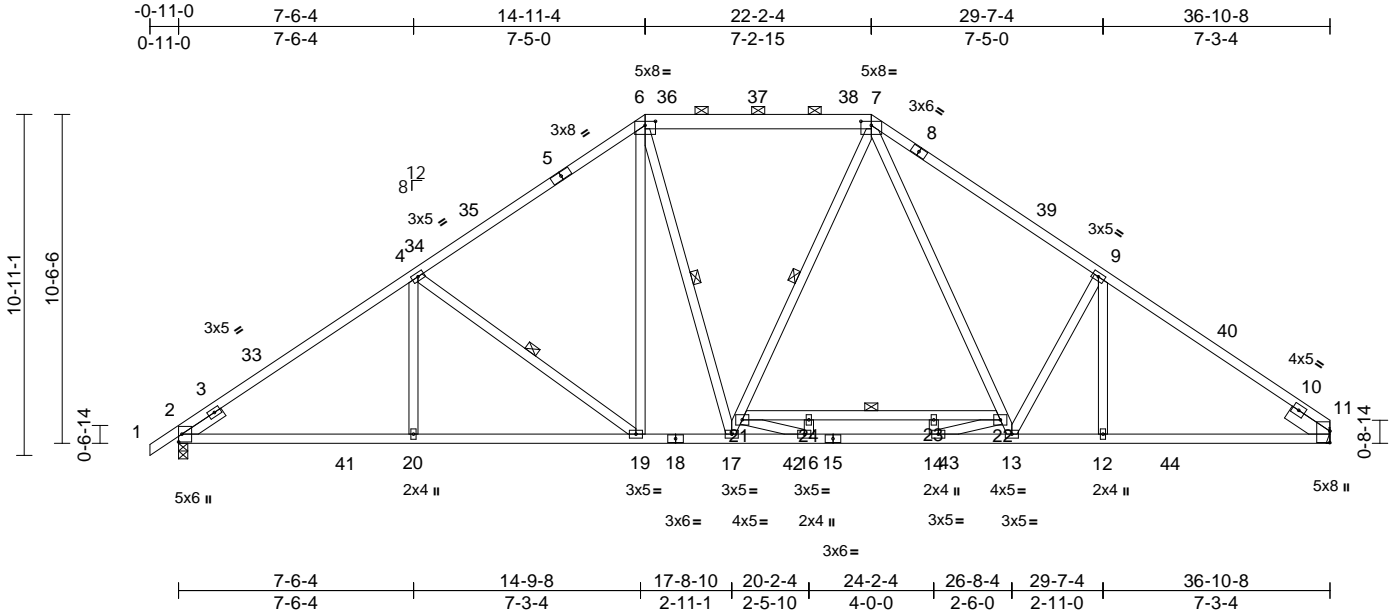

Scale = 1:73.8

Plate Offsets (X, Y): [6:0-4-0,0-1-9], [7:0-4-0,0-1-9], [11:0-4-6,0-0-1]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.84	Vert(LL)	-0.13	19-20	>999	240	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.51	Vert(CT)	-0.26	19-20	>999	180	
TCDL	10.0	Rep Stress Incr	YES	WB	0.41	Horz(CT)	0.10	11	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
Weight: 251 lb FT = 20%											

#### LUMBER

TOP CHORD	2x4 SP 2400F 2.0E *Except* 6-7:2x6 SP No.2, 7-8:2x4 SP No.1
BOT CHORD	2x4 SP 2400F 2.0E
WEBS	2x4 SP No.3 *Except* 17-7,7-13,17-6:2x4 SP No.2
SLIDER	Left 2x4 SP No.3 -- 1-6-0, Right 2x6 SP No.2 -- 1-6-0

#### BRACING

TOP CHORD	Structural wood sheathing directly applied, except 2-0-0 oc purlins (4-9-15 max.): 6-7.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
WEBS	1 Row at midpt 4-19, 7-17, 21-22, 6-17

#### REACTIONS

(size)	2=0-3-8, 11= Mechanical
Max Horiz	2=242 (LC 11)
Max Uplift	2=-79 (LC 14), 11=-17 (LC 15)
Max Grav	2=1838 (LC 51), 11=1819 (LC 47)

#### FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/35, 2-4=-2904/86, 4-6=-2336/111, 6-7=-1863/122, 7-9=-2730/112, 9-11=-2917/31
BOT CHORD	2-20=-124/2320, 19-20=-124/2320, 17-19=0/1722, 16-17=0/1734, 14-16=0/2227, 13-14=0/1785, 12-13=0/2330, 11-12=-92/2330
WEBS	4-20=0/315, 4-19=-741/232, 6-19=-66/629, 9-12=-11/191, 17-21=-207/153, 7-21=-78/303, 7-22=-41/916, 13-22=-149/728, 21-24=-609/0, 23-24=-609/0, 22-23=-609/0, 14-23=0/13, 16-24=0/9, 16-21=0/583, 14-22=0/550, 6-17=-52/294, 9-13=-584/261

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-9-4, Interior (1) 2-9-4 to 9-8-11, Exterior(2R) 9-8-11 to 27-4-13, Interior (1) 27-4-13 to 33-2-4, Exterior(2E) 33-2-4 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 200.0lb AC unit load placed on the bottom chord, 22-2-4 from left end, supported at two points, 5-0-0 apart.
- Provide adequate drainage to prevent water ponding.
- All plates are 3x5 MT20 unless otherwise indicated.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- Refer to girder(s) for truss to truss connections.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 17 lb uplift at joint 11.

- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard

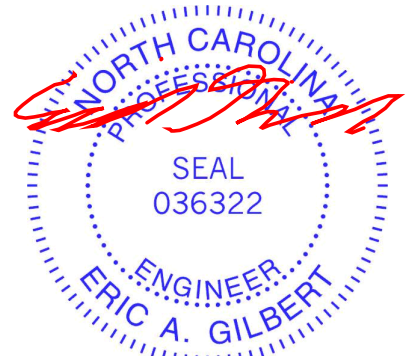

January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688901
25100038-01	T12	Piggyback Base Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36

Page: 1

ID:bpWnkZYnOQxeDlt5gwAML7zwnCxRfC?PsB70Hq3NSgPqnL8w3uITXbGKWrcDdoI7J4zJC?f

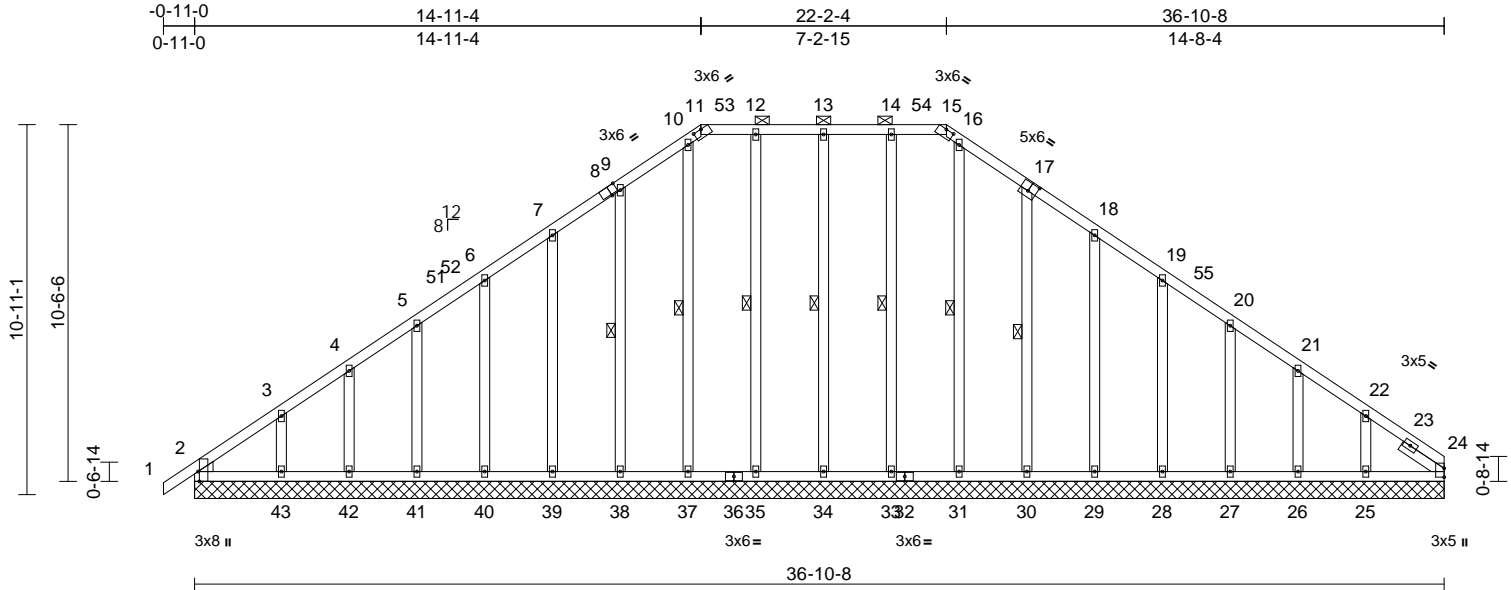

Scale = 1:68

Plate Offsets (X, Y): [2:0-3-8,Edge], [8:0-2-9,Edge], [11:0-3-0,0-0-2], [15:0-3-0,0-0-2], [17:0-3-0,0-3-0]

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.08	Vert(LL)	n/a	-	n/a	999	MT20
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.07	Vert(CT)	n/a	-	n/a	999	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.19	Horz(CT)	0.01	24	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
Weight: 287 lb FT = 20%											

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3  
WEDGE Left: 2x4 SP No.3  
SLIDER Right 2x4 SP No.3 -- 1-6-0

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins, except 2-0-0 oc purlins (6-0-0 max.): 11-15.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 13-34, 12-35, 10-37, 9-38, 14-33, 16-31, 17-30

REACTIONS (size) 2=36-10-8, 24=36-10-8, 25=36-10-8, 26=36-10-8, 27=36-10-8, 28=36-10-8, 29=36-10-8, 30=36-10-8, 31=36-10-8, 33=36-10-8, 34=36-10-8, 35=36-10-8, 37=36-10-8, 38=36-10-8, 39=36-10-8, 40=36-10-8, 41=36-10-8, 42=36-10-8, 43=36-10-8  
Max Horiz 2=236 (LC 11)  
Max Uplift 2=62 (LC 10), 24=-13 (LC 13), 25=-115 (LC 15), 26=-40 (LC 15), 27=-60 (LC 15), 28=-56 (LC 15), 29=-51 (LC 15), 30=-70 (LC 15), 33=-23 (LC 11), 34=-32 (LC 10), 35=-22 (LC 11), 37=-6 (LC 11), 38=-67 (LC 14), 39=-55 (LC 14), 40=-55 (LC 14), 41=-60 (LC 14), 42=-41 (LC 14), 43=-105 (LC 14)

#### FORCES

(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/30, 2-3=-229/188, 3-4=-169/154, 4-5=-146/138, 5-6=-132/131, 6-7=-130/147, 7-9=-129/179, 9-10=-159/216, 10-11=-135/184, 11-12=-129/201, 12-13=-129/201, 13-14=-129/201, 14-15=-129/201, 15-16=-135/185, 16-18=-160/213, 18-19=-110/104, 19-20=-75/55, 20-21=-78/46, 21-22=-105/63, 22-24=-169/98  
BOT CHORD 2-43=-109/159, 42-43=-75/159, 41-42=-75/159, 40-41=-75/159, 39-40=-75/159, 38-39=-75/159, 37-38=-75/159, 35-37=-75/159, 34-35=-75/159, 33-34=-75/159, 31-33=-75/159, 30-31=-75/159, 29-30=-74/158, 28-29=-74/158, 27-28=-74/158, 26-27=-74/158, 25-26=-74/158, 24-25=-74/158  
WEBS 13-34=-183/60, 12-35=-178/45, 10-37=-142/29, 9-38=-198/90, 7-39=-186/78, 6-40=-182/79, 5-41=-145/81, 4-42=-131/73, 3-43=-165/102, 14-33=-177/46, 16-31=-134/0, 17-30=-197/93, 18-29=-178/74, 19-28=-181/80, 20-27=-142/81, 21-26=-132/71, 22-25=-166/114

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 2-6-12, Exterior(2N) 2-6-12 to 11-3-0, Corner(3R) 11-3-0 to 25-10-8, Exterior (2N) 25-10-8 to 33-2-4, Corner(3E) 33-2-4 to 36-10-8 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10



January 13, 2025

Continued on page 2

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacompnents.com](http://www.sbcacompnents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932



Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH
25100038-01	T12	Piggyback Base Supported Gable	1	1	I70688901
Job Reference (optional)					

- 5) Unbalanced snow loads have been considered for this design.
- 6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 7) Provide adequate drainage to prevent water ponding.
- 8) All plates are 2x4 MT20 unless otherwise indicated.
- 9) Gable requires continuous bottom chord bearing.
- 10) Gable studs spaced at 2-0-0 oc.
- 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 12) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 13) N/A

- 14) Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.

LOAD CASE(S) Standard




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688902
25100038-01	T11	Common Supported Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36

Page: 1

ID: ?addf8zgiguRNSCttrJ6P?zwnDh-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

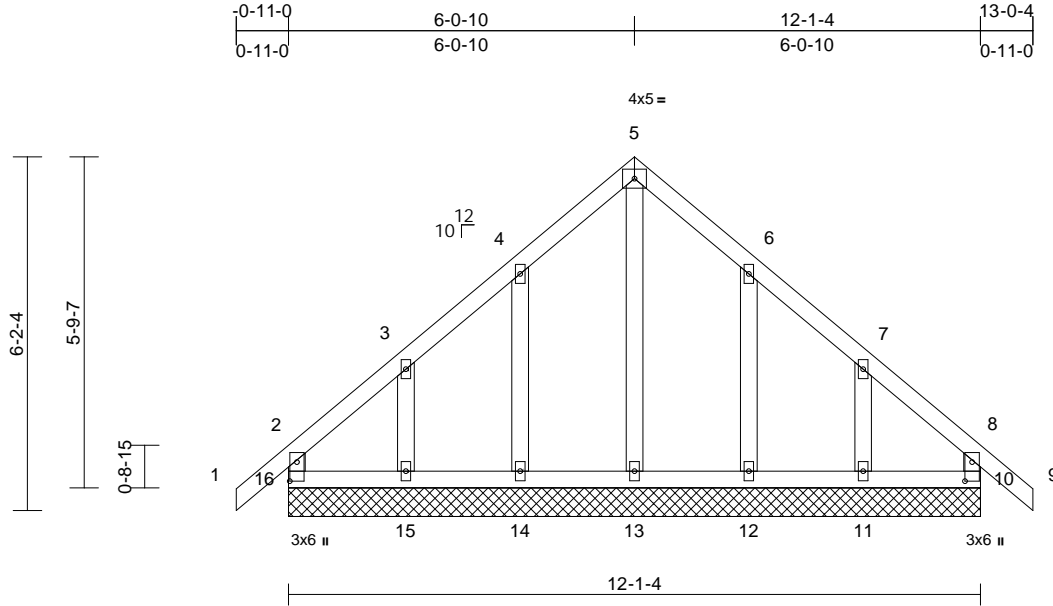

Scale = 1:40.3

Plate Offsets (X, Y): [10:0-4-0,0-1-8], [16:0-4-0,0-1-8]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.15	Vert(LL)	n/a	-	n/a	999	MT20
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.05	Vert(CT)	n/a	-	n/a	999	244/190
TCDL	10.0	Rep Stress Incr	YES	WB	0.12	Horz(CT)	0.00	10	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MR							
BCDL	10.0										
										Weight: 71 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 6-0-0 oc bracing.

REACTIONS	(size)	10=12-1-4, 11=12-1-4, 12=12-1-4, 13=12-1-4, 14=12-1-4, 15=12-1-4, 16=12-1-4
	Max Horiz	16=155 (LC 12)
	Max Uplift	10=23 (LC 11), 11=103 (LC 15), 12=72 (LC 15), 14=71 (LC 14), 15=106 (LC 14), 16=42 (LC 10)
	Max Grav	10=148 (LC 37), 11=188 (LC 22), 12=277 (LC 22), 13=175 (LC 28), 14=277 (LC 21), 15=188 (LC 21), 16=161 (LC 26)

#### FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD	2-16=-134/111, 1-2=0/41, 2-3=-101/90, 3-4=-74/121, 4-5=-118/225, 5-6=-118/224, 6-7=-72/122, 7-8=-81/66, 8-9=0/41, 8-10=-130/108
BOT CHORD	15-16=-66/139, 14-15=-66/139, 13-14=-66/139, 12-13=-66/139, 11-12=-66/139, 10-11=-66/139
WEBS	5-13=-205/50, 4-14=-236/137, 3-15=-163/156, 6-12=-236/136, 7-11=-160/160


#### NOTES

- 1) Unbalanced roof live loads have been considered for this design.

- 2) Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Corner(3E) -0-11-0 to 2-0-10, Exterior(2N) 2-0-10 to 3-0-10, Corner(3R) 3-0-10 to 9-0-10, Exterior (2N) 9-0-10 to 10-0-4, Corner(3E) 10-0-4 to 13-0-4 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 3) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- 4) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 5) Unbalanced snow loads have been considered for this design.
- 6) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- 7) All plates are 2x4 MT20 unless otherwise indicated.
- 8) Gable requires continuous bottom chord bearing.
- 9) Truss to be fully sheathed from one face or securely braced against lateral movement (i.e. diagonal web).
- 10) Gable studs spaced at 2-0-0 oc.
- 11) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 12) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- 13) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 42 lb uplift at joint 16, 23 lb uplift at joint 10, 71 lb uplift at joint 14, 106 lb uplift at joint 15, 72 lb uplift at joint 12 and 103 lb uplift at joint 11.

LOAD CASE(S) Standard

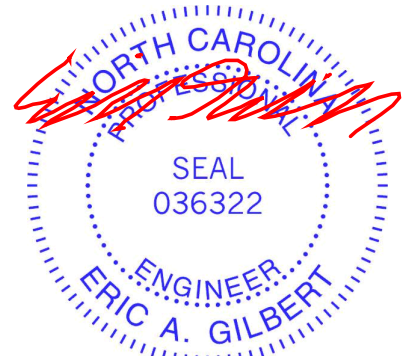

January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688903
25100038-01	T10	Common Girder	1	2	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36

Page: 1

ID:hu8G0u\_FZlKtF20oBp55zwn22-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?i

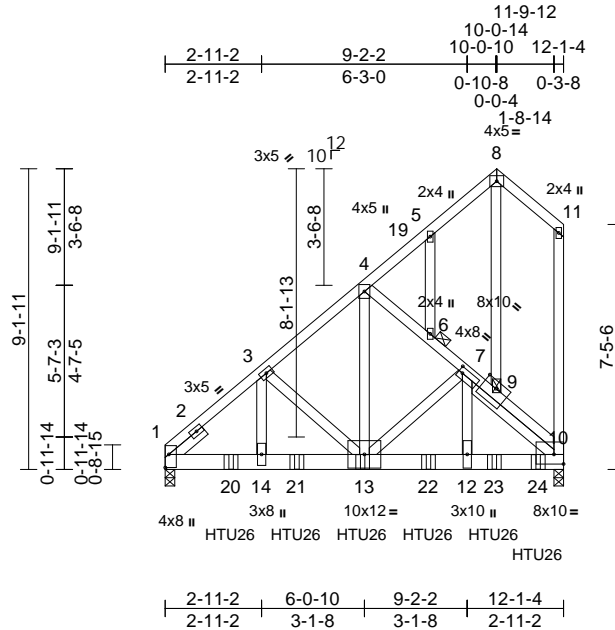

Scale = 1:70

Plate Offsets (X, Y): [1:Edge,0-1-5], [7:0-1-8,0-2-0], [9:0-5-0,0-2-8], [10:Edge,0-3-8]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.54	Vert(LL)	-0.05	13-14	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.38	Vert(CT)	-0.09	13-14	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.65	Horz(CT)	0.01	10	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 242 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x6 SP 2400F 2.0E
WEBS	2x4 SP No.3 *Except* 4-13:2x4 SP No.2
OTHERS	2x4 SP No.3
SLIDER	Left 2x4 SP No.3 -- 1-3-11

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 4-7-3 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
JOINTS	1 Brace at Jt(s): 6, 9

#### REACTIONS

(size)	1=0-3-8, 10=0-3-8
Max Horiz	1=282 (LC 11)
Max Uplift	1=-90 (LC 12), 10=-203 (LC 12)
Max Grav	1=5064 (LC 22), 10=6663 (LC 21)

#### FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-3=-5817/119, 3-4=-4469/116, 4-5=-229/130, 5-8=-196/121, 8-11=-223/108, 4-6=-4413/204, 6-7=-4489/253, 7-9=-6315/270, 9-10=-6320/224, 10-11=-236/79
BOT CHORD	1-14=-214/4424, 13-14=-214/4424, 12-13=-190/4809, 10-12=-194/5008
WEBS	5-6=-144/76, 8-9=-148/210, 4-13=-106/5318, 3-13=-1254/119, 3-14=-25/1756, 7-12=-52/2524, 7-13=-1768/41


#### NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x6 - 3 rows staggered at 0-7-0 oc.  
Web connected as follows: 2x4 - 1 row at 0-9-0 oc, Except member 4-13 2x4 - 1 row at 0-6-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.

- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 1 and 10. This connection is for uplift only and does not consider lateral forces.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Use Simpson Strong-Tie HTU26 (10-16d Girder, 14-10dx1 1/2 Truss) or equivalent spaced at 2-0-0 oc max. starting at 2-0-0 from the left end to 11-4-0 to connect truss(es) to back face of bottom chord.
- Fill all nail holes where hanger is in contact with lumber.

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-4=-60, 4-8=-60, 8-11=-60, 10-15=-20  
Concentrated Loads (lb)  
Vert: 13=-1710 (B), 20=-1710 (B), 21=-1710 (B), 22=-1710 (B), 23=-1710 (B), 24=-1714 (B)

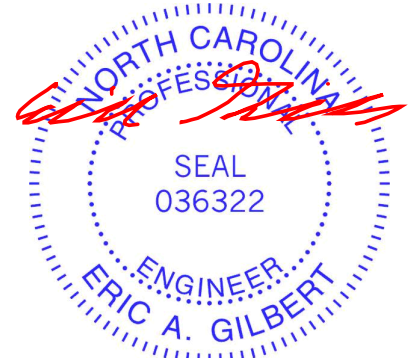

January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688904
25100038-01	T09	Common	6	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36  
ID:D8Rd?jQ0ceuTjs?TwgXKIDzwnFg-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

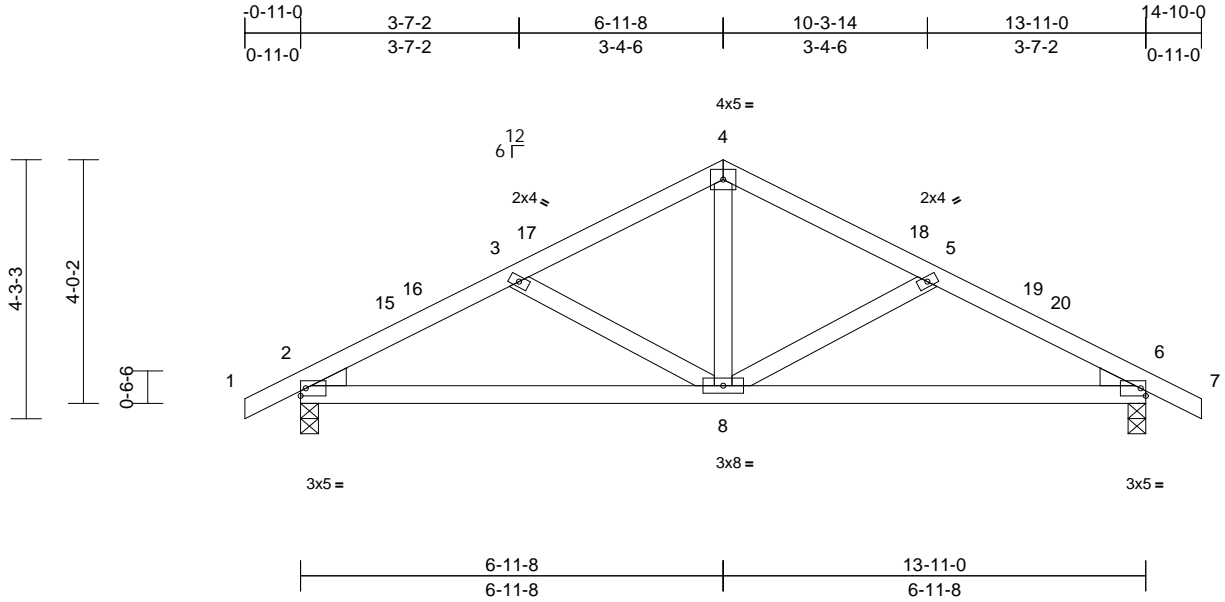

Scale = 1:37.9

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.23	Vert(LL)	-0.04	8-14	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.08	8-14	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.14	Horz(CT)	0.02	6	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 65 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3  
WEDGE Left: 2x4 SP No.3  
Right: 2x4 SP No.3

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 5-8-1 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size) 2=0-3-8, 6=0-3-8  
Max Horiz 2=62 (LC 14)  
Max Uplift 2=-71 (LC 14), 6=-71 (LC 15)  
Max Grav 2=695 (LC 21), 6=695 (LC 22)

#### FORCES


(lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=0/25, 2-3=-1021/292, 3-4=-710/226,  
4-5=-710/226, 5-6=-1021/292, 6-7=0/25  
BOT CHORD 2-8=-178/864, 6-8=-178/864  
WEBS 4-8=-50/374, 3-8=-343/150, 5-8=-343/150

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior (1) 2-1-0 to 3-11-8, Exterior(2R) 3-11-8 to 9-11-8, Interior (1) 9-11-8 to 11-10-0, Exterior(2E) 11-10-0 to 14-10-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 71 lb uplift at joint 2 and 71 lb uplift at joint 6.

LOAD CASE(S) Standard

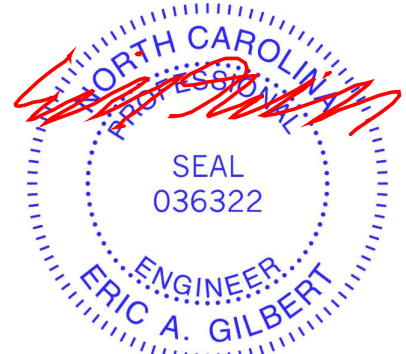

January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688905
25100038-01	T08	Common Structural Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:36  
ID:Zqj4UdHURyNAH049D8KWGhzwF5-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCD0i7J4zJC?f

Page: 1

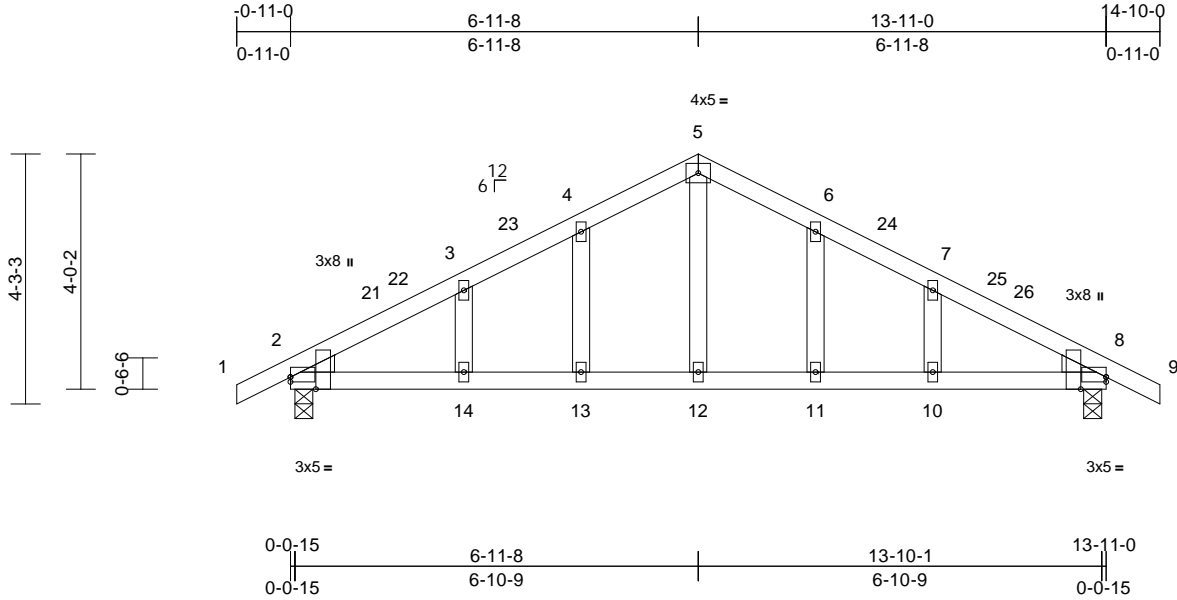

Scale = 1:39.3

Plate Offsets (X, Y): [2:Edge,0-1-0], [2:0-2-8,Edge], [8:Edge,0-1-0], [8:0-2-8,Edge]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.47	Vert(LL)	-0.16	13-14	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.72	Vert(CT)	-0.22	13-14	>769	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.15	Horz(CT)	0.02	2	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 66 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3
WEDGE	Left: 2x4 SP No.3 Right: 2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-8-12 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size)	2=0-3-11, 8=0-3-11
Max Horiz	2=62 (LC 14)
Max Uplift	2=-71 (LC 14), 8=-71 (LC 15)
Max Grav	2=695 (LC 21), 8=695 (LC 22)

#### FORCES


(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/25, 2-3=-778/204, 3-4=-728/239, 4-5=-722/289, 5-6=-722/289, 6-7=-728/239, 7-8=-778/204, 8-9=0/25
BOT CHORD	2-14=-100/639, 13-14=-100/639, 12-13=-100/639, 11-12=-100/639, 10-11=-100/639, 8-10=-100/639
WEBS	5-12=-118/369, 4-13=-125/85, 3-14=-76/54, 6-11=-125/85, 7-10=-76/54

#### NOTES

- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Interior (1) 2-1-0 to 3-11-8, Exterior(2R) 3-11-8 to 9-11-8, Interior (1) 9-11-8 to 11-10-0, Exterior(2E) 11-10-0 to 14-10-0 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 8. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard

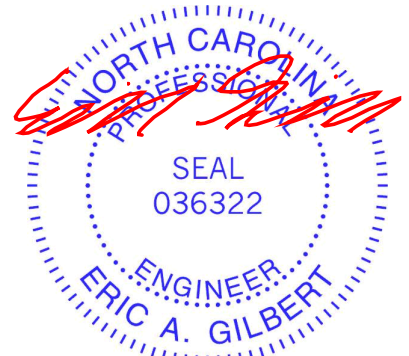

January 13,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacomponents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688906
25100038-01	T07	Common	3	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35

Page: 1

ID:CtwBRvDLcQltAFBBrbkLZdzwnFx-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

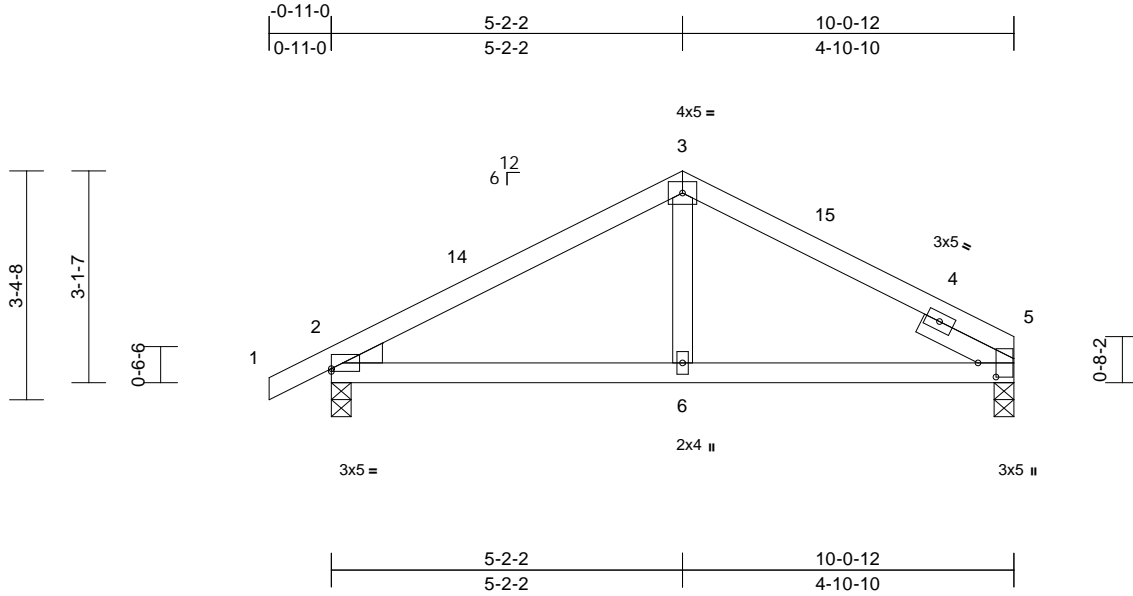

Scale = 1:34

Plate Offsets (X, Y): [2:Edge,0-0-8], [5:0-2-8,0-3-3]

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.51	Vert(LL)	-0.03	6-13	>999	240	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.34	Vert(CT)	-0.05	6-13	>999	180	
TCDL	10.0	Rep Stress Incr	YES	WB	0.08	Horz(CT)	0.01	2	n/a	n/a	
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH							
BCDL	10.0										
										Weight: 40 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
WEDGE	Left: 2x4 SP No.3
SLIDER	Right 2x4 SP No.3 -- 1-6-0

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size)	2=0-3-8, 5=0-3-8
Max Horiz	2=58 (LC 14)
Max Uplift	2=-57 (LC 14), 5=-37 (LC 15)
Max Grav	2=563 (LC 21), 5=495 (LC 22)

#### FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/25, 2-3=-592/227, 3-5=-499/234
BOT CHORD	2-6=-159/428, 5-6=-157/428
WEBS	3-6=0/213

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Exterior(2R) 2-1-0 to 7-0-12, Exterior(2E) 7-0-12 to 10-0-12 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10

- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 57 lb uplift at joint 2.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 5. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard



January 13,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688907
25100038-01	T06	Common Structural Gable	1	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35  
ID:wW?YzW8yGGstrA9rWd6in9zwnG2-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWrCDoi7J4zJC?f

Page: 1

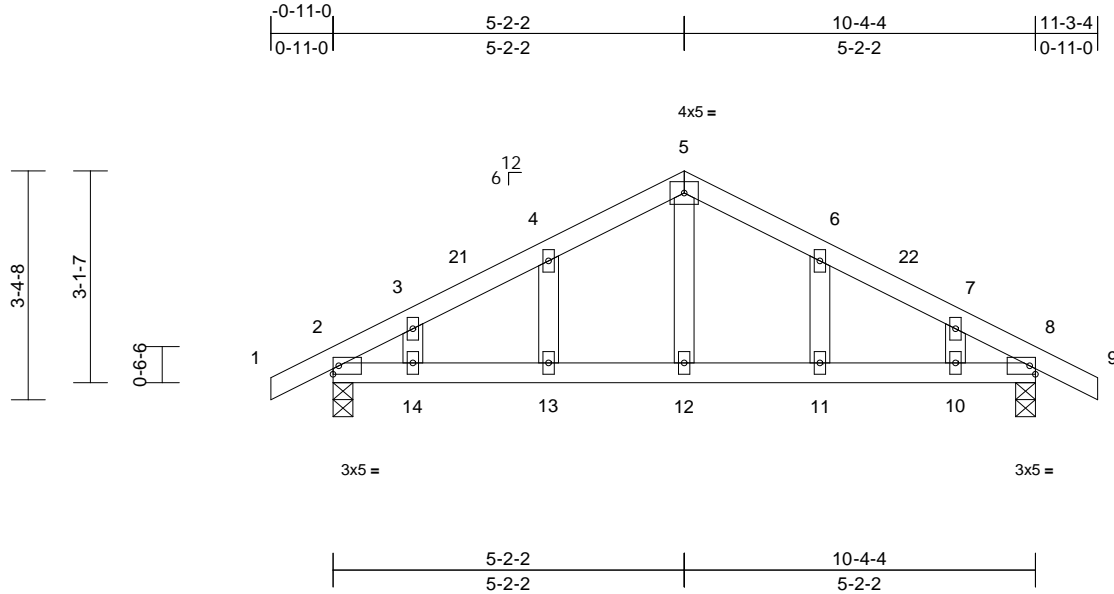

Scale = 1:34

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.28	Vert(LL)	-0.05	10-11	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.43	Vert(CT)	-0.07	10-11	>999	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.09	Horz(CT)	0.01	2	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MSH								
BCDL	10.0											
											Weight: 46 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size)	2=0-3-8, 8=0-3-8
Max Horiz	2=-48 (LC 15)
Max Uplift	2=-58 (LC 14), 8=-58 (LC 15)
Max Grav	2=572 (LC 21), 8=572 (LC 22)

#### FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=0/25, 2-3=-576/188, 3-4=-552/221, 4-5=-533/276, 5-6=-533/276, 6-7=-552/221, 7-8=-576/188, 8-9=0/25
BOT CHORD	2-14=-106/460, 13-14=-106/460, 12-13=-106/460, 11-12=-106/460, 10-11=-106/460, 8-10=-106/460
WEBS	5-12=-97/243, 4-13=-110/96, 3-14=-62/53, 6-11=-110/96, 7-10=-62/53

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 2-1-0, Exterior(2R) 2-1-0 to 8-3-4, Exterior(2E) 8-3-4 to 11-3-4 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- All plates are 2x4 MT20 unless otherwise indicated.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 58 lb uplift at joint 2 and 58 lb uplift at joint 8.

LOAD CASE(S) Standard



January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688908
25100038-01	T04	Monopitch	4	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35  
ID:bOhwYkAHy??dxWwmggCFMUzwnJt-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

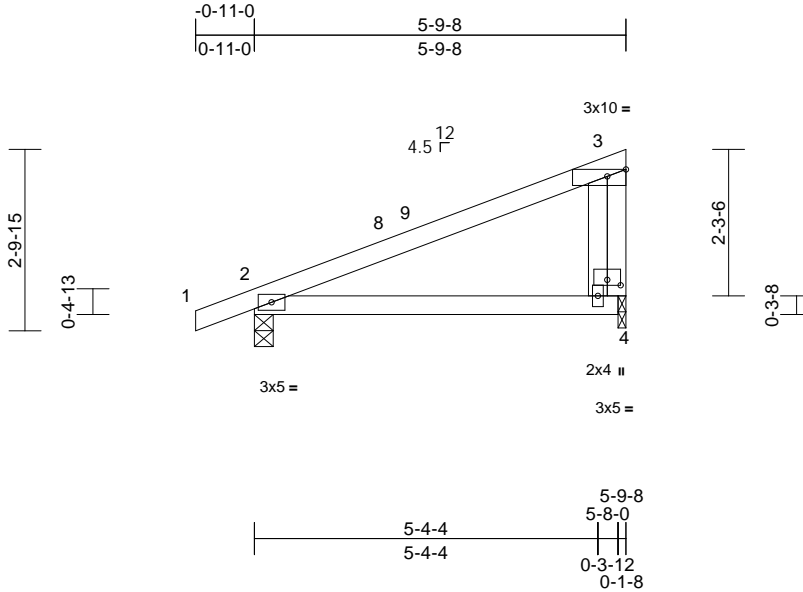

Scale = 1:35.9

Plate Offsets (X, Y): [3:Edge,0-1-5], [4:0-2-8,0-1-0]

Loading	(psf)	Spacing	2-0-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.66	Vert(LL)	-0.07	4-7	>959	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.47	Vert(CT)	-0.12	4-7	>540	180		
TCDL	10.0	Rep Stress Incr	YES	WB	0.00	Horz(CT)	0.01	2	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP								
BCDL	10.0										Weight: 25 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
OTHERS	2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

REACTIONS	(size) 2=0-3-8, 4=0-1-8
Max Horiz	2=92 (LC 13)
Max Uplift	2=-57 (LC 10), 4=-41 (LC 14)
Max Grav	2=395 (LC 21), 4=298 (LC 21)


FORCES	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/29, 2-3=-83/75, 3-4=-214/113
BOT CHORD	2-4=-28/114

#### NOTES

- 1) Wind: ASCE 7-16; Vult=130mph (3-second gust)  
Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-11-0 to 2-1-0, Interior (1) 2-1-0 to 2-6-0, Exterior(2E) 2-6-0 to 5-6-0 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- 3) Unbalanced snow loads have been considered for this design.
- 4) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.

- 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- 7) Bearing at joint(s) 4 considers parallel to grain value using ANSI/TPI 1 angle to grain formula. Building designer should verify capacity of bearing surface.
- 8) Provide mechanical connection (by others) of truss to bearing plate at joint(s) 4.
- 9) One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2 and 4. This connection is for uplift only and does not consider lateral forces.

LOAD CASE(S) Standard

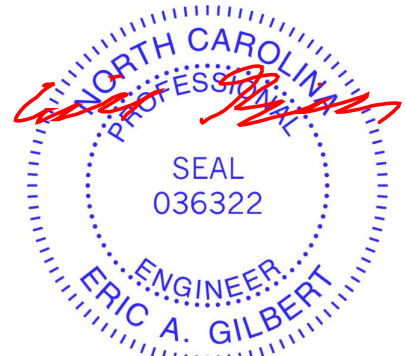

January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacompnents.com](http://www.sbcacompnents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688909
25100038-01	T03	Half Hip	1	2	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35  
ID:MfeWfg3d4EsvM8k1eHY8UbwznK0-RfC?PsB70Hq3NSgPqnL8w3ulTXbGKWRCDoi7J4zJC?f

Page: 1

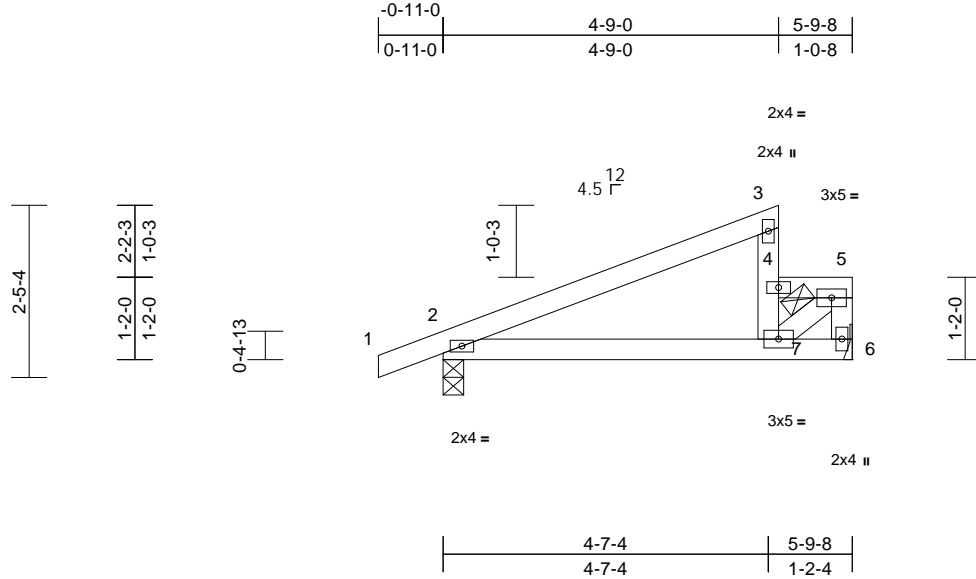

<b>Loading</b>	(psf)	<b>Spacing</b>	1-4-0	<b>CSI</b>		<b>DEFL</b>	in	(loc)	l/defl	L/d	<b>PLATES</b>	<b>GRIP</b>
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.33	Vert(LL)	-0.01	7-10	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.12	Vert(CT)	-0.02	7-10	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.10	Horz(CT)	0.00	2	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP								
BCDL	10.0										Weight: 48 lb	FT = 20%

<b>LUMBER</b>	
TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
WEBS	2x4 SP No.3
<b>BRACING</b>	
TOP CHORD	Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 4-7, 4-5.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.
<b>REACTIONS</b>	(size) 2=0-3-8, 6= Mechanical Max Horiz 2=62 (LC 14) Max Uplift 2=7 (LC 10) Max Grav 2=281 (LC 38), 6=352 (LC 38)
<b>FORCES</b>	(lb) - Maximum Compression/Maximum Tension
TOP CHORD	1-2=0/18, 2-3=-225/0, 4-7=-120/43, 3-4=-51/77, 4-5=-375/0, 5-6=-388/0
BOT CHORD	2-7=0/194, 6-7=-7/11
WEBS	5-7=0/497

#### NOTES

- 2-ply truss to be connected together with 10d (0.131"x3") nails as follows:  
Top chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Bottom chords connected as follows: 2x4 - 1 row at 0-9-0 oc.  
Web connected as follows: 2x4 - 1 row at 0-9-0 oc.
- All loads are considered equally applied to all plies, except if noted as front (F) or back (B) face in the LOAD CASE(S) section. Ply to ply connections have been provided to distribute only loads noted as (F) or (B), unless otherwise indicated.
- Unbalanced roof live loads have been considered for this design.

- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 5-7-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-3=-40, 4-5=-140 (F=-100), 6-8=-13  
Concentrated Loads (lb)  
Vert: 7=-120 (F)



January 13, 2025

#### WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	I70688910
25100038-01	T02	Half Hip	8	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35  
ID:mhHo83hBNiyJ8Nt4KGVsk2zwnKV-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWfCDoi7J4zJC?f

Page: 1

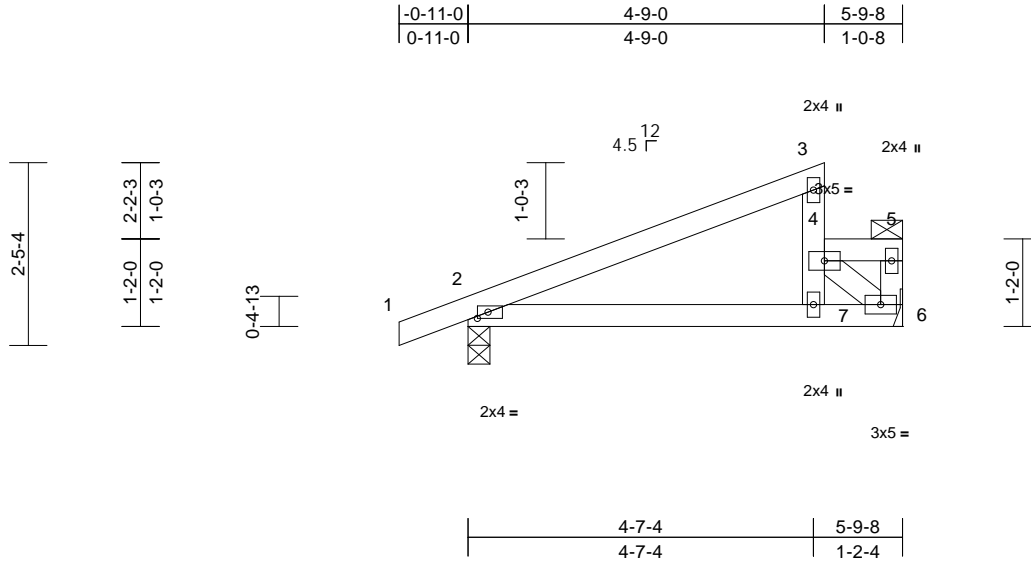

Scale = 1:30.7

Plate Offsets (X, Y): [2:0-1-11,0-1-0]

Loading	(psf)	Spacing	1-4-0	CSI		DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.61	Vert(LL)	-0.02	7-10	>999	240	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.24	Vert(CT)	-0.04	7-10	>999	180		
TCDL	10.0	Rep Stress Incr	NO	WB	0.08	Horz(CT)	0.00	2	n/a	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP								
BCDL	10.0											
											Weight: 24 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
WEBS 2x4 SP No.3

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 5-9-8 oc purlins, except end verticals, and 2-0-0 oc purlins: 4-7, 4-5.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

**REACTIONS** (size) 2=0-3-8, 6= Mechanical  
Max Horiz 2=62 (LC 14)  
Max Uplift 2=-16 (LC 10)  
Max Grav 2=271 (LC 38), 6=257 (LC 38)

**FORCES** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/18, 2-3=-203/0, 4-7=-18/98,  
3-4=-58/69, 4-5=-7/11, 5-6=-30/18  
BOT CHORD 2-7=-8/174, 6-7=0/344  
WEBS 4-6=-442/0

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) -0-11-0 to 5-7-12 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.

- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Provide adequate drainage to prevent water ponding.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Refer to girder(s) for truss to truss connections.
- One H2.5A Simpson Strong-Tie connectors recommended to connect truss to bearing walls due to UPLIFT at jt(s) 2. This connection is for uplift only and does not consider lateral forces.
- Load case(s) 1 has/have been modified. Building designer must review loads to verify that they are correct for the intended use of this truss.
- Graphical purlin representation does not depict the size or the orientation of the purlin along the top and/or bottom chord.
- Hanger(s) or other connection device(s) shall be provided sufficient to support concentrated load(s). The design/selection of such connection device(s) is the responsibility of others.
- In the LOAD CASE(S) section, loads applied to the face of the truss are noted as front (F) or back (B).

#### LOAD CASE(S) Standard

- Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (lb/ft)  
Vert: 1-3=-40, 4-5=-40, 6-8=-13  
Concentrated Loads (lb)  
Vert: 4=-120 (F)



January 13, 2025


**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute ([www.tpinst.org](http://www.tpinst.org)) and **BCSI Building Component Safety Information** available from the Structural Building Component Association ([www.sbcacomponents.com](http://www.sbcacomponents.com))



ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932



Page: 1

January 13, 2025






Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688912
25100038-01	PB07A	Piggyback	15	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:35  
ID:3Ryt8403H6K4r2MujCZL5fzwnQX-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

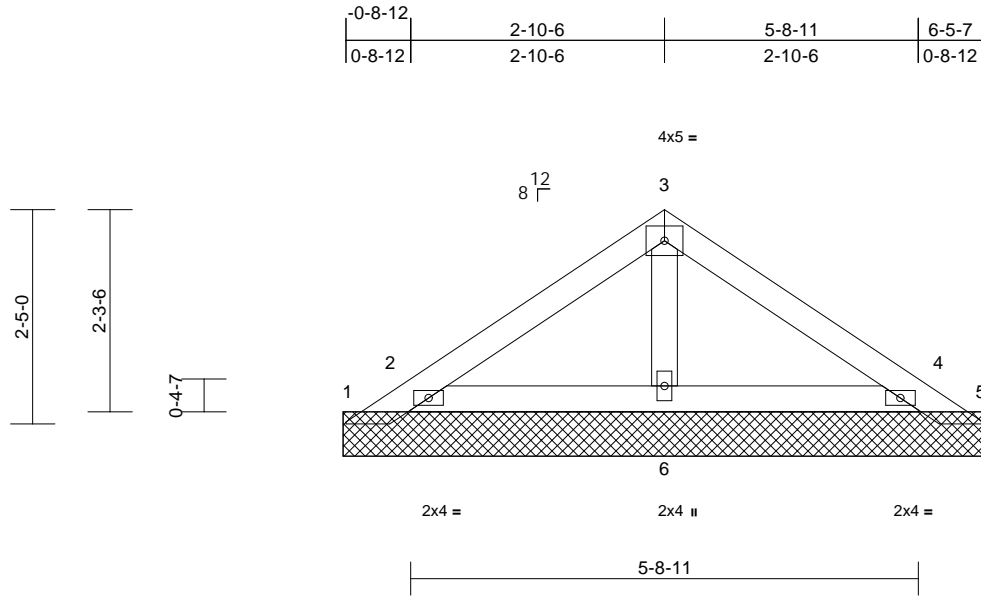

Scale = 1:26

Loading	(psf)	Spacing	2-0-0	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.20	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.07	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.02	Horiz(TL)	0.00	4	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 24 lb	FT = 20%

#### LUMBER

TOP CHORD	2x4 SP No.2
BOT CHORD	2x4 SP No.2
OTHERS	2x4 SP No.3

#### BRACING

TOP CHORD	Structural wood sheathing directly applied or 6-0-0 oc purlins.
BOT CHORD	Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size)	1=7-2-15, 2=7-2-15, 4=7-2-15, 5=7-2-15, 6=7-2-15
Max Horiz	1=-52 (LC 10)
Max Uplift	1=-144 (LC 21), 2=-94 (LC 14), 4=-86 (LC 15), 5=-141 (LC 22)
Max Grav	1=66 (LC 14), 2=413 (LC 21), 4=401 (LC 22), 5=46 (LC 15), 6=175 (LC 22)

#### FORCES

(lb) - Maximum Compression/Maximum Tension	
TOP CHORD	1-2=-69/123, 2-3=-110/67, 3-4=-110/67, 4-5=-44/110
BOT CHORD	2-6=-44/41, 4-6=-44/41
WEBS	3-6=-91/21

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-3-5 to 3-3-5, Exterior(2R) 3-3-5 to 3-11-10, Exterior(2E) 3-11-10 to 6-11-10 zone; cantilever left and right exposed ; end vertical left and right exposed;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60

- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 4-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 144 lb uplift at joint 1 and 141 lb uplift at joint 5.
- N/A

- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

**LOAD CASE(S)** Standard



January 13,2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932




Job	Truss	Truss Type	Qty	Ply	29 Hidden Lakes North-Roof-Plan 10 GLH	170688913
25100038-01	PB07	Piggyback	2	1	Job Reference (optional)	

Carter Components (Sanford, NC), Sanford, NC - 27332,

Run: 8.73 S Dec 5 2024 Print: 8.730 S Dec 5 2024 MiTek Industries, Inc. Fri Jan 10 11:46:34  
ID:wjKFBa?RoBnOpc07UozVw1zwnLO-RfC?PsB70Hq3NSgPqnL8w3uITXbGKWrCDoi7J4zJC?f

Page: 1

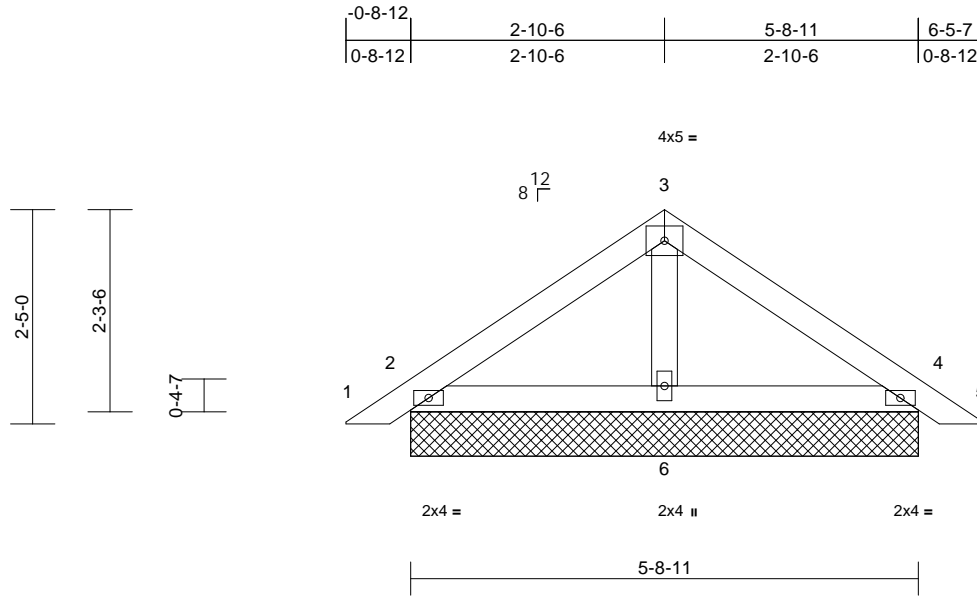

Scale = 1:26

Loading	(psf)	Spacing	1-11-4	CSI	DEFL	in	(loc)	l/defl	L/d	PLATES	GRIP
TCLL (roof)	20.0	Plate Grip DOL	1.15	TC	0.14	n/a	-	n/a	999	MT20	244/190
Snow (Pf)	20.0	Lumber DOL	1.15	BC	0.15	n/a	-	n/a	999		
TCDL	10.0	Rep Stress Incr	YES	WB	0.02	Horz(CT)	0.00	2	n/a		
BCLL	0.0*	Code	IRC2021/TPI2014	Matrix-MP							
BCDL	10.0									Weight: 24 lb	FT = 20%

#### LUMBER

TOP CHORD 2x4 SP No.2  
BOT CHORD 2x4 SP No.2  
OTHERS 2x4 SP No.3

#### BRACING

TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

#### REACTIONS

(size) 2=5-8-11, 4=5-8-11, 6=5-8-11  
Max Horiz 2=-51 (LC 12)  
Max Uplift 2=-30 (LC 14), 4=-36 (LC 15)  
Max Grav 2=218 (LC 21), 4=218 (LC 22), 6=200 (LC 22)

#### FORCES

(lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-2=0/24, 2-3=-114/74, 3-4=-114/74, 4-5=0/24

BOT CHORD 2-6=-13/48, 4-6=-3/48

WEBS 3-6=-87/18

#### NOTES

- Unbalanced roof live loads have been considered for this design.
- Wind: ASCE 7-16; Vult=130mph (3-second gust) Vasd=103mph; TCDL=6.0psf; BCDL=6.0psf; h=25ft; Cat. II; Exp B; Enclosed; MWFRS (envelope) exterior zone and C-C Exterior(2E) 0-3-5 to 3-3-5, Exterior(2R) 3-3-5 to 3-11-10, Exterior(2E) 3-11-10 to 6-11-10 zone; cantilever left and right exposed; end vertical left and right exposed; C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.

- TCLL: ASCE 7-16; Pr=20.0 psf (roof LL: Lum DOL=1.15 Plate DOL=1.15); Pf=20.0 psf (Lum DOL=1.15 Plate DOL=1.15); Is=1.0; Rough Cat B; Fully Exp.; Ce=0.9; Cs=1.00; Ct=1.10
- Unbalanced snow loads have been considered for this design.
- This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 20.0 psf on overhangs non-concurrent with other live loads.
- Gable requires continuous bottom chord bearing.
- Gable studs spaced at 2-0-0 oc.
- This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-06-00 tall by 2-00-00 wide will fit between the bottom chord and any other members.
- N/A

- See Standard Industry Piggyback Truss Connection Detail for Connection to base truss as applicable, or consult qualified building designer.

LOAD CASE(S) Standard



January 13, 2025

**WARNING - Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473 rev. 1/2/2023 BEFORE USE.**

Design valid for use only with MiTek® connectors. This design is based only upon parameters shown, and is for an individual building component, not a truss system. Before use, the building designer must verify the applicability of design parameters and properly incorporate this design into the overall building design. Bracing indicated is to prevent buckling of individual truss web and/or chord members only. Additional temporary and permanent bracing is always required for stability and to prevent collapse with possible personal injury and property damage. For general guidance regarding the fabrication, storage, delivery, erection and bracing of trusses and truss systems, see **ANSI/TPI1 Quality Criteria and DSB-22** available from Truss Plate Institute (www.tpinst.org) and **BCSI Building Component Safety Information** available from the Structural Building Component Association (www.sbcacompnents.com)

ENGINEERING BY  
**TRENCO**  
A MiTek Affiliate

818 Soundside Road  
Edenton, NC 27932



# Symbols

## PLATE LOCATION AND ORIENTATION



\* Plate location details available in MITek software or upon request.

## PLATE SIZE

**4 X 4**

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T or I bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number/letter where bearings occur. Min size shown is for crushing only.

## Industry Standards:

ANSI/TP1: National Design Specification for Metal Plate Connected Wood Truss Construction.  
DSB-22: Building Component Safety Information, Guide to Good Practice for Handling, Installing, Restraining & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

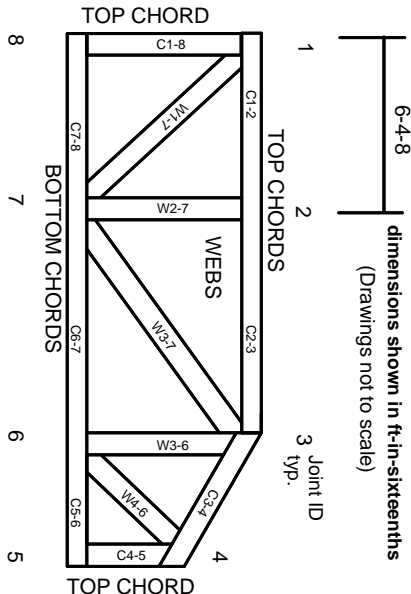

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

# Product Code Approvals

ICC-ES Reports:

ESR-1988, ESR-2362, ESR-2685, ESR-3282  
ESR-4722, ESL-1388

# Design General Notes

Trusses are designed for wind loads in the plane of the truss unless otherwise shown.

Lumber design values are in accordance with ANSI/TP1 1 section 6.3. These truss designs rely on lumber values established by others.

© 2023 MITek® All Rights Reserved

# General Safety Notes

**Failure to Follow Could Cause Property Damage or Personal Injury**

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative Tor I bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by ANSI/TP1 1.
7. Design assumes trusses will be suitably protected from the environment in accord with ANSI/TP1 1.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with ANSI/TP1 1 Quality Criteria.
21. The design does not take into account any dynamic or other loads other than those expressly stated.

**MITek**

ENGINEERING BY  
**TRENCO**  
A MITek Affiliate

MITek Engineering Reference Sheet: MII-7473 rev. 1/2/2023





Customer:  
Street 1:  
City:  
Customer Ph...

Job Name: **01**  
Level: **1st FLOOR**  
Label: **DB1-2 - i52**  
Type: **Beam**


**2 Ply Member**  
**2.1 RigidLam SP LVL 1-3/4**  
**x 11-7/8**

Status:  
**Design**  
**Passed**

Illustration Not to Scale. Pitch: 0/12

Designed by Single Member Design Engine in MiTek® Structure Version  
8.7.3.303.Update13.26

Report Version: 2023.09.18 10/10/2025 09:21

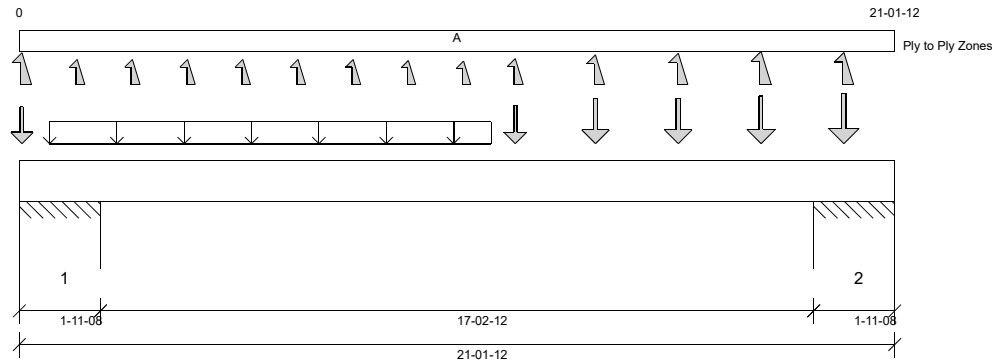

#### DESIGN INFORMATION a

Building Code: IRC 2021  
Design Methodology: ASD  
Risk Category: II (General Construction)  
Residential  
Service Condition: Dry  
System Spacing: -  
LL Deflection Limit: L/360, 0.75" (absolute)  
TL Deflection Limit: L/240, 1.00" (absolute)

#### Lateral Restraint Requirements:

Both ends of the member and the outer supports must be laterally restrained. Top and bottom edges of the member must be fully restrained or have the following maximum unbraced length:

Top: 1'- 10 1/2" Bottom: 20'- 6 3/4"

#### Bearing Stress of Support Material:

- 725 psi Wall @ 0'- 1 1/2"
- 725 psi Wall @ 1'- 10"
- 725 psi Wall @ 19'- 3 3/4"
- 725 psi Wall @ 21'- 1/4"

#### ANALYSIS RESULTS

Design Criteria	Location	Load Combination	LDF	Design	Limit	Result
Max Pos. Moment:	10'- 8 3/4"	D + S	1.15	2378 lb ft	24315 lb ft	Passed - 10%
Max Neg. Moment:	19'- 3 3/4"	D + S	1.15	3973 lb ft	17567 lb ft	Passed - 23%
Max Shear:	18'- 2 3/8"	D + S	1.15	1380 lb	9241 lb	Passed - 15%
Live Load (LL) Pos. Defl.:	10'- 6 7/8"	S		0.051"	L/360	Passed - L/999
Total Load (TL) Pos. Defl.:	10'- 6 13/16"	D + S		0.090"	L/240	Passed - L/999

#### SUPPORT AND REACTION INFORMATION

ID	Input Bearing Length	Controlling Load Combination	LDF	Downward Reaction	Uplift Reaction	Resistance of Member	Resistance of Support	Result
1	8-04	0.6D + 0.6W	1.60	436 lb		30130 lb	20934 lb	Passed - 2%
1	8-04	D + Lr	1.15		-2049 lb	-	-	
1	1-03-04	D + S	1.15	3872 lb		40031 lb	38697 lb	Passed - 10%
1	1-03-04	0.6D + 0.6W	1.60		-978 lb	-	-	
2	1-03-04	D + S	1.15	3967 lb		40031 lb	38697 lb	Passed - 10%
2	1-03-04	0.6D + 0.6W	1.60		-960 lb	-	-	
2	8-04	0.6D + 0.6W	1.60	536 lb		30130 lb	20934 lb	Passed - 3%
2	8-04	D + S	1.15		-2183 lb	-	-	

#### LOADING

Type	Start Loc	End Loc	Source	Face	Dead (D)	Live (L)	Snow (S)	Roof Live (Lr)	Wind (W)
Self Weight	0'	21'- 1 3/4"	Self Weight	Top	11 lb/ft	-	-	-	-
Uniform	0'- 8 3/4"	11'- 4 3/4"	Smoothed Load	Top	66 lb/ft	-	54 lb/ft	78 lb/ft	23 lb/ft
Point	0'- 3/4"	0'- 3/4"	T01(c01)	Top	87 lb	-	84 lb	121 lb	36/-261 lb
Point	1'- 4 3/4"	1'- 4 3/4"	T02(c07)	Top	-	-	-	-	-171 lb
Point	2'- 8 3/4"	2'- 8 3/4"	T02(c04)	Top	-	-	-	-	-171 lb
Point	4'- 3/4"	4'- 3/4"	T02(c03)	Top	-	-	-	-	-171 lb
Point	5'- 4 3/4"	5'- 4 3/4"	T02(c05)	Top	-	-	-	-	-171 lb
Point	6'- 8 3/4"	6'- 8 3/4"	T02(c08)	Top	-	-	-	-	-171 lb
Point	8'- 3/4"	8'- 3/4"	T02(c01)	Top	-	-	-	-	-170 lb
Point	9'- 4 3/4"	9'- 4 3/4"	T02(c02)	Top	-	-	-	-	-157 lb
Point	10'- 8 3/4"	10'- 8 3/4"	T02(c06)	Top	-	-	-	-	-150 lb
Point	11'- 11 3/4"	11'- 11 3/4"	T03(c01)	Top	98 lb	-	85 lb	122 lb	36/-183 lb
Point	13'- 11"	13'- 11"	T04(c03)	Top	132 lb	-	107 lb	155 lb	46/-233 lb
Point	15'- 11"	15'- 11"	T04(c01)	Top	133 lb	-	108 lb	156 lb	46/-255 lb
Point	17'- 11"	17'- 11"	T04(c02)	Top	137 lb	-	114 lb	165 lb	49/-280 lb
Point	19'- 11"	19'- 11"	T04(c04)	Top	147 lb	-	126 lb	182 lb	54/-265 lb

#### UNFACTORED REACTIONS

ID	Start Loc	End Loc	Source	Dead (D)	Live (L)	Snow (S)	Roof Live (Lr)	Wind (W)
1	0'	1'- 11 1/2"	E13(i23)	1804/-952 lb	-	1267/-650 lb	1986/-1095 lb	436 lb/-1755 lb
==>	0'- 1 1/2"	0'- 1 1/2"	E13(i23)	-952 lb	-	-650 lb	157/-1095 lb	-
==>	1'- 10"	1'- 10"	E13(i23)	1804 lb	-	1267 lb	1829 lb	-
2	19'- 2 1/4"	21'- 1 3/4"	E5(i4)	1836/-1019 lb	-	1300/-719 lb	1938/-1098 lb	436 lb/-1755 lb
==>	19'- 3 3/4"	19'- 3 3/4"	E5(i4)	1836 lb	-	1300 lb	1877 lb	-
==>	21'- 1/4"	21'- 1/4"	E5(i4)	-1019 lb	-	-719 lb	61/-1098 lb	-

#### DESIGN NOTES

- CAUTION: The maximum net analysis reaction exceeds the user-defined maximum uplift value at one or more supports.
- The dead loads used in the design of this member were applied to the structure as projected dead loads.
- Analysis and Design has been performed using precision loading from actual modeled conditions. Some loads may have been modified to simplify reporting.





Customer:  
Street 1:  
City:  
Customer Ph...

Job Name: **01**  
Level: **1st FLOOR**  
Label: **DB1-2 - i52**  
Type: **Beam**

**2 Ply Member**  
**2.1 RigidLam SP LVL 1-3/4**  
**x 11-7/8**

Status:  
**Design**  
**Passed**

#### DESIGN NOTES

- Tributary Loads have been generated based on actual spacing between members in the model which may differ from the default system spacing. The actual loads applied to the member are shown in the Specified Loads table.
- Transfer reactions may differ from design results as allowed per building codes and standard load distribution practices.
- This report is based on modeled conditions input by the user. Source information for the loads and supports are provided for reference only. Verify that all loads and support conditions are correct.
- Review all loads and reactions to ensure that the member/bearing/connector/structure can resist adequately. Unless already specified on this report, anchorage for uplift reactions to be specified by others. Installation of member and accessories (if required) as per manufacturer's instruction.
- Beam Stability Factor used in the calculation for Allowable Max Pos Moment (CL) = 0.99

#### PLY TO PLY CONNECTION

- Zone A: Factored load = 0 plf. Use 12d (0.148"x3.25") nails. LDF = 1.00. Qty = 44. Row = 2, Spacing = 12"  
12d (0.148"x3.25") nails properties: D = 0.148" , L = 3.25". Fastener capacity = 128 lbs. X1 = 2.25" , Y1 = 0.75" , Y2 = 1.5"  
Install fasteners from one face.  
X1 = Minimum end distance, X2 = Minimum edge distance, Y2 = Minimum row spacing.

#### FASTENER INSTALLATION – 2 ROWS (FROM ONE FACE)

