CYPRESS COVE **ABBREVIATIONS** HWD HARDWOOD (FL R&M RANGE W/MICROWAY DRY DRYER MACHINE TEMP TEMPERED (GLASS U.N.O. UNLLGG OTHERWISE F.F. FINISH FLOOR (LIN OBS OBSCURE (GLA WH WATER HEATER FP FIREPLACE OPT OPTIONAL WIC WALK-IN CLOSE FURRED(ING) PEDESTAL (SINK) W/W/O WITH or WITHOU ROHND FAIL TERPROOF(ING)

GENERAL NOTES

1 - GENERAL BUILDING & DESIGN REQUIREMENTS

THE ATTACHED PLANS & SPECIFICATIONS ARE THE SOLE PROPERTY OF TRI POINTE HOMES ANY UNAUTHORIZED USE OF THESE PLANS WITHOUT PRIOR WRITTEN CONSENT OF TRI POINTE HOMES IS STRICTLY

2) TRI POINTE HOMES DESIGNS & BUILDS HOUSING AS SET FORTH BY THE FORMAT AND PROVISIONS OF TH INTERNATIONAL RESIDENTIAL CODE (IRC), AND THE NATIONAL ELECTRIC CODE (NEC). ANY NON-CONFORMING DOCUMENTS DISCOVERED BY THE CONTRACTOR OR HIS AGENTS SHALL BE CALLED TO THE IMMEDIATE ATTENTION OF TRI POINTE HOMES BY CALLING (469)329-0470.

) THESE PLANS ARE SUBJECT TO MODIFICATIONS TO MEET CODE REQUIREMENTS AND/OR TO FACILITATE MECHANICAL/ ELECTRICAL/ PLUMBING INSTALLATION AND/ OR TO IMPLEMENT DESIGN IMPROVEMENTS. ANY

INTENTION TO MODIFY THESE PLANS MUST BE APPROVED IN WRITING BY TRI POINTE HOMES
4) CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL DIMENSIONS AFFECTING CONTRACTOR'S PRODUCTS, INSTALLATIONS, OR FABRICATIONS IN THE FIELD PRIOR TO EXPEDITING THE CONSTRUCTION OF SUCH WORK. FIELD VERIFY ALL DIMENSIONS — DO NOT SCALE DRAWINGS!! CONTRACTOR IS RESPONSIBLE FOR SURVEYING THE PROJECT AND BECOMING FAMILIAR WITH THE EXISTING CONDITIONS AND SCOPE OF WORK INCLUDING BUT NOT LIMITED TO SITE AND SOIL BEARING CONDITIONS.
5) ERRORS AND OMISSIONS WHICH MAY OCCUR IN THE CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE

ATTENTION OF THE ARCHITECT, IN WRITING, AND WRITTEN INSTRUCTION SHALL BE OBTAINED PRIOR TO PROCEEDING WITH CONSTRUCTION. THE CONTRACTOR SHALL BE HELD RESPONSIBLE FOR ANY ERRORS, DISCREPANCIES, OR OMISSIONS FOR WHICH THE CONTRACTOR FAILED TO NOTIFY THE ARCHITECT PRIOR TO

2 - SITE CONSTRUCTION

BACK FILL SHALL BE FREE FROM VEGETATION AND CONSTRUCTION DEBRIS

) BACK FILL SHALL BE PLACED IN LIFTS AND COMPACTED IN SUCH A MANNER AS BACKFILL TO NOT DAM THE FOUNDATION WALLS OR ANY WATERPROOFING/ DAMPPROOFING MATERIALS.

3 - CONCRETE

1) SLOPE ON GARAGE SLAB SHALL BE 1/8" PER FOOT TOWARDS VEHICLE DOOR. SLOPE ON PORCH AND

ALL EXTERIOR BRICK MUST MEET ASTM C-216 FOR "SW" CONDITIONS

) MASONRY VENEER SHALL BE ATTACHED TO SUPPORTING WALLS w/ CORRUGATED METAL TIES IN CCORDANCE WITH R703.7.4.1 - I.R.C. OR LOCAL CODE REQUIREMENTS

) WEEPHOLES SHALL BE PROVIDED ALONG THE OUTSIDE WYTHE OF EXTERIOR MASONRY WALLS AT 33" O.C. MAX, SHALL BE A MIN. OF 3/16" IN DIAMETER, AND LOCATED IMMEDIATELY ABOVE THE FLASHING PER 18703.7.6 – LR.C.

5 - METALS

6 - WOOD AND PLASTICS

7 - THERMAL & MOISTURE PROTECTION

) Fire stopping and/ or draft stopping shall meet the requirements of IRC R602.8. 2) Attic ventilation shall be provided at 1/300 th of the Area of the Space ventilated. Cross VANILATION WITH HALF OF THE VENTILATED AREA SHALL BE PROVIDED BY ROOF VENTS AND THE OTHER HALF BY SOFFIT VENTS. VENTS SHALL BE PLACED SO AS TO NOT ALLOW INFILTRATION OF RAIN OR SNOW.) PROVIDE APPROVED TILE BACKER DRYWALL FOR ALL SHOWER AND BATH SPACE) PROVIDE ATTIC VENTILATION PER IRC-R806.1

8 - DOORS AND WINDOWS

-) REVIEW ALL WINDOW HDR HEIGHTS PER PLATE HT. AND VERIFY W/ ELEVATIONS AND CORNICE DETAILS TEMPERED GLASS SHALL BE USED IN HAZARDOUS AREAS AS DESCRIBED IN SECTION R308.4 - LR.C.
- FRONT DOOR WIDTH PER IRC-R311.3
- GARAGE DOOR PER IRC-R309.1

FMERGENCY EGRESS SHALL MEET REQUIREMENTS OF SECTION R310 - LR C 2018 - SLEEPING ROOMS HALL HAVE AT LEAST ONE EGRESS OPENING OF NOT LESS THAN 5.7 SF AND A CLEAR OPENING OF NOT IFSS THAN 20" WIDE X 24" HIGH AND SHALL NOT BE MORE THAN 44" ABOVE THE FLOOR

15 - MECHANICALS

WOOD BUILT CHIMNEYS AND FIREPLACES SHALL BE INSTALLED PER MANUFACTURER'S INSTRUCTIONS AND EXTERIOR AIR INTAKE FOR COMBUSTION AIR PER IRC SECTION AS REQUIRED BY LOCAL MUNICIPALITY

ALL FLECTRICAL INSTALLATION SHALL MEET THE REQUIREMENTS OF THE NATIONAL ELECTRIC CODE (NEC) MATERIAL AND EQUIPMENT SHALL BEAR THE LABEL OF APPROVAL OF THE UNDERWRITERS ABORATORIES, INC.

) ELECTRICAL CONTRACTOR SHALL VERIFY SPACE REQUIRED FOR METER INSTALLATION BEFORE ONSTRUCTION AND SHALL NOTIFY GENERAL CONTRACTOR OF ANY DISCREPANCIES.

VERIFY LOCATION OF ALL RECEPTACLES FOR APPLIANCES WITH MANUFACTURER SPECIFICATIONS. GROUND FAULT INTERRUPTS SHALL BE LOCATED PER THE NEC

ALL SWITCHES SHALL BE INSTALLED AT 3'-6" ABOVE FINISHED FLOOR TO CENTERLINE OF SWITCH

VLESS NOTED OTHERWISE) ALL CONVENIENCE OUTLETS SHALL BE INSTALLED W/ CENTERLINE OF OUTLET LOCATED 1'-3" ABOVE INISHED FLOOR UNLESS NOTED OTHERWISE

ALL CONVENIENCE OUTLETS WITH SWITCHES TO BE SWITCH AT TOP ONLY.

ALL EXTERIOR WALL BRACKET FIXTURES SHALL BE INSTALLED AS NOTED ON PLANS.

APPROVED SMOKE DETECTORS SHALL BE LOCATED ON EVERY STORY OF THE DWELLING UNIT AS PER IRC CTION R317 (SEE SHEET B1.1 FOR LOCATIONS). WHERE MORE THAN ONE DETECTOR IS REQUIRED THEY SHALL BE INTERCONNECTED. POWER SOURCE SHALL BE BUILDING POWER w/ BATTERY BACKUP.)) CONDUCTORS SHALL BE OF COPPER.

GENERAL FRAMING SPECS AND CONSTRUCTION NOTES STAIRS:

1) THE MAXIMUM RISER HEIGHT SHALL BE 7 3/4 INCHES AND THE MINIMUM TREAD DEPTH SHALL BE 10

HANDRAILS HAVING MINIMUM AND MAXIMUM HEIGHTS OF 34 INCHES AND 38 INCHES SHALL BE OVIDED ON AT LEAST. ONE SIDE OF STAIRWAYS IN ACCORDANCE WITH SECTION R315.1 — I.R.C HANDRAIL AND BALUSTRADE (WHERE PRESENT) SHALL BE CONSTRUCTED ACCORDING TO IRC. ALL REQUIRED HAND RAILS SHALL BE CONTINUOUS THE FULL LENGTH OF THE STAIRS W/ 2 OR MORE SERS FROM A POINT ABOVE THE THE TOP RISER OF A FLIGHT TO A POINT ABOVE THE LÓWEST RISER OF THE FLIGHT. ENDS SHALL BE RETURNED OR SHALL TERMINATE AT NEWEL POSTS OR SAFETY TERMINALS. ANDRAILS ADJACENT TO A WALL SHALL HAVE A SPACE OF NOT LESS THAN 1.5" BETWEEN THE WALL

WALLS:

) ALL DIMENSIONS ARE FROM FACE OF STUD TO FACE OF STUD. ALL STUDS ARE 3 1/2" UNLESS NOTED. LL DIMENSIONS PRESENTED HERE ARE FRAME. DIMENSIONS ONLY.

I SEPARATION BETWEEN THE RESIDENCE AND THE GARAGE SHALL BE MAINTAINED BY INSTALLATION OF $rac{1}{2}"$ GYPSUM BOARD ON ALL COMMON WALLS. 2-STORY HOMES REQUIRE 5/8" TYPE X GYPSUM BOARD AT CARAGE CEILINGS WHERE HABITABLE ROOMS ARE PRESENT ABOVE.

FLOORS:

STRUCTURAL FLOOR MEMBERS SHALL NOT BE CUT, BORED, OR NOTCHED IN EXCESS OF THE LIMITATIONS

) THE ENDS OF EACH JOIST, BEAM, OR GIRDER SHALL HAVE NOT LESS THAN 1.5 INCHES OF BEARING ON WOOD OR METAL AND NOT LESS THAN 3 INCHES ON MASONRY OR CONCRETE OR AS OTHERWISE SPECIFIED

) ALL DIMENSIONAL FLOOR JOISTS TO BE PER ENGINEER STRUCTURAL PLANS.

FRAMING:

ALL FRAMING DIMENSIONS TO FACE OF MEMBER.

ALL BEARING HEADERS TO BE PER ENGINEERING PLANS. FIRE STOPPING AND / OR DRAFT STOPPING SHALL MEET THE REQUIREMENTS OF IRC R602.8.

ROOF

) HIP AND VALLEY RAFTERS SHALL BE SUPPORTED AT RIDGE DOWN TO BEARING PARTITION, CUT ENDS OF RAFTERS SHALL BE FULLY SUPPORTED WALL AND RIDGE

REQUIRED VENTILATION AREAS CALCULATED AT 1/300 RATIO

SQUARE FOOTAGE

Elevation "A"

(Slab S.F.)		
Slab Area	Sq. Ft	
FIRST FLOOR	1767	
2 BAY GARAGE	428	
PORCH	172	
COVERED OUTDOOR LIVING	153	
Total Slab Area	2520	

(Outside of Frame S.F.)		
A/C Area	Sq. Ft.	
FIRST FLOOR	1767	
Total A/C Area	1767	
Non-A/C Area	Sq. Ft.	
2 BAY GARAGE	428	
PORCH	172	
COVERED OUTDOOR LIVING	153	
Total Non-A/C Area	753	

(Inside of Frame S.F.)	
C Area	Sq. Ft.
RST FLOOR	1718
otal A/C Area	1718



NON-GARAGE SIDE

BUILDING CODE COMPLIANCE

LECTRICAL PLANS DESIGNED TO MEET OR EXCEED MINIMUM

CONSTRUCTION PLANS DESIGNED TO MEET OR EXCEED

TABLE OF CONTENTS

	SHEET LEGEND
SHEET NO.	TYPE OF SHEET/LAYOUT
"G0.01"	COVER SHEET & GEN. NOTES
"G0.11"	REVISIONS & SYMBOLS
"S1.10A"	BASE FOUNDATION PLAN - ELEVATION 'A'
"A1.10A"	FIRST FLOOR PLAN - ELEVATION 'A'
"01.A10"	FLOOR PLAN OPTIONS
"01.A20"	2ND FLOOR PLAN OPTION
"A2.01A"	EXTERIOR ELEVATIONS - 'A'
"A2.02A"	EXTERIOR ELEVATIONS - 'A'
"A2.03A"	EXTERIOR ELEVATIONS OPTION - 'A'
"A2.04A"	EXTERIOR ELEVATIONS OPTION - 'A'
"A3.01A"	ROOF PLAN — ELEVATION 'A'
"A4.01"	INTERIOR DETAIL SHEET
"E1.10A"	1ST FLR. ELECTRICAL PLAN - ELEVATION 'A'
"E1.11A"	1ST FLR. ELECTRICAL PLAN UPGRADE OPTIONS — ELEVATION 'A'
"01.E10"	1ST FLR. ELECTRICAL PLAN OPTIONS
"01.E20"	2ND FLR. ELECTRICAL PLAN OPTION
"01.E11"	1ST FLR. ELECTRICAL PLAN UPGRADE OPTIONS
"01.E21"	2ND FLR. ELECTRICAL PLAN UPGRADE OPTION
"D1.0"	DETAILS
"D2.0"	GRAB BAR PARTIAL PLANS

Lot 370

5920-04 Cypress Cove **Elevation A**

Right-Hand Garage

*Opt. Gourmet Kitchen 1

*Opt. Primary Bath 1

*Opt. Fireplace at Great Room

*Opt. Door From Primary W.I.C. to Laundry


*Opt. Screened Covered Outdoor Living

*Opt. Outdoor Living Patio

*Opt. Exterior Gas Stub Out

*Opt. Fire-Rated Garage Side

*Opt. Fire-Rated Non-Garage Side

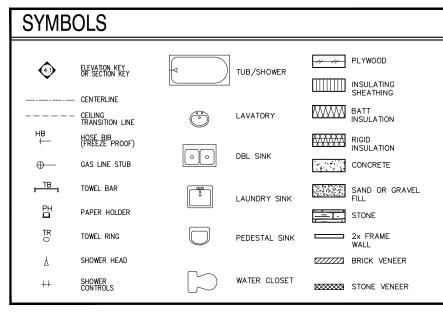

DointeHOMES

BWd Business Operation 5440 Wade Park Blv Suite 400 Raleigh, NC 27607

GENERAL ઝ

SHE

SUBDIVISION: ALTIS AT ADDRESS: LOT: 370

10-13-24 Issue Date: ACC

5920 - 04

CYPRESS COVE

G0.01

	REVISION INDEX		
REL. #	DESCRIPTION	DATE	DRAWN BY
5920-04	NEW PLAN ADDED ATTIC PULL-DOWN, REVISED ROD/SHELF IN PRIMARY WIC, ADDED OPTIONS - SCREENED COVERED OUTDOOR LIVING, GOURMET KITCHEN KITCHEN, ZERO ENTRY SHOWER AT PRIMARY BATH, ADDED TRIM SURROUNDING VENTS AT VARIOUS ELEVATIONS, REVISED BENCH DETAIL,	10/13/2024 01/19/2025	ACC ACC
	— ADDED OPT. LAUNDRY CABINETS, ADDED (2) 4-LED LIGHTS IN GARAGE, REVISED ELECT LIGHTING AND SWITCHÉS IN PRIMARY BATH, ADDED DISHWASHER ACCESSIBLE DISCONNECT SWITCH AND COUNTER-TOP AIR SWITCH FOR DISPOSAL NOTES. ADDED SHOWER NICHE MOTE, ADDED CURB TO SHOWERS, REVISED INT/EXT FIREPLACE DEPTHS, REVISED OPENING HEADER HEIGHTS THROUGHOUT, REVISED REAR EXTERIOR DOOR TO 3', REVISED DROP ZONE AREA, ADDED DOOR HEIGHTS TO MAIN FLOOR NOTES, ADDED BATH ACCESSORY HEIGHTS	04/22/2025	ACC
	TO MAIN FLOOR NOTES, ADDED ZERO ENTRY SHOWER DETAIL, REMOVED PRIMARY BATH 2 OPTION, ADDED OUTDOOR LIVING PATIO OPTION, ADDED PARTIAL SHOWER NICHE DETAIL, ADDED COURMET KITCHEN INTERIOR, REVISED ELECTRICAL / ELECTRICAL OPTION AT GREAT ROOM AND PRIMARY BATH. ADDED TYPICAL CLOSET ROD AND SHELF DETAILS, ADDED SHOWER NICHE DETAILS, REVISED PANTRY SHELVES TO 4, REMOVED KITCHEN ISLAND "TOP	07/31/2025	ACC
	SIZE" NOTE, ADDED TOWEL HOOK IN PRIMARY BATH, ADDED GABLE WINDOW DIMENSIONS, REVISED TYPICAL BENCH DETAIL, ADDED VARIOUS ELECTRICAL NOTES, ADDED SWITCHES TO OPTIONAL ELECTRICAL SHEETS,	, ,	
	ADDED OPTIONAL BEAMS IN PRIMARY SUITE, ADDED OPTIONAL GRAB BARS IN ALL BATHS, REVISED TOWEL BAR AND HOLDER HEIGHTS	09/06/2025	ACC

tri pointe.

HOMES

5440 WADE PARK BLVD, SUITE 400, RALEIGH, NG 27607

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

SUBDIVISION: ALTIS AT SERENITY
ADDRESS: 98 SHADY CREEK WAY,
LOT: 370 BLOCK:

Issue Date: 10-13-24

Drawn By: ACC

5920-04

PLAN NAME:
CYPRESS COVE

G0.11


Lot 370

5920-04 Cypress Cove

Elevation A

Right-Hand Garage

UNDER 9,000 FT² FIRE-RATED WALL
REQUIRED AT
GARAGE SIDE &
NON-GARAGE SIDE

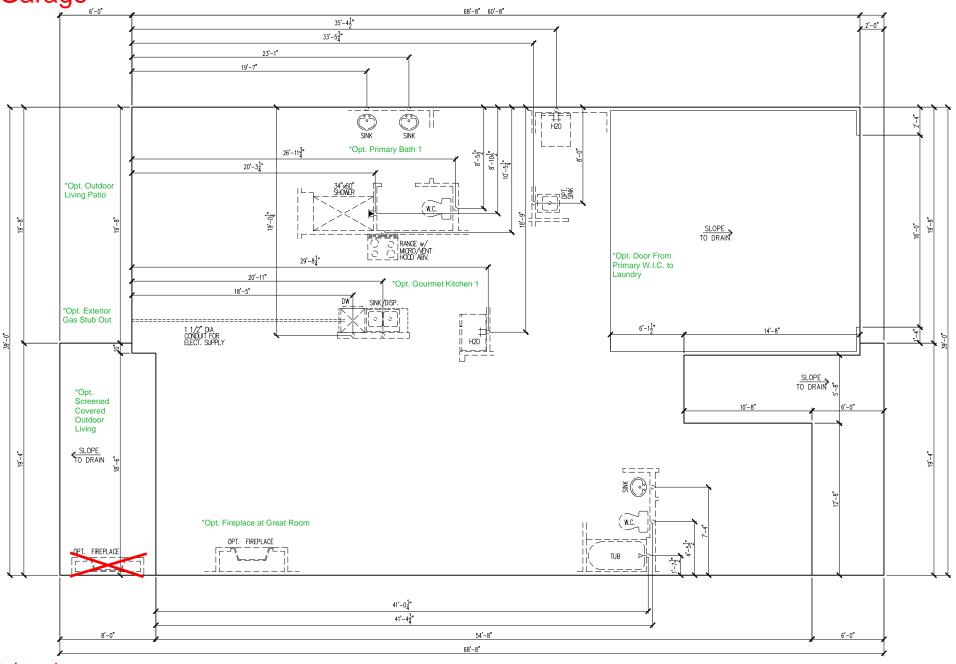

tri pointe Homes 5440 WADE PARK BLVD, SUITE 400, RALEIGH, NG 27607

> 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

UNDATION PLAN

SUBDIVISION: ALTIS AT SERENITY
ADDRESS: 98 SHADY CREEK WAY,
ADDRESS: FUQUAY-VARINA, NC 27
LOT: 370 BLOCK:

Issue Date: 10-13-24
Drawn By: ACC

PLAN #: 5920-04

CYPRESS COVE

S1.10A

*Opt. Gourmet Kitchen 1

*Opt. Primary Bath 1

*Opt. Fireplace at Great Room

*Opt. Door From Primary W.I.C. to Laundry


*Opt. Screened Covered Outdoor Living

*Opt. Outdoor Living Patio

*Opt. Exterior Gas Stub Out

*Opt. Fire-Rated Garage Side

*Opt. Fire-Rated Non-Garage Side

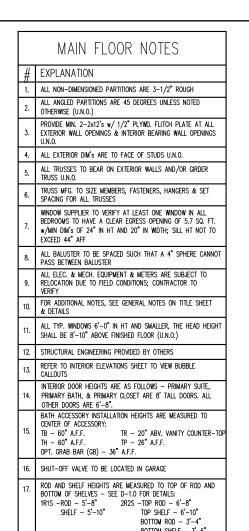

Lot 370 5920-04 Cypress Cove Elevation A Right-Hand Garage

*Opt. Gourmet Kitchen 1

*Opt. Primary Bath 1

*Opt. Fireplace at Great Room

*Opt. Door From Primary W.I.C. to Laundry

*Opt. Screened Covered Outdoor Living

*Opt. Outdoor Living Patio


*Opt. Exterior Gas Stub Out

*Opt. Fire-Rated Garage Side

*Opt. Fire-Rated Non-Garage Side

UNDER 9,000 FT² FIRE-RATED WALL
REQUIRED AT GARAGE
SIDE & NON-GARAGE SIDE

*Opt. Fire-Rated Garage Side

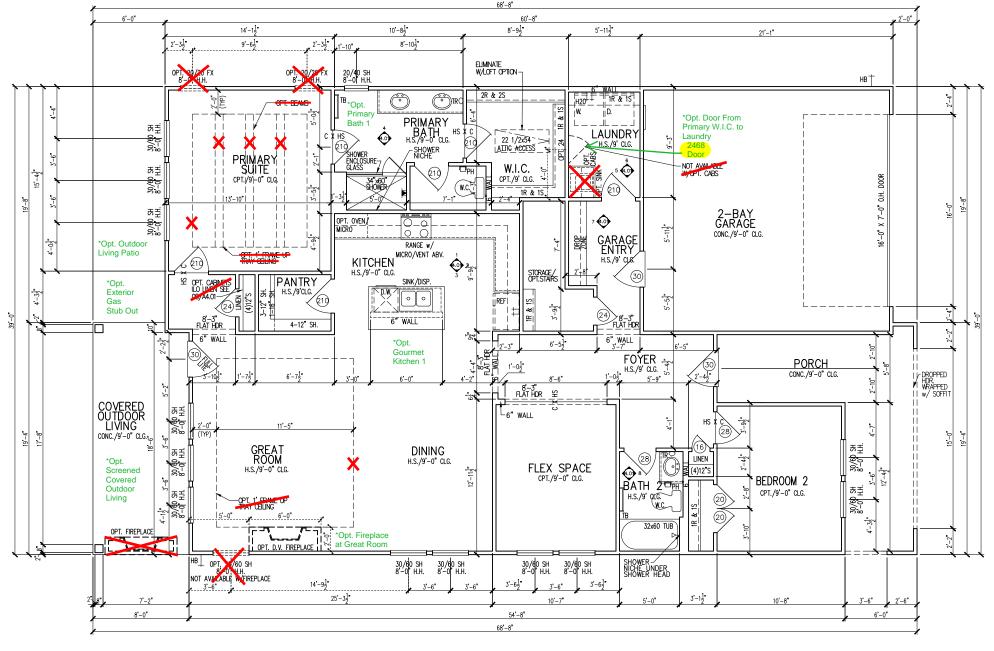

*Opt. Fire-Rated Non-Garage Side

IT Dointe S
HOMES
WADE PARK BLVD, SUITE 400, RALEIGH, NC 27607

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

SUBDIVISION: ALTIS AT SERENITY
ADDRESS: 98 SHADY CREEK WAY,
LOT: 370 BLOCK:


Issue Date: 10-13-24

Drawn By: ACC

5920-04

CYPRESS COVE

A1.10

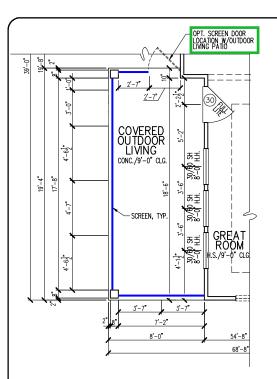

OPT. SCREENED COVERED OUTDOOR LIVING PARTIAL FLOOR PLAN

MAIN FLOOR NOTES

EXPLANATION

ALL NON-DIMENSIONED PARTITIONS ARE 3-1/2" ROUGH

OTHERWISE (U.N.O.)

PROVIDE MIN. 2-2x12's w/ 1/2" PLYWD. FLITCH PLATE AT ALL EXTERIOR WALL OPENINGS & INTERIOR BEARING WALL OPENINGS

ALL EXTERIOR DIM'S ARE TO FACE OF STUDS U.N.O.

ALL TRUSSES TO BEAR ON EXTERIOR WALLS AND/OR GIRDER TRUSS U.N.O.

TRUSS MFG. TO SIZE MEMBERS, FASTENERS, HANGERS & SET SPACING FOR ALL TRUSSES

WINDOW SUPPLIER TO VERIFY AT LEAST ONE WINDOW IN ALL BEDROOMS TO HAVE A CLEAR EGRESS OPENING OF 5.7 SQ. FT. w/MIN DIM's OF 24" IN HT AND 20" IN WIDTH; SILL HT NOT TO

ALL BALUSTER TO BE SPACED SUCH THAT A 4" SPHERE CANNO PASS BETWEEN BALUSTER

ALL ELEC. & MECH. EQUIPMENT & METERS ARE SUBJECT TO RELOCATION DUE TO FIELD CONDITIONS; CONTRACTOR TO

FOR ADDITIONAL NOTES, SEE GENERAL NOTES ON TITLE SHEET

ALL TYP, WINDOWS 6'-0" IN HT AND SMALLER. THE HEAD HEIGH SHALL BE 8'-10" ABOVE FINISHED FLOOR (U.N.O.)

STRUCTURAL ENGINEERING PROVIDED BY OTHERS

REFER TO INTERIOR ELEVATIONS SHEET TO VIEW BUBBLE CALLOUTS

INTERIOR DOOR HEIGHTS ARE AS FOLLOWS - PRIMARY SUITE, PRIMARY BATH, & PRIMARY CLOSET ARE 8' TALL DOORS. ALL OTHER DOORS ARE 6'-8".


BATH ACCESSORY INSTALLATION HEIGHTS ARE MEASURED TO CENTER OF ACCESSORY:

TB - 60" A.F.F. TH - 60" AFF TP - 26" A.F.F. OPT. GRAB BAR (GB) - 36" A.F.F.

SHUT-OFF VALVE TO BE LOCATED IN GARAGE

ROD AND SHELF HEIGHTS ARE MEASURED TO TOP OF ROD AND BOTTOM OF SHELVES — SEE D-1.0 FOR DETAILS: 2R2S -TOP ROD - 6'-8" SHELF - 5'-10"

TOP SHELF - 6'-10" BOTTOM ROD - 3'-4" BOTTOM SHELF - 3'-6"

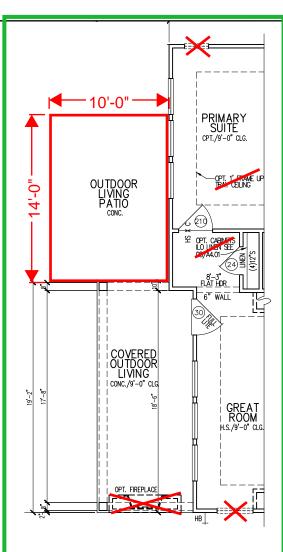

OPT. OUTDOOR LIVING PATIO PARTIAL FLOOR PLAN

COOKTOP w/

VENT ABV.

6" WALI


OPT. GOURMET 2

KITCHEN - PARTIAL

PARTIAL FLOOR PLAN

ULL DEPTH CABINET OVER FRIDGE

KITCHEN

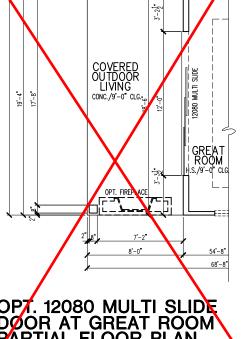


OPT. 12080 MULTI SLIDE DOOR AT GREAT ROOM PARTIAL FLOOR PLAN




OVEN/ MICRO COOKTOP w/ VENT ABV. KITCHEN €.0 SINK /DISP FULL DEPTH CABINET OVER FRIDGE 6" WALL


OPT. GOURMET 1 KITCHEN - PARTIAL PARTIAL FLOOR PLAN

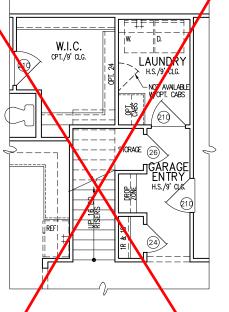


SECOND FLOOR STAIR PARTIAL FLOOR PLAN



OPT CABINETS
ILO LINEN CLOSET
PARTIAL FLOOR PLAN




OPT. OFFICE ILO FLEX SPACE PARTIAL FLOOR PLAN





OPT. DOOR FROM PRIM. W.I.C TO LAUNDRY PARTIAL FLOOR PLAN



OPT. BEDROOM 3 ILO FLEX SPACE PARTIAL FLOOR PLAN **Dointe**HOMES は

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

OPTIONS SERENITY SUBDIVISION: ALTIS AT 8 ADDRESS: FUQUAY-VAR PLAN FLOOR

ADDRESS: LOT: 370 10-13-24 Issue Date: ACC

5920-04

CYPRESS COVE

01.A10

MAIN FLOOR NOTES # EXPLANATION ALL NON-DIMENSIONED PARTITIONS ARE 3-1/2" ROUGH ALL ANGLED PARTITIONS ARE 45 DEGREES UNLESS NOTED OTHERWISE (U.N.O.) PROVIDE MIN. 2-2x12's w/ 1/2" PLYWD. FLITCH PLATE AT ALL EXTERIOR WALL OPENINGS & INTERIOR BEARING WALL OPENINGS 4. ALL EXTERIOR DIM'S ARE TO FACE OF STUDS U.N.O. ALL TRUSSES TO BEAR ON EXTERIOR WALLS AND/OR GIRDER TRUSS U.N.O. TRUSS MFG. TO SIZE MEMBERS, FASTENERS, HANGERS & SET SPACING FOR ALL TRUSSES WINDOW SUPPLIER TO VERIFY AT LEAST ONE WINDOW IN ALL BEDROOMS TO HAVE A CLEAR EGRESS OPENING OF 5.7 SQ. FT. w/MIN DIM's OF 24" IN HT AND 20" IN WIDTH; SILL HT NOT TO ALL BALUSTER TO BE SPACED SUCH THAT A 4" SPHERE CANNOT PASS BETWEEN BALUSTER ALL ELEC. & MECH. EQUIPMENT & METERS ARE SUBJECT TO RELOCATION DUE TO FIELD CONDITIONS; CONTRACTOR TO FOR ADDITIONAL NOTES, SEE GENERAL NOTES ON TITLE SHEET & DETAILS ALL TYP. WINDOWS 6'-0" IN HT AND SMALLER. THE HEAD HEIGHT 12. STRUCTURAL ENGINEERING PROVIDED BY OTHERS REFER TO INTERIOR ELEVATIONS SHEET TO VIEW BUBBLE CALLOUTS INTERIOR DOOR HEIGHTS ARE AS FOLLOWS - PRIMARY SUITE, PRIMARY BATH, & PRIMARY CLOSET ARE 8' TALL DOORS. ALL OTHER DOORS ARE 6'-8". BATH ACCESSORY INSTALLATION HEIGHTS ARE MEASURED TO CENTER OF ACCESSORY: TR - 20" ABV. VANITY COUNTER-TO TH - 60" A.F.F. TP - 26" A.F.F. OPT. GRAB BAR (GB) - 36" A.F.F. SHUT-OFF VALVE TO BE LOCATED IN GARAGE ROD AND SHELF HEIGHTS ARE MEASURED TO TOP OF ROD AND BOTTOM OF SHELVES - SEE D-1.0 FOR DETAILS: 1R1S -ROD - 5'-8" 2R2S -TOP ROD - 6'-8" SHELF - 5'-10" TOP SHELF - 6'-1 TOP SHELF - 6'-10"

Lot 370 5920-04 Cypress Cove Elevation A Right-Hand Garage

*Opt. Gourmet Kitchen 1

*Opt. Primary Bath 1

*Opt. Fireplace at Great Room

*Opt. Door From Primary W.I.C. to Laundry

*Opt. Screened Covered Outdoor Living


*Opt. Outdoor Living Patio

*Opt. Exterior Gas Stub Out

*Opt. Fire-Rated Garage Side

*Opt. Fire-Rated Non-Garage Side

UNDER 9,000 FT² - FIRE-RATED WALL REQUIRED AT GARAGE SIDE & NON-GARAGE SIDE

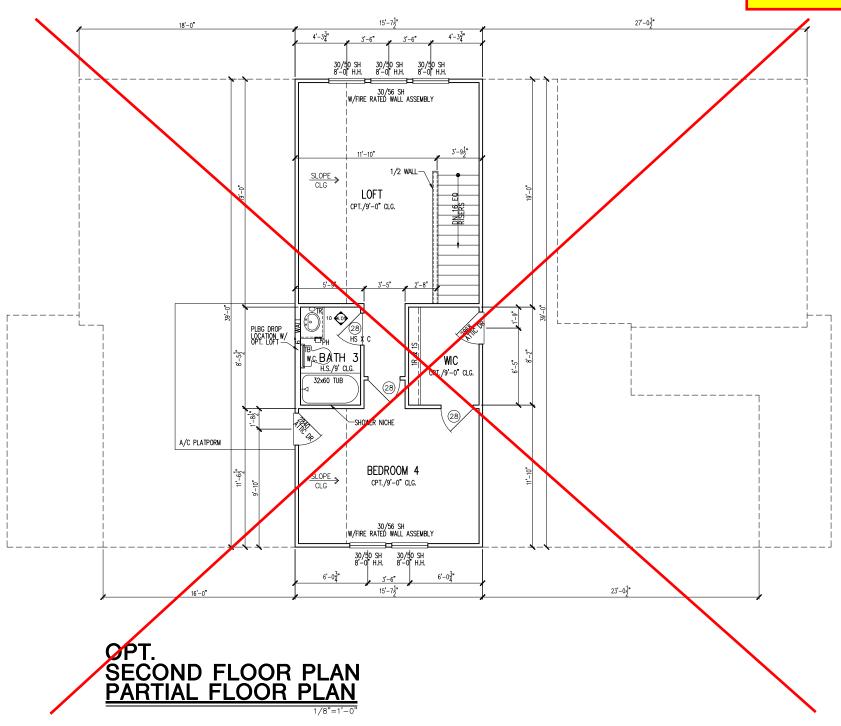

Tribointe.
HOMES
5440 WADE PARK BLVD, SUITE 400, RALEIGH, NC 27807

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

OR PLAN – OPTION
ALTIS AT SERENITY
HADY CREEK WAY,


SUBDIVISION: ALTIS AT SERENITY
ADDRESS: FUQUAY-VARINA, NC 27:
LOT: 370 BLOCK:


Issue Date: 10-13-24
Drawn By: ACC


5920-04

CYPRESS COVE

01.A20

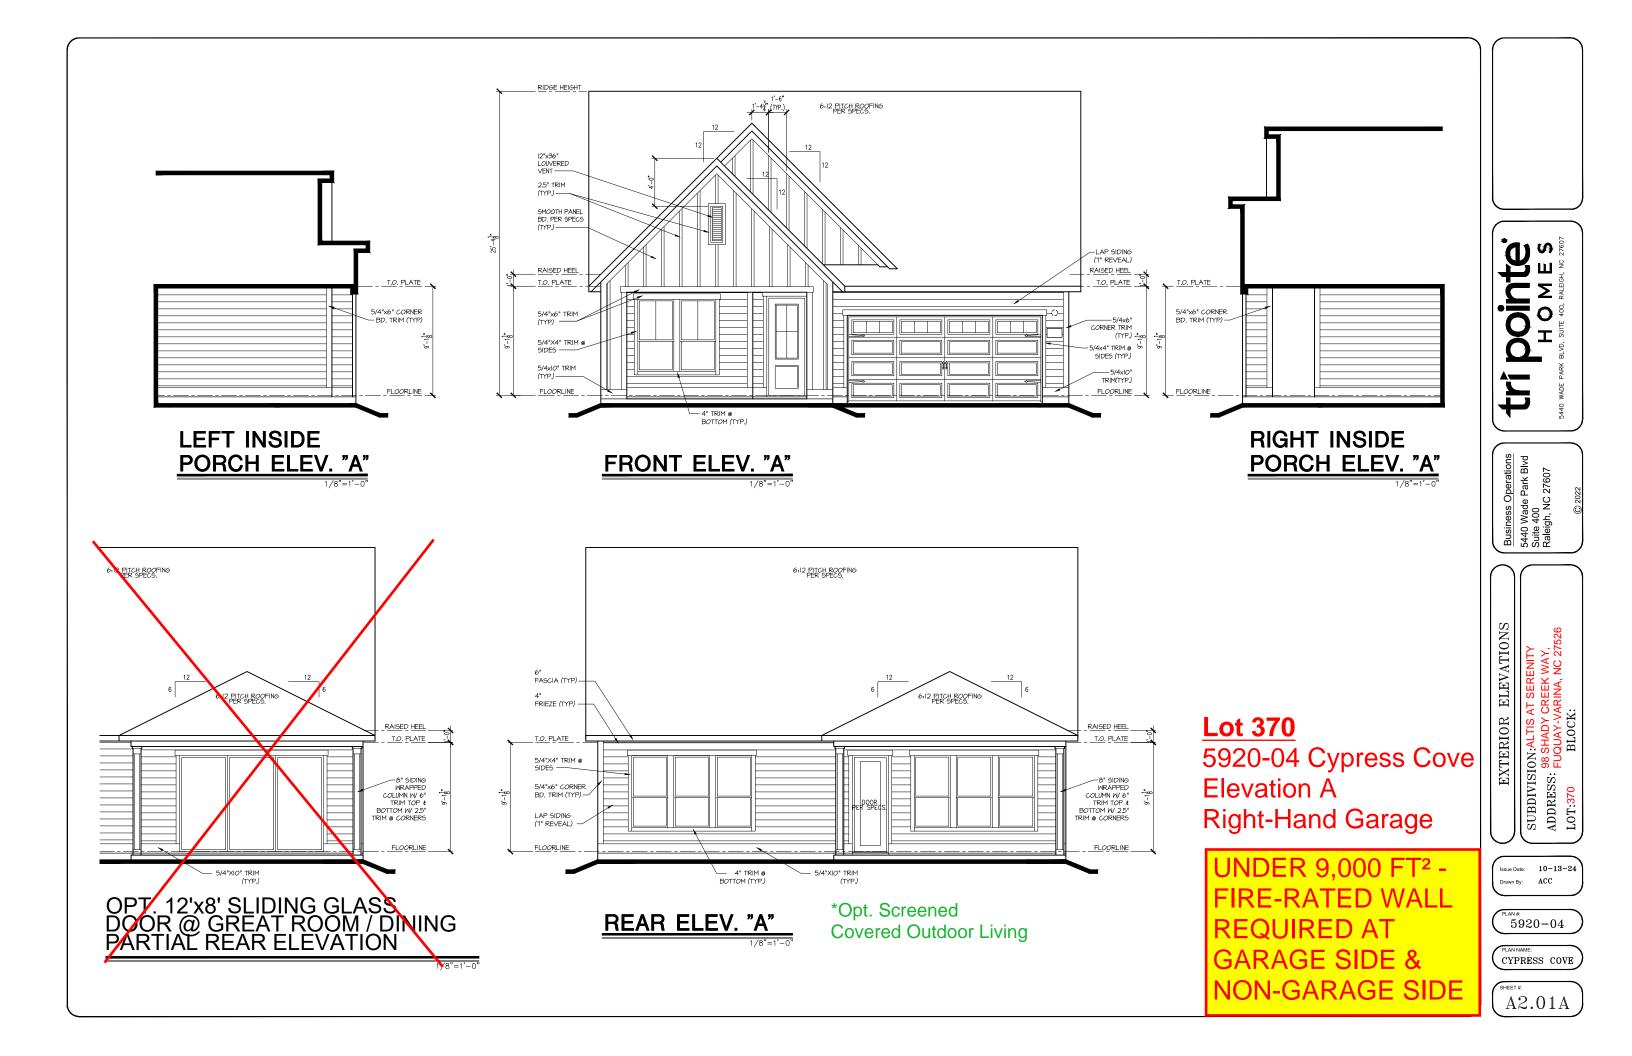

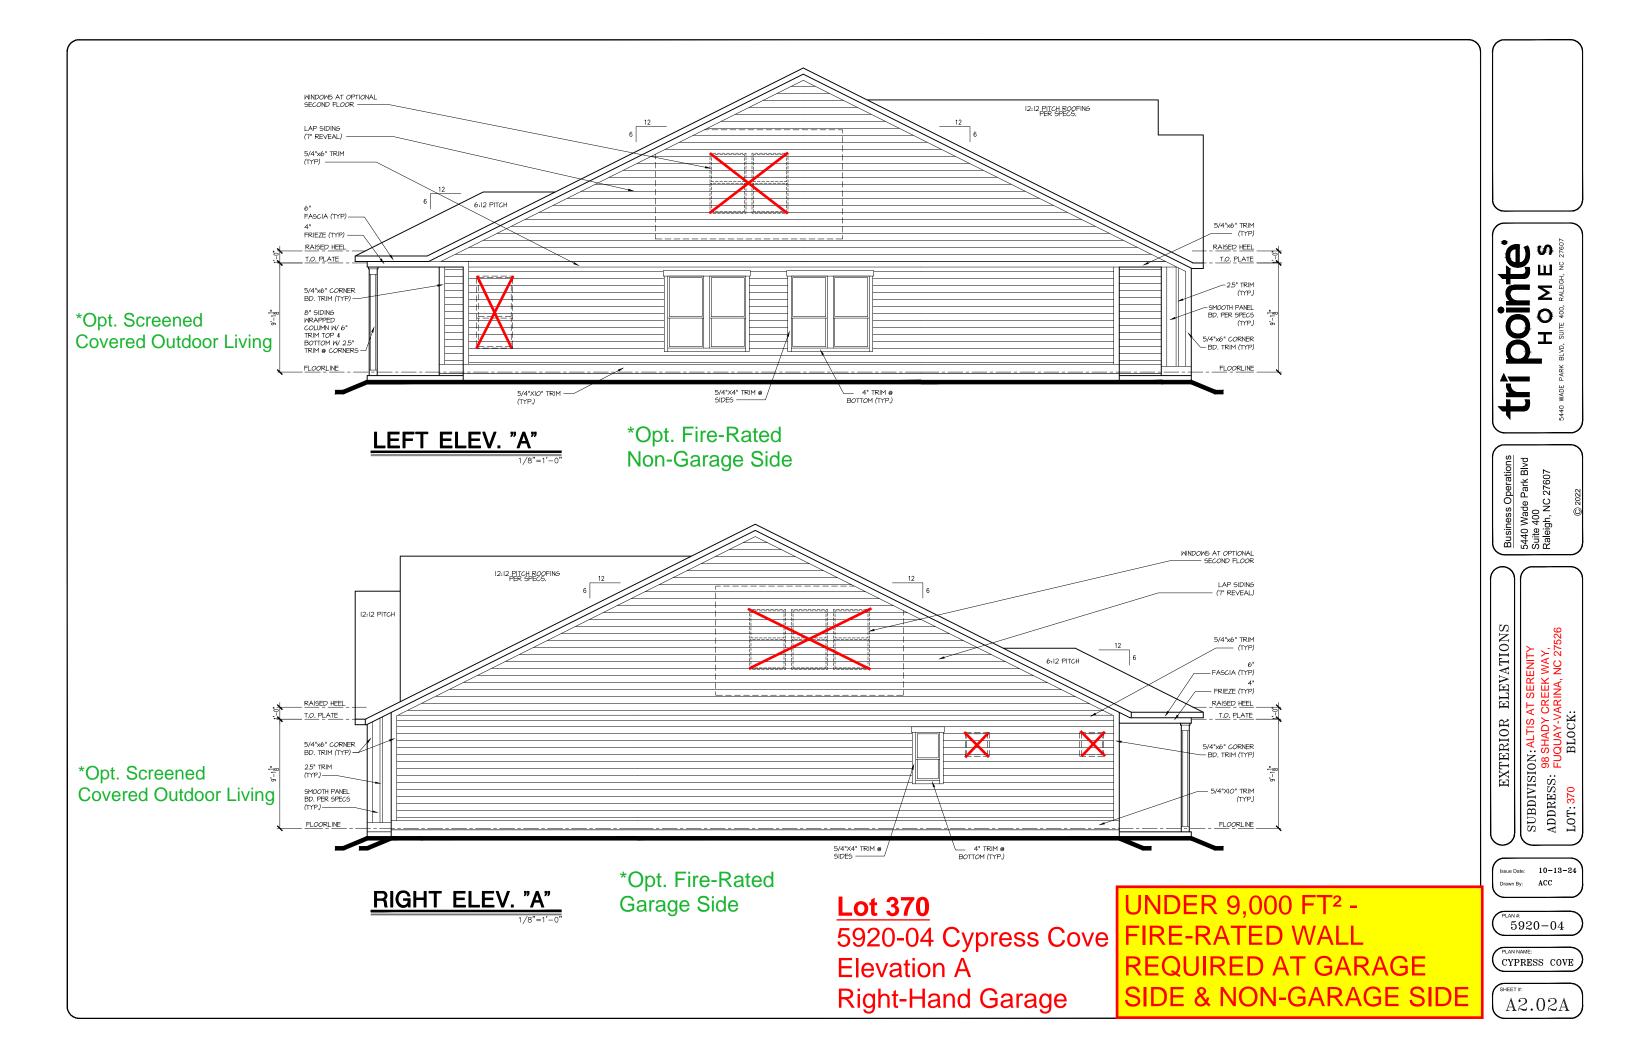

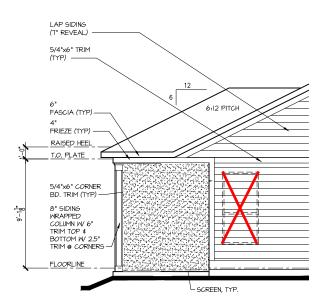


OPT. SCREENED COVERED OUTDOOR LIVING PARTIAL LEFT ELEVATION

LAP SIDING (7" REVEAL) **NON-GARAGE SIDE** 6:12 PITCH - FASCIA (TYP) – FRIEZE (TYP) RAISED HEEL T.O. PLATE 5/4"x6" CORNER

OPT. SCREENED COVERED OUTDOOR LIVING PARTIAL RIGHT ELEVATION

Lot 370 5920-04 Cypress Cove **Elevation A** Right-Hand Garage

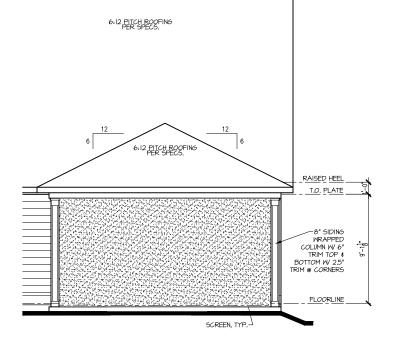

OPT. SCREENED COVERED OUTDOOR LIVING PARTIAL REAR ELEVATION

*Screens Per Manufacturer

Dointe S HOMES RR BLVD. SUITE 400. RALEIGH, NC 27607

UNDER 9,000 FT² -

FIRE-RATED WALL

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607


OPTION SUBDIVISION: ALTIS AT SERENITY
ADDRESS: 98 SHADY CREEK WAY,
FUQUAY-VARINA, NC 27
LOT: 370 BLOCK:

Issue Date: 10-13-24 ACC

5920-04

CYPRESS COVE

A2.03A

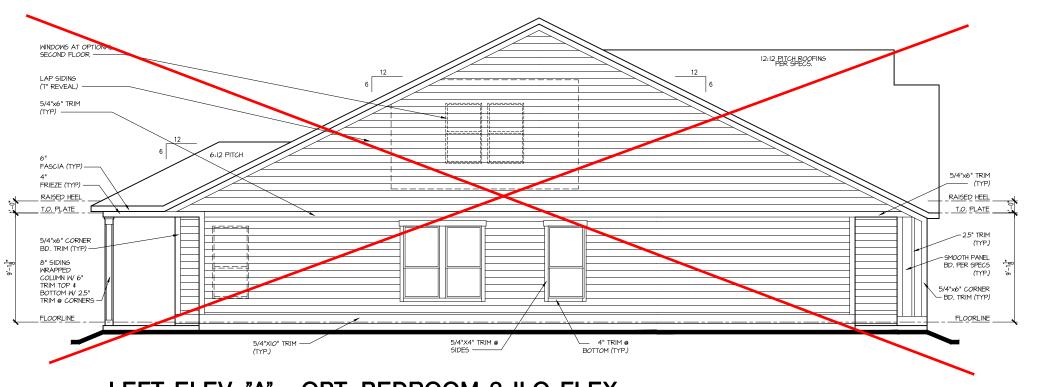

LEFT ELEV. "A" - OPT. BEDROOM 3 ILO FLEX

Lot 370
5920-04 Cypress Cove
Elevation A
Right-Hand Garage

UNDER 9,000 FT² FIRE-RATED WALL
REQUIRED AT
GARAGE SIDE &
NON-GARAGE SIDE

tri pointe HOMES

> Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

EXTERIOR ELEVATIONS OPTION
SUBDIVISION: ALTIS AT SERENITY
ADDRESS: 98 SHADY CREEK WAY,
FUQUAY-VARINA, NC 27526
LOT: 370 BLOCK:

Issue Date: 10-13-24
Drawn By: ACC


5920-04


CYPRESS COVE

A2.04A

Lot 370 5920-04 Cypress Cove FIRE-RATED WALL **Elevation A** Right-Hand Garage

UNDER 9,000 FT² -NON-GARAGE SIDE

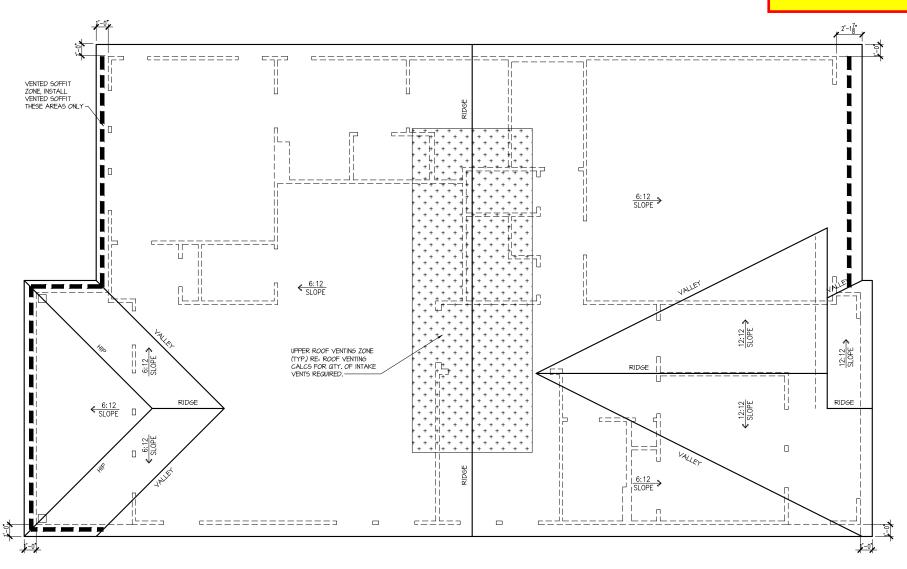



NOTE: QTY OF UPPER VENTS SHOWN COVERS 100% OF UPPER VENTING. NO MIXING OF VENT TYPES FOR UPPER VENTING IS FIGURED FOR IN THIS TABLE.

ROOF PLAN 'A'

Dointe HOMES AR BLVD, SUITE 400, RALEGH, NC 27607

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

SUBDIVISION: ALTIS AT SERENITY
ADDRESS: FUQUAY-VARINA, NC 2755
LOT: 370 BLOCK: ROOF PLAN

Issue Date: 10-13-24 ACC

5920-04

CYPRESS COVE

A3.01A



Dointe S HOMES ARK BLVD, SUITE 400, RALEIGH, NC 27607 4

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

SUBDIVISION;ALTIS AT SERENITY
ADDRESS: 98 SHADY CREEK WAY,
FUQUAY-VARINA, NC 27526
LOT:370 BLOCK:

Issue Date: 10-13-24 Drawn By: ACC

5920-04

CYPRESS COVE

A4.01

ELECTRICAL I SCHEDU	-IXTURE	
SCHEDULE		
DESCRIPTION	SYMBOL	
110V OUTLET	ф	
220V OUTLET	\$ 220	
1/2 HOT OUTLET	₩	
GFI OUTLET	∜\$ GFI	
WP GFI OUTLET	₩P/GFI	
GARAGE DOOR OPENER OUTLET	Ø GDO	
SECURITY SYSTEM	♦ SEC SYS	
DISHWASHER	⊗ DW	
JUNCTION BOX	Ū	
CEILING MOUNTED LIGHT		
CEILING FAN w/ LIGHT KIT	BRACING	
RECESSED CEILING LIGHT	Ø	
RECESSED WATER PROOF LIGHT)M(WP	
WALL MOUNTED LIGHT	9	
WALL MOUNTED PUSH BUTTON	å PB	
TWO WAY SWITCH	\$	
THREE WAY SWITCH	* \$	
FOUR WAY SWITCH	*\$	
DIMMER SWITCH	\$PIM	
EXHAUST VENTS	SVENT TO EXT	
LOW VOLTAGE PANEL		
PHONE OUTLET	● PH	
TV OUTLET	● TV	
DATA & RG6 COMBO BOX		
SMOKE DETECTOR	(S)	
CARBON MONOXIDE SMOKE DETECTOR COMBO	⊚ CM/SD	
DOOR CHIMES	CHIMES	
ELECTRICAL PANEL		
SURFACE MOUNT LED		
EXTERIOR WALL MOUNT UPLIGHT	8	
SOFFIT MOUNT FLOOD LIGHT	₹\$^	
UNDER COUNTER LIGHTING	-co- UCL	
SMURF TUBE		

Lot 370 5920-04 Cypress Cove **Elevation A** Right-Hand Garage

*Opt. Gourmet Kitchen 1

*Opt. Primary Bath 1 *Opt. Fireplace at Great Room

*Opt. Door From Primary W.I.C. to Laundry

*Opt. Screened Covered Outdoor Living


*Opt. Outdoor Living Patio

*Opt. Exterior Gas Stub Out

*Opt. Fire-Rated Garage Side

*Opt. Fire-Rated Non-Garage Side

UNDER 9,000 FT² -FIRE-RATED WALL NON-GARAGE SIDE

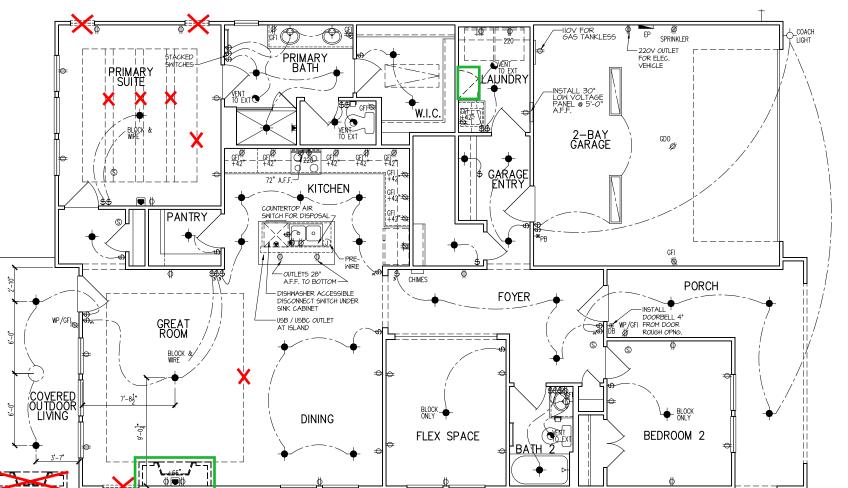

Dointe RES HOMES

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

SUBDIVISION: ALTIS AT SERENITY
ADDRESS: 98 SHADY CREEK WAY,
EUT: 370 BLOCK: ELECTRICAL FLOOR

10-13-24 Issue Date:

ACC

5920-04

CYPRESS COVE

E1.10A

ELECTRICAL NOTES:

- PROVIDE AND INSTALL LOCALLY CERTIFIED PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE AND CARBON MONOXIDE DETECTORS REQUIRED BY NATIONAL FIRE PROTECTION ASSOCIATION (NEPA) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES PROVIDE AND INSTALL GROUND FAULT CIRCUIT—INTERUPTERS (GT) AS REQUIRED BY NATIONAL ELECTRIC CODE (NEC) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES. ELECTRICAL CONTRACTOR TO PROVIDE PROVIDED THE PROPERCH HORSE AND MEETING CODES.
- REQUIRED DIRECT HOOK-UPS/CUTOFES.
- REQUIRED DIRECT HOOK—UPS/CUTOFFS.
 HVAC CONTRACTOR TO VERIFY THERMOSTAT
 LOCATIONS.
 ALL ELECTRICAL AND MECHANICAL EQUIPMENT
 (I.E. FURNACES, A/C UNITS, ELECTRICAL PANELS,
 SANITARY SUMP PITS, DRAIN TILE SUMP, AND
 WATER HEATERS) ARE SUBJECT TO RELOCATION
 DUE TO FIELD CONDITIONS.

ELECTRICAL DEVICES: ABOVE FINISHED FLOOR: WALL OUTLETS. . . WATER SOFTENER AND SUMP OUTLETS. . . . GARAGE DOOR COACH LIGHT, (ABOVE GARAGE FLOOR). . . THERMOSTAT. .54". TO .CL .84". TO .CL DOORBELL CHIMES. DOORBELL BUTTON KITCHEN HOOD FAN "WHIP". KITCHEN WALL HUNG MICROWAVE OUTLET . . KITCHEN DISHWASHER RECEPTACLE. UNDER SINK

KITCHEN REFRIGERATOR.

CL = CENTER LINE 1 = FIELD VERIFY 2 = MASTER BATH STANDARD 30" HIGH VANITY TO BE RAISED 4"

ELECTRICAL FIXTURE SCHEDULE		
DESCRIPTION	SYMBOL	
110V OUTLET	Ф	
220V OUTLET	\$ 220	
1/2 HOT OUTLET	•	
GFI OUTLET	∜\$ GFI	
WP GFI OUTLET	₩P/GFI	
GARAGE DOOR OPENER OUTLET	Ø GDO	
SECURITY SYSTEM	♦ SEC SYS	
DISHWASHER	⊕DW	
JUNCTION BOX	J	
CEILING MOUNTED LIGHT		
CEILING FAN w/ LIGHT KIT	BRAZING	
RECESSED CEILING LIGHT	Ø	
RECESSED WATER PROOF LIGHT)©(WP	
WALL MOUNTED LIGHT	Ŷ	
WALL MOUNTED PUSH BUTTON	d PB	
TWO WAY SWITCH	\$	
THREE WAY SWITCH	* \$	
FOUR WAY SWITCH	⁴\$	
DIMMER SWITCH	\$ ^{DIM}	
EXHAUST VENTS	SVENT TO EXT	
LOW VOLTAGE PANEL		
PHONE OUTLET	● PH	
TV OUTLET	⊗ TV	
DATA & RG6 COMBO BOX		
SMOKE DETECTOR	<u>©</u>	
CARBON MONOXIDE SMOKE DETECTOR COMBO	⊚ CM/SD	
DOOR CHIMES	CHIMES	
ELECTRICAL PANEL	EP EP	
SURFACE MOUNT LED		
EXTERIOR WALL MOUNT UPLIGHT	8	
SOFFIT MOUNT FLOOD LIGHT	44s	
UNDER COUNTER LIGHTING	-coc- UCL	
SMURF TUBE		

ELECTRICAL NOTES:

1. PROWIDE AND INSTALL LOCALLY CERTIFIED SMOKE AND CARBON MONOXIDE DETECTORS REQUIRED BY NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES 2. PROVIDE AND INSTALL GROUND FAULT (IRCUIT—INTERRUPIETES (GFI) AS REQUIRED BY NATIONAL ELECTRIC CODE (NEC) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES.
3. ELECTRICAL CONTRACTOR TO PROVIDE REQUIRED DIRECT HOOK—UPS/CUTOFFS.
4. HVAC CONTRACTOR TO VERIFY THERMOSTAT LOCATIONS.
5. ALL ELECTRICAL AND MECHANICAL EQUIPMENT (I.E. FURNACES, A/C UNITS, ELECTRICAL PANELS, SANITARY SUMP PITS, DRAIN TILE SUMP, AND WATER HEATERS) ARE SUBJECT TO RELOCATION DUE TO FIELD CONDITIONS.
ELECTRICAL DEVICES: ABOVE FINISHED FLOORS.

+42" TO BOTTOM OF HORIZONTAL OUTLET(TYP. @ COUNTER)
 REMAINING SWITCHES.
 48".TD. CL

 WALL OUTLETS.
 12". TO CL


 BATH VANITY BRACKET OUTLET.
 1,2"

 (1" ABOVE TOP OF VANITY)
 1,2"
 WATER SOFTENER AND SUMP OUTLETS. 48" TO CL FRONT DOOR COACH LIGHT. THERMOSTAT. . KITCHEN REFRIGERATOR.

2 = MASTER BATH STANDARD 30" HIGH VANITY TO BE RAISED 4"

Lot 370 5920-04 Cypress Cove **Elevation A** Right-Hand Garage

- *Opt. Gourmet Kitchen 1
- *Opt. Primary Bath 1
- *Opt. Fireplace at Great Room
- *Opt. Door From Primary W.I.C. to Laundry
- *Opt. Screened Covered Outdoor Living
- *Opt. Outdoor Living Patio
- *Opt. Exterior Gas Stub Out
- *Opt. Fire-Rated Garage Side

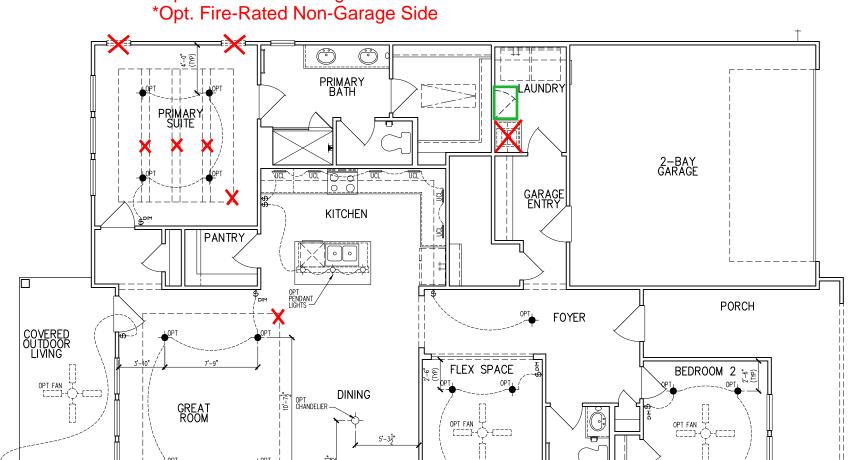

Check BOO for Selected Electrical Options

UNDER 9,000 FT2 -NON-GARAGE SIDE

Dointe K

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

OPITONS

PLAN FLOOR

1st


SUBDIVISION: ALTIS AT SERENITY
ADDRESS: 98 SHADY CREEK WAY,
FUQUAY-VARINA, NC 2752
LOT:370 BLOCK:

10-13-24 Issue Date: ACC

5920-04

CYPRESS COVE

E1.11A

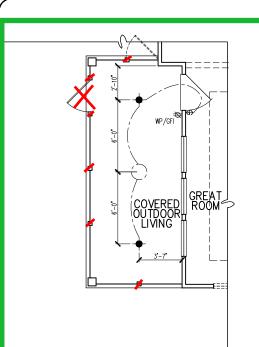

OPT. SCREENED COVERED OUTDOOR LIVING PARTIAL ELECTRICAL PLAN

ELECTRICAL FIXTURE SCHEDULE	
DESCRIPTION	SYMBOL
110V OUTLET	ф
220V OUTLET	Ф220
1/2 HOT OUTLET	♦
GFI OUTLET	₩ GFI
WP GFI OUTLET	₩P/GFI
GARAGE DOOR OPENER OUTLET	Ø GDO
SECURITY SYSTEM	♦ SEC SYS
DISHWASHER	⊕DW
JUNCTION BOX	0
CEILING MOUNTED LIGHT	\(\rightarrow \)
CEILING FAN w/ LIGHT KIT	ERAMINE
RECESSED CEILING LIGHT	Ø
RECESSED WATER PROOF LIGHT	∭WP
WALL MOUNTED LIGHT	Ŷ
WALL MOUNTED PUSH BUTTON	á PB
TWO WAY SWITCH	\$
THREE WAY SWITCH	3\$
FOUR WAY SWITCH	* \$
DIMMER SWITCH	\$ ^{D™}
EXHAUST VENTS	S VENT TO EXT
LOW VOLTAGE PANEL	□ \$□
PHONE OUTLET	⊕ PH
TV OUTLET	⊕ TV
DATA & RG6 COMBO BOX	₩
SMOKE DETECTOR	S
CARBON MONOXIDE SMOKE DETECTOR COMBO	⊚ CM/SD
DOOR CHIMES	CHIMES
ELECTRICAL PANEL	EP EP
SURFACE MOUNT LED	•
EXTERIOR WALL MOUNT UPLIGHT	₽.
SOFFIT MOUNT FLOOD LIGHT	44

UNDER COUNTER LIGHTING


ELECTRICAL NOTES:

PROVIES AND INSTALL LOCALLY CERTIFIED SMOKE AND CABRON MONOMER DETECTORS AS REQUIRED IN AND CABRON MONOMER DETECTORS AS REQUIRED BY AND ALL DOLLAR ASSOCIATION (NFPA) AND MEETING THE REQUIREMENTS OF ALL GOVERNIC CODES PROVIDE AND INSTALL GROUND FAULT THE REQUIREMENTS OF ALL GOVERNIC CODES PROVIDE AND INSTALL GROUND FAULT THE REQUIREMENTS OF ALL GOVERNIC CODES PROVIDE AND INSTALL GROUND FAULT THE REQUIREMENTS OF ALL GOVERNIC CODES AND METHOD BY THE REQUIREMENTS OF ALL GOVERNIC CODES AND METHOD THE METHOD THE REQUIREMENT OF THE METHOD THE AND METHOD THE SUPPLY AND MATER HATERS) ARE SUBJECT TO RELOCATION DUE TO FIELD COMMITTIONS.


ALE ELECTRICAL PROVIDES ABOVE FINISED FLOORS.


ELECTRICAL DEVICES: A	MOUNE LIMIQUED L	LUUR
SWITCHES OVER COUNTER		
WALL OUTLETS OVER COUNTER.		
+42" TO BOTTOM OF HORIZONTAL O	UTLET(TYP. @ COUN	(TER)
REMAINING SWITCHES	48	.TO.
WALL OUTLETS		. 10
BATH VANITY BRACKET OUTLET. (1" ABOVE TOP OF VANITY)	1,2	!
WATER SOFTENER AND SUMP OU	TLETS 48	" TO
EXTERIOR GFI OUTLETS	12	.TO.
GARAGE GFI (ABOVE GARAGE FL	OOR) 48	* TO
FRONT DOOR COACH LIGHT		. TO
GARAGE DOOR COACH LIGHT, (ABOVE GARAGE FLOOR)		
THERMOSTAT		
DOORBELL CHIMES		
DOORBELL BUTTON	Ы	YELAN
KITCHEN HOOD FAN "WHIP"		. TQ
KITCHEN WALL HUNG MICROWAVE	OUTLET 72	. TO
KITCHEN DISHWASHER RECEPTAC	LE	DER
KITCHEN RANGE	24	.TO.
KITCHEN REFRIGERATOR		. TO
WASHER/DRYER OUTLET		. TQ

CL = CENTER LINE 1 = FIELD VERIFY 2 = MASTER BATH STANDARD 30" HIGH VANITY TO BE RAISED 4"

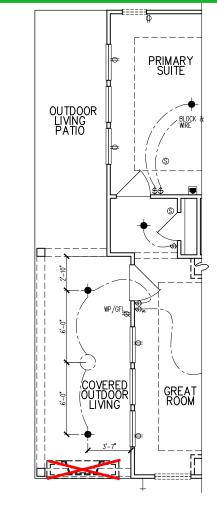


OPT. OUTDOOR LIVING PATIO PARTIAL ELECTRICAL PLAN



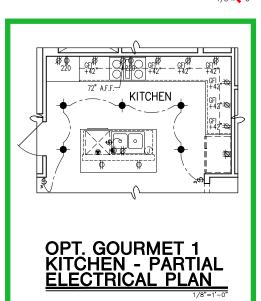


OPT. SHOWER ILO TUB AT BATH 2 - PARTIAL ELECTRICAL PLAN



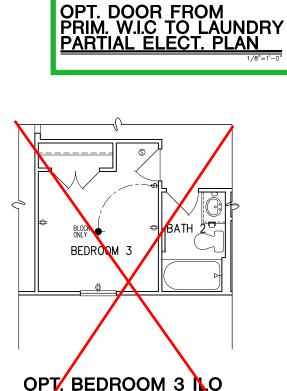

_LLAUNDRY

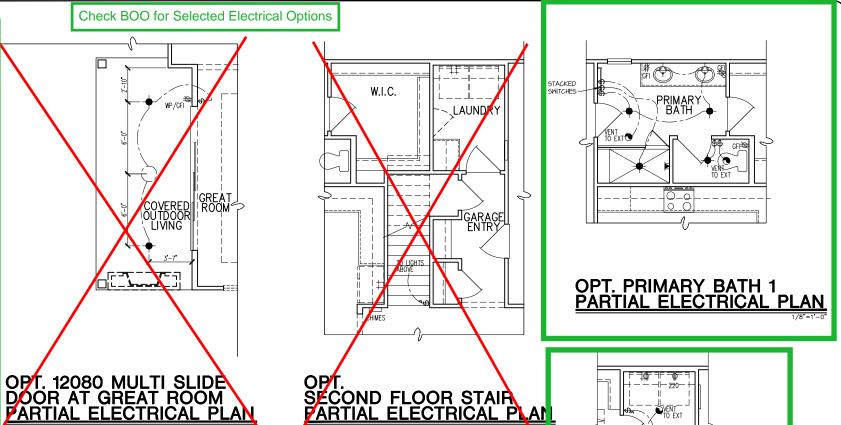







OPT. BEDROOM 3 ILO FLEX SPACE - PARTIAL ELECTRICAL PLAN

DointeHOMES 4

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

OPTIONS SUBDIVISION: ALTIS AT SERENITY
ADDRESS: FUQUAY-VARINA, NC 2755
LOT: 370 BLOCK: PLAN ELEC. ADDRESS: LOT: 370

10-13-24 Issue Date: ACC

5920-04

CYPRESS COVE

01.E10

ELECTRICAL FIXTURE SCHEDULE		
DESCRIPTION	SYMBOL	
110V OUTLET	ф	
220V OUTLET	\$ 220	
1/2 HOT OUTLET		
GFI OUTLET	∜ GFI	
WP GFI OUTLET	₩P/GFI	
GARAGE DOOR OPENER OUTLET	Ø GDO	
SECURITY SYSTEM	∯SEC SYS	
DISHWASHER	⊕DW	
JUNCTION BOX	Ū	
CEILING MOUNTED LIGHT	\rightarrow	
CEILING FAN w/ LIGHT KIT	BRACING	
RECESSED CEILING LIGHT	Ø	
RECESSED WATER PROOF LIGHT)®(WP	
WALL MOUNTED LIGHT	9	
WALL MOUNTED PUSH BUTTON	⊌ PB	
TWO WAY SWITCH	\$	
THREE WAY SWITCH	* \$	
FOUR WAY SWITCH	\$	
DIMMER SWITCH	\$□™	
EXHAUST VENTS	S VENT TO EXT	
LOW VOLTAGE PANEL		
PHONE OUTLET	● PH	
TV OUTLET	⊗ TV	
DATA & RG6 COMBO BOX		
SMOKE DETECTOR	Ó	
CARBON MONOXIDE SMOKE DETECTOR COMBO	⊚ CM/SD	
DOOR CHIMES	CHIMES	
ELECTRICAL PANEL	₽	
SURFACE MOUNT LED	•	
EXTERIOR WALL MOUNT UPLIGHT	8	
SOFFIT MOUNT FLOOD LIGHT	44	
UNDER COUNTER LIGHTING	+ UCL	
SMURF TUBE		

ELECTRICAL NOTES:

PROVIDE AND INSTALL LOCALLY CERTIFIED SMOKE AND CARBON MONOXIDE DETECTORS REQUIRED BY NATIONAL FIRE PROTECTION ASSOCIATION (NFPA) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES PROVIDE AND INSTALL GROUND FAULT CIRCUIT—INTERRUPTERS (SF) AS REQUIRED BY NATIONAL ELECTRIC CODE (NEC) AND MEETING THE REQUIREMENTS OF ALL GOVERNING CODES. ELECTRICAL CONTRACTOR TO PROVIDE REQUIRED DIRECT HOOK—UPS/CUTOFFS. HYAC CONTRACTOR TO VERIFY THERMOSTAT LOCATIONS. HAVE CONTRACTOR TO VERHY HERMOSTAT LOCATIONS.


ALL ELECTRICAL AND MECHANICAL EQUIPMENT (I.E. FURNACES, A/C UNITS, ELECTRICAL PANELS, SANITARY SUMP PITS, DRAIN TILE SUMP, AND WATER HEATERS) ARE SUBJECT TO RELOCATION DUE TO FIELD CONDITIONS. ELECTRICAL DEVICES: ABOVE FINISHED FLOOR: SWITCHES OVER COUNTER. . WALL OUTLETS OVER COUNTER REMAINING SWITCHES. 48". TD. CL
WALL OUTLETS. 12". TO CL
BATH VANITY BRACKET OUTLET. 1,2
CL
BATH SODE TOP OF VANITY) WATER SOFTENER AND SUMP OUTLETS. 48" TO CL EXTERIOR GFI OUTLETS. 12". TO .CL GARAGE GFI (ABOVE GARAGE FLOOR). 48" TO CL FRONT DOOR COACH LIGHT. . . GARAGE DOOR COACH LIGHT, (ABOVE GARAGE FLOOR). . . . DOORBELL BUTTON. . . CL = CENTER LINE 1 = FIELD VERIFY

2 = MASTER BATH STANDARD 30" HIGH VANITY TO BE RAISED 4"

Lot 370

5920-04 Cypress Cove FIRE-RATED WALL Elevation A Right-Hand Garage

UNDER 9,000 FT² -**GARAGE SIDE & NON-GARAGE SIDE**

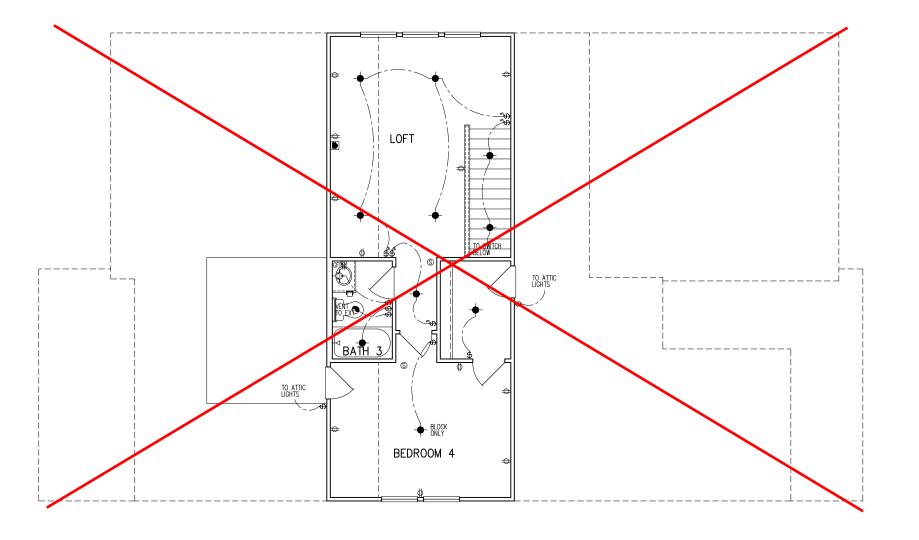

OPT. SECOND FLOOR PLAN PARTIAL ELECTRICAL PLAN

Dointe HOMES HOMES 4

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

OPTION SUBDIVISION:ALTIS AT SERENITY ADDRESS: 98 SHADY CREEK WAY, FUQUAY-VARINA, NC 27 FLR ELEC.


10-13-24 ACC Drawn By:


2nd

5920-04


CYPRESS COVE

01.E20

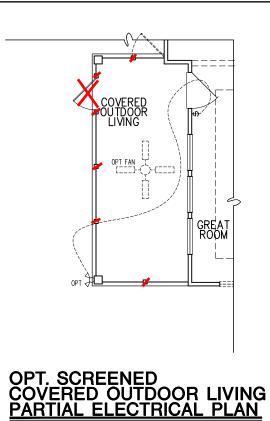

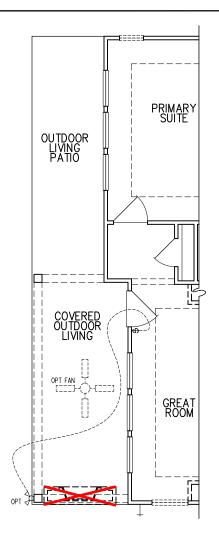

OPT. OUTDOOR LIVING PATIO PARTIAL ELECTRICAL PLAN

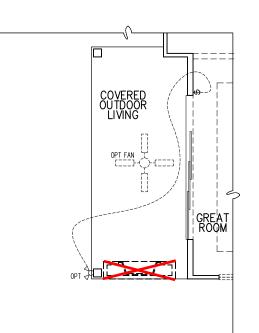

OPT. 12080 MULTI SLIDE DOOR AT GREAT ROOM PARTIAL ELECTRICAL PLAN

Check BOO for Selected Electrical Options

Lot 370 5920-04 Cypress Cove **Elevation A** Right-Hand Garage

*Opt. Gourmet Kitchen 1

*Opt. Primary Bath 1

*Opt. Fireplace at Great Room

*Opt. Door From Primary W.I.C. to Laundry

*Opt. Screened Covered Outdoor Living

*Opt. Outdoor Living Patio


*Opt. Exterior Gas Stub Out


*Opt. Fire-Rated Garage Side

*Opt. Fire-Rated Non-Garage Side


UNDER 9,000 FT² -GARAGE SIDE & NON-GARAGE SIDE



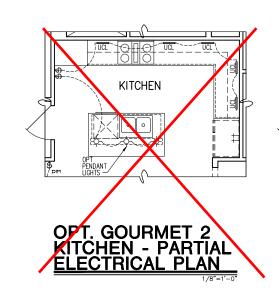



OPT. GOURMET 1 KITCHEN - PARTIAL ELECTRICAL PLAN







ACC

10-13-24

Issue Date:

SUBDIVISION: ALTIS AT SERENIT ADDRESS: 98 SHADY CREEK WA' FUQUAY-VARINA, NC

Dointe RES HOMES

4

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

OPTIONS

FLOOR ELEC.


1st

5920-04 CYPRESS COVE

01.E11

Lot 370 5920-04 Cypress Cove Elevation A Right-Hand Garage

UNDER 9,000 FT² -NON-GARAGE SIDE

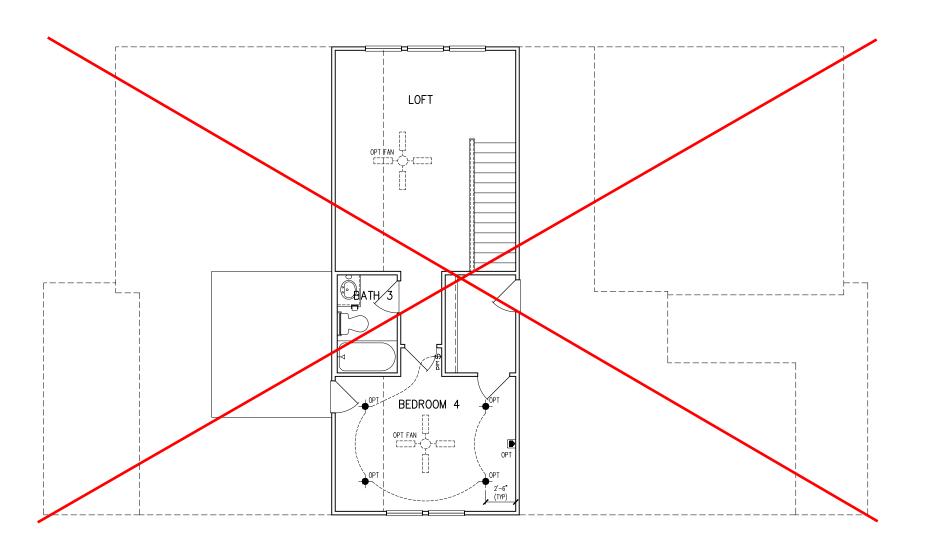

OPT. SECOND FLOOR PLAN PARTIAL ELECTRICAL PLAN

tri pointe H O M E S 540 WADE PARK BLVD, SUITE 400, FALEIGH, NC 27607

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607


2nd FLOOR ELEC. PLAN


SUBDIVISION: ALTIS AT SERENITY
ADDRESS: 98 SHADY CREEK WAY,
LOT:370 BLOCK:

5920-04


CYPRESS COVE


^{SHEET #:} 01.Е21

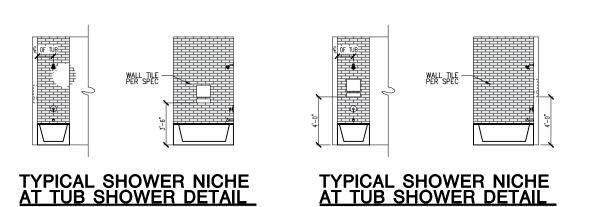



Lot 370 5920-04 Cypress Cove **Elevation A** Right-Hand Garage










WALL TILE PER SPEC

TYPICAL SHOWER NICHE AT SHOWER DETAIL

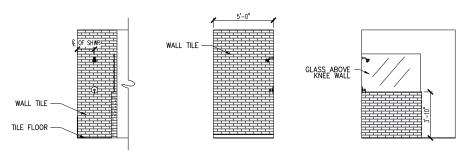



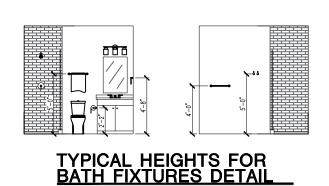





5920-04


CYPRESS COVE


D1.0

pointe S H O M E S RR BLVD, SUITE 400, RALEIGH, NG 27607 は

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

SUBDIVISION: ALTIS AT SERENITY ADDRESS: 98 SHADY CREEK WAY, ADDRESS: FUQUAY-VARINA, NC 27

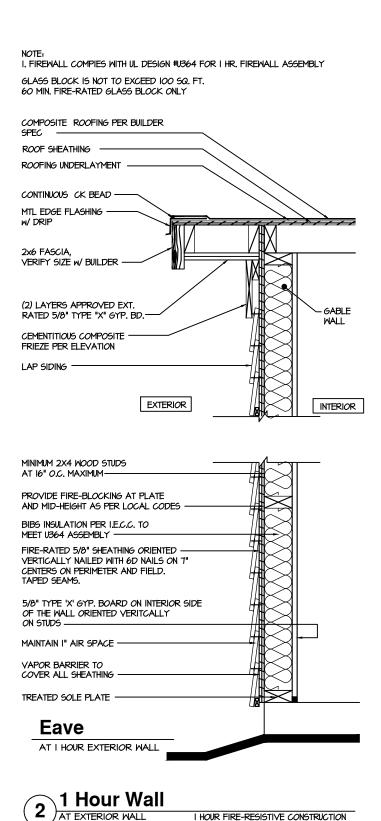

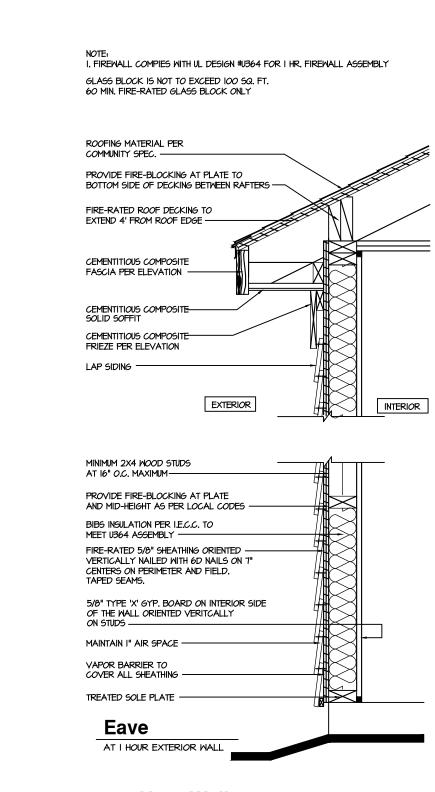



I HOUR FIRE-RESISTIVE CONSTRUCTION

Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607


SUBDIVISION: ALTIS AT S ADDRESS: FUQUAY-VARIN LOT: 370

Issue Date: 10-13-24 ACC

5920-04


CYPRESS COVE


D1.1

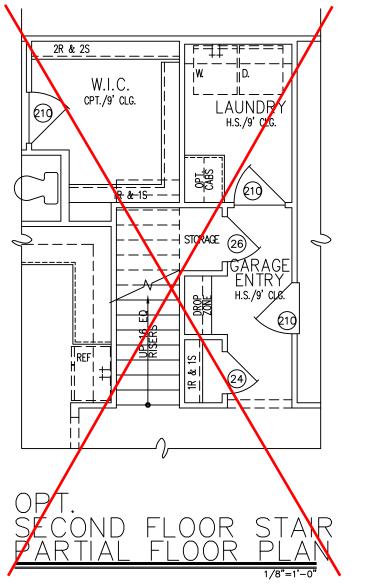




UNDER 9,000 FT² -FIRE-RATED WALL REQUIRED AT GARAGE SIDE & NON-GARAGE SIDE

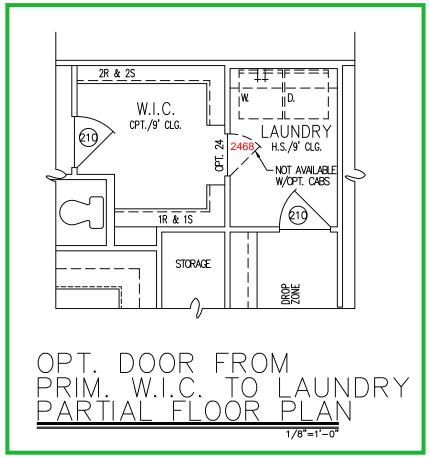

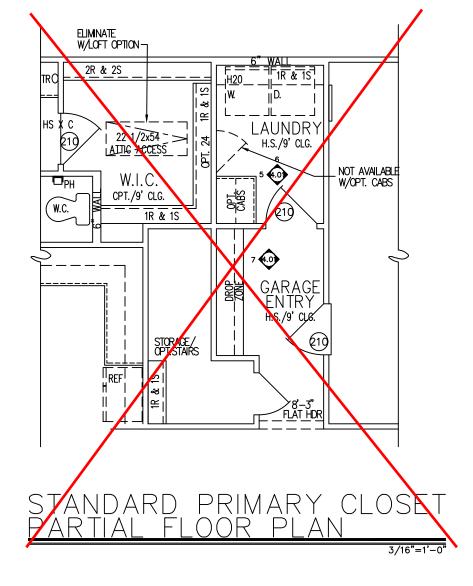

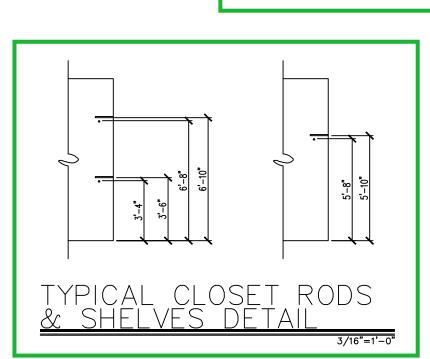



Business Operations 5440 Wade Park Blvd Suite 400 Raleigh, NC 27607

PRIMARY CLOSET PARTIALS
SUBDIVISION: ALTIS ® SERENITY
ADDRESS: 98 SHADY CREEK WAY,
ADDRESS: FUQUAY-VARINA, NC 27526
LOT: 370 BLOCK:

Issue Date: 10-08-24
Drawn By: ACC

5920-04

CYPRESS COVE

D2.0

GENERAL STRUCTURAL NOTES

FLOOR FRAMING

- I IOISTS/TRUSSES SHALL BE DESIGNED BY MANUE TO MEET OR EXCEED L/480 LIVE LOAD DEFLECTION CRITERIA. (EXCLUDES STONE/MARBLE OR WET BED CONSTRUCTED FLOORS - CONTACT M&K FOR EXCLUDED FLOOR DESIGNS)
- PER THE GUIDELINES OF THE TILE COUNCIL OF NORTH AMERICA (TCNA HANDBOOK), IT SHALL BE THE FLOOR FINISH INSTALLER'S RESPONSIBILITY TO VERIFY THAT THE FINISHES TO BE INSTALLED MATCH THE DESIGN CRITERIA NOTED ABOVE (UNDER "DESIGN
- FLOOR SYSTEMS & SHEATHING HAVE BEEN DESIGNED TO SUPPORT ADDITIONAL DEAD LOAD FROM CERAMIC TILE (EXCLUDING MARBLE OR STONE). HOWEVER, IT SHALL BE THE FLOOR FINISH INSTALLER'S RESPONSIBILITY TO PROVIDE PROPER UNDERLAYMENT, UNCOUPLING MEMBRANE AND MORTAR/GROUT PER THE ASSEMBLY DESIGNATIONS IN THE TONA HANDBOOK (TILE COUNCIL OF NORTH AMERICA).
- AT I-JOIST FLOORS, PROVIDE I I/8" MIN. OSB RIM BOARD
- METAL HANGERS SHALL BE SPECIFIED BY MANUFACTURER, U.N.O.
- I-JOIST/TRUSS SHOP DWGS, SHALL BE SUBMITTED TO ARCH, & ENG.
 FOR REVIEW AND APPROVAL PRIOR TO FABRICATION OR DELIVERY
- FLOOR SHEATHING SHALL BE 23/32" A.P.A. RATED 'STURD-I-FLOOR' 24" O.C. EXPOSURE I (OR APPROVED EQUAL) WITH TONGUE AND GROOVE EDGES. FASTEN TO FRAMING MEMBERS W GLUE AND
- 2 1 x 0.131" NAILS @ 6"o.c. @ PANEL EDGES & @ 12"o.c. FIELD
- · 2 3 × 0.120 NAILS @ 4" O.C. @ PANEL EDGES \$ @ 8" O.C. FIELD. - 2 3 × 0.113 NAILS @ 3" O.C. @ PANEL EDGES \$ @ 6" O.C. IN FIELD

ROOF FRAMING

- ROOF SHEATHING SHALL BE 1/16" A.P.A. RATED SHEATHING 24/16 EXPOSURE I (OR APPROVED EQUAL). FASTEN TO FRAMING MEMBERS
- W 2 5" x 0.131" NAILS @ 6"0,c, @ PANEL EDGES & @ 12" O.C. FIELD.
- · w/ 2 🖁 × 0.120" NAILS @ 4"o.c. @ PANEL EDGES \$ @ 8" O.C. FIELD. - w/ 2 3 × 0.113" NAILS @ 3"o.c. @ PANEL EDGES & @ 6" O.C. FIELD.
- WITHIN 48" OF ALL ROOF EDGES, RIDGES, & HIPS FASTEN ROOF. SHEATHING FIELDS PER EDGE NAILING SPEC.
- FASTEN EACH ROOF TRUSS TO TOP PLATE W/ SIMPSON H2.5T CLIP (OR APPROVED EQUAL) @ ALL BEARING POINTS. PROVIDE (2) H2.5T CLIPS AT 2-PLY GIRDER TRUSSES, (3) H2.5T CLIPS AT 3-PLY GIRDER TRUSSES & ROOF BEAMS - AT ALL BEARING POINTS.
- METAL HANGERS SHALL BE SPECIFIED BY THE MANUFACTURER, U.N.O.
- ROOF TRUSS SHOP DWGS SHALL BE SUBMITTED TO ARCH & ENG FOR REVIEW AND APPROVAL PRIOR TO FABRICATION OR DELIVERY
- ERECT AND INSTALL ROOF TRUSSES PER WTCA & TPI'S BCSI I "GUIDE TO GOOD PRACTICE FOR HANDLING, INSTALLING & BRACING
- OF METAL PLATE CONNECTED WOOD TRUSSES." SUPPORT SHORT SPAN ROOF TRUSSES W/2x4 LEDGER FASTENED TO

FRAMING W(2) 3" x 0.120" NAILS @ 16" O.C. (UP TO 7' SPAN).

CONNECTION SPECIFICATIONS (TYP. U.N.O.)

DESCRIPTION OF BLDG. ELEMENT	3"x0.131" NAILS	3"x0.120" NAILS
JOIST TO SOLE PLATE	(3) TOENAILS	(3) TOENAILS*
SOLE PL. TO JOIST/RIM OR BLK'G	NAILS @ 4" o.c.	NAILS @ 4" o.c.
STUD TO PLATE	(4) TOENAILS/ (3)END NAILS	(4) TOENAILS/ (4)END NAILS*
RIM TO TOP PLATE	TOENAILS @ 6" o.c.	TOENAILS @ 4" o.c.*
BLK'G. BTWN. JOISTS TO TOP PL.	(3) TOENAILS EA. END	(3) TOENAILS EA. END*
DOUBLE STUD	NAILS @ 16" o.c.	NAILS @ 16" o.c.
DOUBLE TOP PLATE	NAILS ❷ 12" o.c.	NAILS @ 8" o.c.
DOUBLE TOP PLATE LAP SPLICE	(12) NAILS IN LAPPED AREA	(15) NAILS IN LAPPED AREA
	(24" MIN.)	(24" MIN.)
TOP PLATE LAP @ CORNERS & INTERSECTING WALLS	(3) NAILS	(3) NAILS
RAFTER/TRUSS TO TOP PLATE	(4) TOENAILS +	(4) TOENAILS +
	(I) SIMPSON H2.5T	(I) SIMPSON H2.5T
GAB. END TRUSS TO DBL. TOP PL.	TOENAILS @ 8" o.c.	TOENAILS @ 6" o.c.
R.T. w/ HEEL HT. 9 1/4" TO 12"	2xIO BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE w/ TOENAILS @ 6" O.C.	2xIO BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE w/ TOENAILS @ 4" O.C.
R.T. w/ HEEL HT. 12" TO 16"	2XI2 BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE w/ TOENAILS @ 6" O.C.	2xI2 BLK EVERY 3RD BAY FASTENED TO DBL. TOP PLATE W/ TOENAILS @ 4" O.C.
R.T. w/ HEEL HT. UP TO 24"	LAP WALL SHTG. W DBL. TOP PL. & INSTALL ON TRUSS VERT FASTEN W NAILS @ 6" O.C.	LAP WALL SHTG. W/ DBL. TOP PL. \$ INSTALL ON TRUSS VERT FASTEN W/ NAILS @ 6" O.C.*
R.T. w/ HEEL HT. 24" TO 48"	LAP WALL SHTG. W/ DBL. TOP PL. & INSTALL ON TRUGS VERT FASTEN W/ NAILS @ 6" O.C. PROVIDE 2x BLK @ EA. BAY AT TOP OF HEEL	LAP WALL SHTG. W/ DBL. TOP PL. & INSTALL ON TRUSS VERT FASTEN W/ NAILS @ 6" O.C. PROVIDE 2x BLK @ EA. BAY AT TOP OF HEEL*
WALL TO FOUNDATION	WALL SHTG. LAP W/ SILL PL. & FASTENED PER SHEAR WALL FASTENING SPEC.	

2½"x0.113 IS AN ACCEPTABLE ALTERNATIVE TO A 3"x0.120", SAME SPACING OR NUMBER OF NAILS. DNLY ACCEPTABLE WHERE * ARE SHOWN)

GENERAL STRUCTURAL NOTES

DESIGN LOADING

- DESIGN IS BASED ON 2018 NORTH CAROLINA STATE BUILDING CODE RESIDENTIAL CODE.
- WOOD FRAME ENGINEERING IS BASED ON NDS, "NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION" - LATEST EDITION.

DESIGN LOADS ROOF

SNOW = 15 PSF (12 PSF GROUND SNOW, TRUSSES) LIVE = 20 PSF (REDUCIBLE BASED ON ROOF PITCH)
DEAD = 7 PSF T.C., IO PSF B.C.

LOAD DURATION FACTOR = 1.25 FLOOR LIVE = 40 PSF (30 PSF @ SLEEPING AREAS)

DEAD = 10 PSF (I-JOISTS), 15 PSF (FLOOR TRUSSES) ADD'L TO PSE @ CERAMIC TILE IN KITCHEN BUNROOMS, BATHS, FOYER, LAUND. & MUDRMS

2,000 PSF ASSUMED ALLOWABLE BEARING PRESSURE (TO BE VERIFIED BY BUILDER)

115 MPH, EXPOSURE B

GENERAL FRAMING

- ALL TYP, NAIL FASTENER REQUIREMENTS ARE NOTED IN STANDARD CONNECTIONS TABLE (IRC TABLE R602.3(I)) OR ON PLANS. ALL NAILS SPECIFIED ARE MIN DIAMETER AND LENGTH REQUIRED FOR CONNECTION. ALL HANGER NAILS SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS FOR MAX CHARTED CAPACITY NOTE: HANGERS USE COMMON NAIL DIAMETERS NOT TYPICAL FRAMING GUN NAILS.
- EXT. & INT. BEARING WALLS SHALL BE 2x4 OR 2x6 (AS SHOWN ON PLANS) @ 16" O.C. SPF/SP #2 GRADE LUMBER, OR BETTER, U.N.O.. WALLS OVER 12' TALL SHALL BE PER PLAN.
- ALL INTERIOR BEARING WALLS ARE ASSUMED TO BE SHEATHED W/ GYP WALL BOARD (ONE SIDE MIN.) OR PROVIDE MID HT. BLOCKING.
- ALL HEADERS, BEAMS & OTHER STRUCTURAL MEMBERS SHALL BE SPRUCE-PINE-FIR #2 (SPE) OR SOUTHERN PINE #2 (SP) LUMBER, OR BETTER, SUPPORT ALL HEADERS/ BEAMS W/ (1)2x JACK STUD & (1)2x KING STUD MINIMUM
- THE NUMBER OF STUDS SPECIFIED AT A SUPPORT INDICATES THE NUMBER OF JACK STUDS REQUIRED, U.N.O.,
- ALL NON-BEARING INTERIOR STUD WALLS SHALL BE CONSTRUCTED WITH 2x 'STUD' GRADE MEMBERS SPACED @ 24" O.C. (MAX., U.N.O.) . HEADERS IN NON-LOAD BEARING WALLS SHALL BE: (I)2x4/6 FLAT @ OPENINGS UP TO 4', (2)2x4/6 FLAT UP TO 8'.
- ALL FRAMING LUMBER SHALL BE DRIED TO 15% MC (KD-15)
- ENGINEERED LUMBER BEAMS TO MEET OR EXCEED THE FOLLOWING: • 'LVL' - Fb=2600 psi; Fv=285 psi; E=2.0x10^6 psi
- ENGINEERED LUMBER POSTS TO MEET OR EXCEED THE FOLLOWING 'LVL' - Fb=2400 psi; Fcll=2500 psi; E=1.8xl0^6 psi
- FOR 2 & 3 PLY BEAMS OF EQUAL 134" MAX, WIDTH, FASTEN PLIES TOGETHER WITH 3 ROWS OF 3"X0.120" NAILS @ 8" O/C OR 2 ROWS K"x3K" SIMPSON SDS SCREWS (OR 3K" TRUSSI OK SCREWS) @ 16" GREATER. APPLY EASTENING AT BOTH FACES FOR 3-PLY CONDITION. LOCATE TOP & BOTTOM NAILS/SCREWS 2" FROM EDGE. SOLID 31/2" OR 51/4" BEAMS ARE ACCEPTABLE. USE 2 ROWS OF NAILS FOR 2x6 € 2x8 MEMBERS.
- FOR 4 PLY BEAMS OF EQUAL 13/4" MAX. WIDTH, FASTEN PLIES TOGETHER WITH 3 ROWS OF 1/2 x6" SIMPSON SDS SCREWS (OR 6 3/4" TRUSSLOK SCREWS) @ 16" O/C. USE A MINIMUM OF 4 ROWS FOR BEAM DEPTHS OF 14" OR GREATER, APPLY FASTENING AT BOTH FACES (ONE SIDE ONLY FOR TRUSSLOK SCREWS). LOCATE TOP AN BOTTOM SCREWS 2" FROM EDGE. A SOLID 7" BEAM IS ACCEPTABLE
- PROVIDE SOLID BLOCKING IN FLOOR SYSTEM UNDER ALL POSTS CONTINUOUS TO FND./BEARING. BLOCKING TO MATCH POST ABOVE.
- ALL EXTERIOR 4x4 WOOD POSTS SHALL HAVE SIMPSON BCS2-2/4 CAP & ABW44 BASE, U.N.O.
- CORROSION NOTES
- BUILDER RESPONSIBLE TO DETERMINE CORROSION-RESISTANCE REQUIREMENTS AND COMPATIBILITY OF HARDWARE FASTENERS AND CONNECTORS FOR ENVIRONMENTAL EXPOSURE AND IN CONTACT W PRESERVATIVE-TREATED WOOD OF ACTUAL FINAL CONDITIONS AND SOURCED MATERIALS. CONTACT LUMBER & HARDWARE SUPPLIERS TO COORD.

JNDER 9.000 FT² -

GARAGE SIDE &

NON-GARAGE SIDE

GENERAL STRUCTURAL NOTES

FOUNDATION

- DESIGN IS BASED ON 2018 NORTH CAROLINA STATE BUILDING CODE:
- FOOTING DESIGN 2,000 PSF ALLOWABLE SOIL BEARING
- FASTEN 2x4/6 SILL PLATES TO CONC FND WITH A MINIMUM OF 2 ANCHORS PER PLATE 12" MAX FROM PLATE ENDS - UTILIZING:
- I/2" DIA. ANCHOR BOLTS @ 6'-0" O.C,7" MIN. EMBEDMENT I/2" DIA. x 6" LONG SIMPSON TITEN HD @ 6'-0" O.C.
- SIMPSON MASA ANCHOR STRAPS @ 6'-0" O.C. (CONCRETE)
- ALL LUMBER EXPOSED TO WEATHER OR IN CONTACT W/ PERIMETER FOUNDATION SHALL BE PRESERVATIVE TREATED SOUTHERN PINE #2.
- BUILDER TO VERIFY CORROSION-RESISTANCE COMPATIBILITY OF HARDWARE & FASTENERS IN CONTACT W/ PRESERVATIVE-TREATED WOOD, CONTACT LUMBER & HARDWARE SUPPLIERS TO COORD.
- FOOTINGS SHALL BE PLAIN CONCRETE, U.N.O
- CONCRETE DESIGN BASED ON ACL 318, CONCRETE SHALL ATTAIN THE FOLLOWING MIN. COMPRESSIVE STRENGTHS IN 28 DAYS, U.N.O. f'c = 3,000 psi: FOOTINGS & INTERIOR SLABS ON GRADE 3,500 psi: GARAGE & EXTERIOR SLABS ON GRADE fu = 60.000 psi
- ALL CONCRETE EXPOSED TO THE WEATHER SHALL NOT HAVE LESS THAN 5% OR MORE THAN 7% AIR ENTRAINMENT
- REGIONS WHERE CODE FROST DEPTH IS NOT APPLICABLE. CONSULT SOILS REPORT OR BUILDING DEPT. FOR MINIMUM DEPTH BELOW GRADE
- FOOTINGS AND SLABS ON GRADE SHALL BEAR ON VIRGIN SOIL OR
- PROVIDE CONTROL JOINTS AT ALL INSIDE CORNERS OF SLAB EDGES, AND OTHER LOCATIONS WHERE SLAB CRACKS ARE LIKELY
- JOINTS SHALL BE LOCATED @ 10'-0" O.C. (RECOMMENDED) OR 15'-0" O.C. (MAXIMUM)
- JOINT GRID PATTERN SHALL BE AS CLOSE TO SQUARES AS POSSIBLE (I:I RATIO), WITH A MAXIMUM OF I:I.5 RATIO
- CONTROL JOINTS SHALL NOT BE INSTALLED IN STRUCTURAL
- DIMENSIONS BY OTHERS, BUILDER TO VERIFY.

HOLD-DOWN SCHEDULE

SYMBOL	SPECIFICATION	
► HD-I	SIMPSON CSI6 STRAP TIE W/ 14" END LENG	
► HD-2	SIMPSON MSTC66 STRAP TIE W 24" END LENG	
▶ HD-3	SIMPSON HTT4 HOLD-DOWN *	
► HD-4	SIMPSON HDU5-SDS2.5 HOLD-DOWN *	
► HD-5	SIMPSON STHDI4RJ HOLD-DOWN *	

UTILIZE SIMPSON "SET-3G" EPOXY SYSTEM TO FASTEN %" DIA. THREADED ROD INTO CONCRETE FOUNDATION. PROVIDE 12" MIN. EMBEDMENT INTO CONCRETE. INSTALL PER MANUE, RECOMMENDATIONS, DO NOT LOCATE ANCHORS WITHIN I 3/4" OF EDGE OF FOUNDATION

MEANS & METHODS NOTES

THE STRUCTURE IS DESIGNED TO BE SELF SUPPORTING AND STABLE AFTER THE BUILDING IS FINISHED AND ALL PLAN, DETAIL, AND NOTE SPECIFICATIONS HAVE BEEN COMPLETED. IT IS THE CONTRACTOR'S SOLE RESPONSIBILITY TO DETERMINE THE ERECTION PROCEDURES AND SEQUENCE TO COMPONENTS DURING CONSTRUCTION. THIS INCLUDES BUT IS NOT LIMITED TO, THE ADDITION OF NECESSARY SHORING, SHEETING, TEMPORARY BRACING, GUYS, AND TIE-DOWNS. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL SHORING AND BRACING REQUIRED TO STABILIZE AND PROTECT EXISTING AND ADJACENT STRUCTURES AND SYSTEMS DURING COURSE OF DEMOLITION AND CONSTRUCTION

STRUCTURAL DESIGN AND SPECIFICATIONS ASSUME THAT ALL SUPPORTING AND NON-SUPPORTING ELEMENTS IN CONTACT WITH FLOOR FRAMING ARE LEVEL, INCLUDING, BUT NOT LIMITED TO: FOUNDATIONS SLABS ON GRADE, BEAMS, WALLS, AND NON-BEARING ELEMENTS. IT IS THE CONTRACTOR'S RESPONSIBILITY TO VERIEY LEVELNESS AND MAKE ADJUSTMENTS AS NECESSARY, INCLUDING CONSIDERATION OF THOSE AREAS THAT MAY BE WITHIN CONTRACTUAL, INDUSTRY OR WARRANTY TOLERANCES.

VENEER LINTEL SCHEDULE

		SPAN (MAX)	HEIGHT OF VENEER ABOVE LINTEL	STEEL ANGLE SIZE
		3'-0"	20 FT. MAX	L3"x3"x¼"
		6'-0"	3 FT. MAX	L3"x3"x1/4"
			I2 FT. MAX	L4"x3"x1/4"
			20 FT. MAX	L5"x3½"x%"
		8'-0"	3 FT. MAX	L4"x4"x¼" *
			I2 FT. MAX	L5"x3½"x%"
			I6 FT. MAX	L6"x3½"x¾"
		9'-6"	I2 FT. MAX	L6"x3½"x¾6"
		16'-0"	2 FT. MAX	L7"x4"x½" **
			3 FT. MAX	L8"x4"x/5" **

- ALLIMITES.

 \$404L SIPPORT 2 %* 3 ½" YEBEER W 40 PAI MAXIMM MEIGHT.

 (IG SHALL HAVE 4" MIN. BEARING

 IG SHALL HAVE 9" MIN. BEARING

 IG SHALL HAVE 9" MIN. BEARING

 IG SHALL BOT BE FASTIBED BACK TO MODO HEADER IN MALL 446" oz. W ½" DIA. x 3 ½"

 LONG LAG SCREPK IN 2" LONG YERTICALLY SLOTTED HOLES.

 MAX. YEBEER IN APPLIES TO ANY FORTION OF PROKE OVER THE OPENING.

 ALL INITIES SHALL BE LONG IES VERTICAL.

 MAY BEC OT IN THE FIELD TO BE 3½" MIDE OVER THE BEARING LIGHTH ONLY. THIS

 SET STIPLIFIELD AND FOR ANY LIMITEL CONDITION NOT ENCOMPASSED BY THE

 ROW GER SHAPETERS.

FOR QUEEN VENEER USE L4x31/4". FOR 3½" VENEER ONLY, SEE PLAN FOR VENEER SUPPORT IF VENEER < 3½" THICK.

I-JOIST MANUFACTURER

ADDITIONAL NOTES FOR TRUSS \$

ROOF TRUSS, FLOOR TRUSS AND ENGINEERED JOISTS SHALL BE DESIGNED TO MEET THE DEFLECTION CRITERIA BELOW, UNLESS NOTED OTHERWISE ON PLAN. MULHERN & KULP CANNOT BE HELD RESPONSIBLE FOR ANY STRUCTURAL ISSUES
RELATED TO ANY BUILDING COMPONENT IF COMPONENT SHOP DRAWINGS ARE NOT SUBMITTED TO M&K FOR REVIEW PRIOR TO FABRICATION,

TRUSSES/JOISTS SHALL BE DESIGNED SO THAT DIFFERENTIAL DEFLECTION BETWEEN ADJACENT PARALLEL TRUSSES/JOISTS OR GIRDER TRUSSES/FLUS BEAMS DO NOT EXCEED THE FOLLOWING: A ROOF TRUSSES.

I/4" DEAD LOAD

DELIVERY, OR INSTALLATION.

B. FLOOR TRUSSES, ATTIC TRUSSES, & I-JOISTS:

ABSOLUTE DEAD LOAD DEFECTION OF FLOOR TRUSSES/ATTIC TRUSSES WHEN ADJACENT TO FLOOR FRAMING BY OTHERS SHALL BE LIMITED TO 3/16". (NO DIFFERENTIAL DEFLECTION

FLOOR JOIST NOTES

- SPECIFIED ON PLAN FLOOR JOISTS SERIES & SPACING IS PER THE FLOOR JOIST MANUF.
- SPACING SHALL NOT EXCEED 19.2" O.C. (MAX.) LOCATION OF TILE: SPACING SHALL NOT EXCEED 16" O.C. (MAX.)

LATERAL/WALL BRACING & WALL SHEATHING SPECIFICATIONS

THIS MODEL HAS BEEN DESIGNED TO RESIST LATERAL FORCES RESULTING FROM:

5 MPH WIND IN 2018 NCSBC:RO

(115 MPH WIND SPEED IN ASCE 7-10 WIND MAP, PER IRC R301.2.1.1) EXP. B, RISK CAT. 2 & SEISMIC CAT. A/B.

THE DESIGN WAS COMPLETED PER 2015 IBC (SECTION 1609) & ASCE 7-10, AS PERMITTED BY R301.1.3 OF THE 2018 NGSBG:RG, ACCORDINGLY THIS MODEL, AS DOCUMENTED AND DETAILED HEREWITHIN, IS ADEQUATE TO RESIST THE CODE REQUIRED LATERAL FORCES.

DESIGN WIND UPLIFT LOADS HAVE BEEN CALCULATED UTILIZING ASCE 7-10 (ACCEPTED ENGINEERING PRACTICE) AS ALLOWED PER 2018 NCSBC:RC SECTION R802.II.I.I. THIS MODEL HAS BEEN DETAILED WHERE REQUIRED & ENGINEERED TO RESIST THE WIND UPLIFT LOAD PATH PER SECTIONS R602.3.54 R802.II.

EXT. WALL SHEATHING SPECIFICATION

- 7/16" OSB OR 15/32" PLYWOOD: FASTEN SHEATHING W/ 2 🖁 "XO.II3 NAIL5 @ 6" O.C. AT EDGES & @ 12" O.C. IN THE PANEL FIELD. (TYP, U.N.O.)
- ALL SHEATHING PANELS SHALL BE ORIENTED VERTICALLY (LONG DIRECTION PARALLEL TO STUDS) AND INSTALLED FULL HEIGHT OF SHEAR WALL - OR 2x HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT ALL UNSUPPORTED PANEL EDGES & EDGE
- ALL EXT. WALLS SHALL BE CONTINUOUSLY SHEATHED AND ARE CONSIDERED SHEAR WALLS.
- ALT. STAPLE CONNECTION SPEC: 1 3/4" 16 GA STAPLES (1/6" CROWN) @ 3" O.C. AT EDGES \$ @ 6" O.C IN FIELD.


3" O.C. EDGE NAILING

 AT DESIGNATED AREAS - FASTEN PANEL EDGES OF WOOD STRUCTURAL WALL SHEATHING TO FRAMING W 2 🖁 × 0.113" NAILS @ 3" O.C. AND 12" O.C. IN THE PANEL FIELD NO STAPLE ALTERNATIVE AVAILABLE AT THIS SPEC. ALL SHEATHING PANELS SHALL BE ORIENTED VERTICALLY (LONG DIRECTION PARALLEL TO STUD) AND INSTALLED FULL HEIGHT OF SHEAR WALL - OR - 2x HORIZONTAL BLOCKING SHALL BE PROVIDED TO SUPPORT UNSUPPORTED PANEL EDGES AND 3" O.C. EDGE FASTENING.

TYP. UNIT SEPARATION WALL SHEATHING SPECIFICATION

•1/2" OR 5/8" GYPSUM WALL BOARD: FASTEN GWB SHEATHING TO FRAMING W/ 1 \$"x0.086" COOLER NAILS OR I 1/4" DRYWALL SCREWS @ 7" O.C. " PANEL EDGES & PANEL FIELD (INCLUDING T&B PLATES

- SEE CONNECTION SPECIFICATIONS CHART FOR STANDARD SHEAR TRANSFER DETAILING. IF ADDITIONAL CAPACITY IS REQUIRED BY DESIGN. T WILL BE SPECIFICALLY NOTED ON PLAN.
- DESIGN ASSUMES 16" O.C MAX. STUD SPACING, U.N.O.
- ALL STRUCTURAL PANELS ARE TO BE DIRECTLY APPLIED TO STUD FRAMING.
- FASTEN TOGETHER END STUDS OF WALL PANELS SHEATHED W/ OSB OR PLYWOOD W/ 3" x 0.120" NAILS @ 4" O.C. (THRU ONE SIDE ONLY)



MULHERN+KULP RESIDENTIAL STRUCTURAL ENGINERING



lulhern+Kulp project numbe 243-2403

SMI ssue date 11-07-24

REVISIONS

05-16-25 Per updated af JPP


pointe HOMES

NOTE GENERAL 5920-04 SERENITY MASTER SET RALEIGH, NC

S0.0

5920-04 Cypress Cove Elevation A Right-Hand Garage

Lot 370

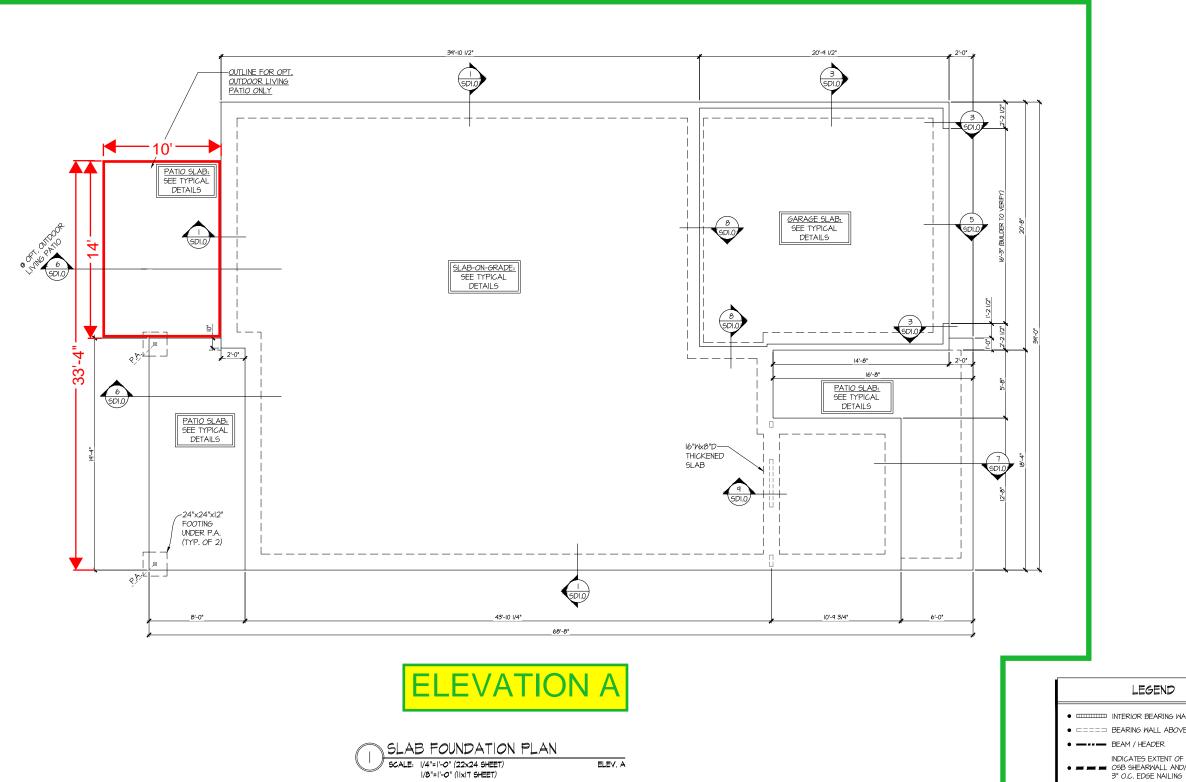

UNDER 9,000 FT² -**GARAGE SIDE & NON-GARAGE SIDE**

<u>Lot 370</u> 5920-04 Cypress Cove Elevation A Right-Hand Garage

LEGEND

- IIIII INTERIOR BEARING WALL
- □□□□□ BEARING WALL ABOVE (B.W.A.)
- BEAM / HEADER
- INDICATES EXTENT OF INT.

 OSB SHEARWALL AND/OR

- ► INDICATES HOLDOWN

- INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

REFER TO SO.O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

MULHERN+KULP RESIDENTIAL STRUCTURAL ENGINERING



Mulhern+Kulp project number: 243-24030

SMK SMN drawn by: issue date: 11-07-24

REVISIONS:


date: 05-16-25 PER UPDATED ARCI JPP

tri pointe

FOUNDATION PLAN

5920-04 MODEI SERENITY MASTER SET RALEIGH, NC

S1.0

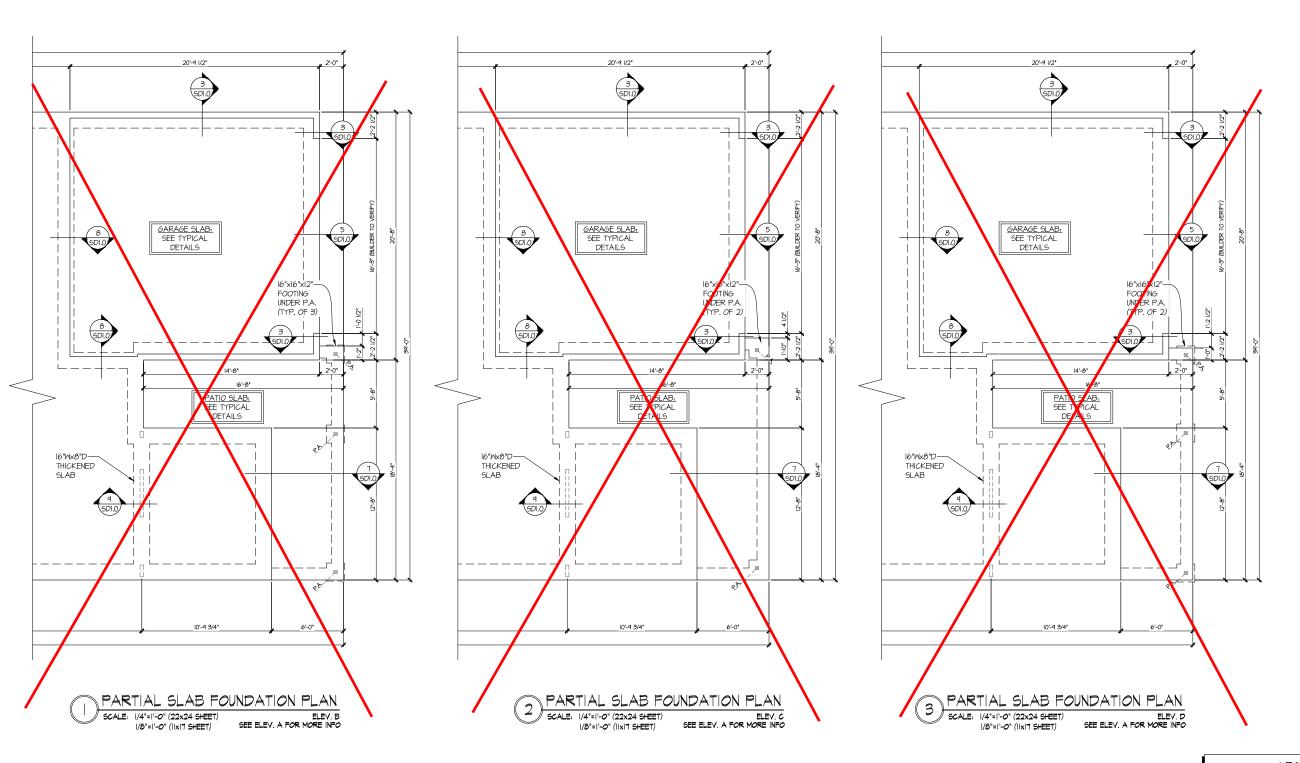

GARAGE SIDE & NON-GARAGE SIDE

<u>Lot 370</u> 5920-04 Cypress Cove Elevation A Right-Hand Garage

REFER TO SO.O FOR TYPICAL STRUCTURAL NOTES # SCHEDULES

LEGEND

- INTERIOR BEARING WALL
- □===□ BEARING WALL ABOVE (B.W.A.)
- BEAM / HEADER
- INDICATES EXTENT OF INT ■ 05B SHEARWALL AND/OR 3" O.C. EDGE NAILING
- EXTENT OF VALLEY TRUSS OVERFRAMING
- EXTENT OF FLOOR SYSTEM TO BE DESIGNED FOR TILE
- NDICATES HOLDOWN
- JL METAL HANGER
- * INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

MULHERN+KULP

RESIDENTIAL STRUCTURAL ENGINEERING

3665 Encicle Fritner, Sale 260 - Agreem, 6A. 3002

p.776-777-4894 - Ambreciations

NC License # C-3025



Mulhern+Kulp project number: 243-24030

SMK SMN issue date: 11-07-24

REVISIONS:


05-16-25 PER UPDATED AR JPP

tri pointe

FOUNDATION PLAN

5920-04 MODEI SERENITY MASTER SET RALEIGH, NC

S1.1

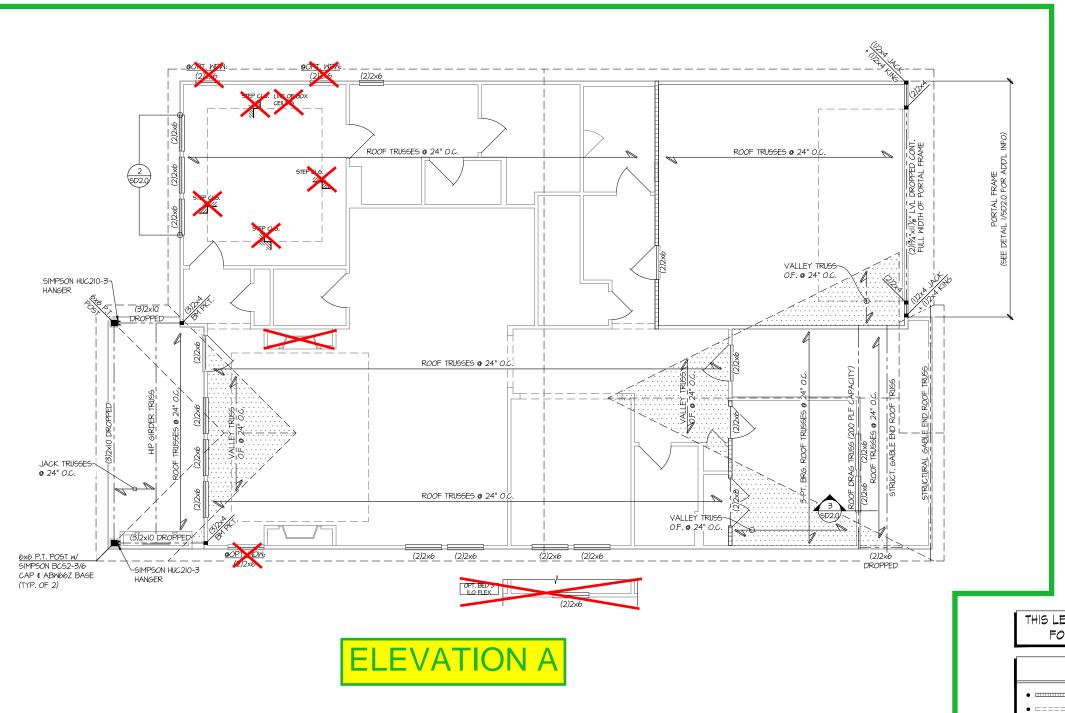

ROOF FRAMING PLAN

SCALE: 1/4"=1'-0" (22x24 SHEET) 1/8"=1'-0" (IIx17 SHEET)

UNDER 9,000 FT² - FIRE-RATED WALL REQUIRED AT GARAGE SIDE & NON-GARAGE SIDE

Lot 370
5920-04 Cypress Cove
Elevation A
Right-Hand Garage

THIS LEVEL HAS BEEN DESIGNED FOR 9'-1" PLATE HEIGHT

LEGEND

- INTERIOR BEARING WALL
- □□□□□ BEARING WALL ABOVE (B.W.A.)
- BEAM / HEADER
- INDICATES EXTENT OF INT.

 OSB SHEARWALL AND/OR

 3" O.C. EDGE NAILING
- VTOF: EXTENT OF VALLEY TRUSS OVERFRAMING
- PZZZZZZ EVTENT OF ELOOP GYGTEM TO
- ZZZZZZ DE DESIGNED FOR
- INDICATES HOLDOWN
- ▲ METAL HANGER
- INDICATES POST ABOVE. PROVIDE SOLID

REFER TO SO.O FOR
TYPICAL STRUCTURAL NOTES

\$ SCHEDULES

DEFENS YOUR PURCHASE INC.

MULHERN+KULP RESIDENTIAL STRUCTURAL ENGINERING 305 BROADIG PRIVAN, SIR 250 - Alphanes, 64, 2022



Mulhern+Kulp project number: 243-24030

project mgr: SMM drawn by: SMM issue date: 1 1 -07-24

REVISIONS:


date: initial:
05-16-25 JPP
PER UPDATED ARCH

tri pointe

ROOF FRAMING PLAN 5920-04 MODEL

5920–04 Serenity Master set Raleigh, nc

S2.0

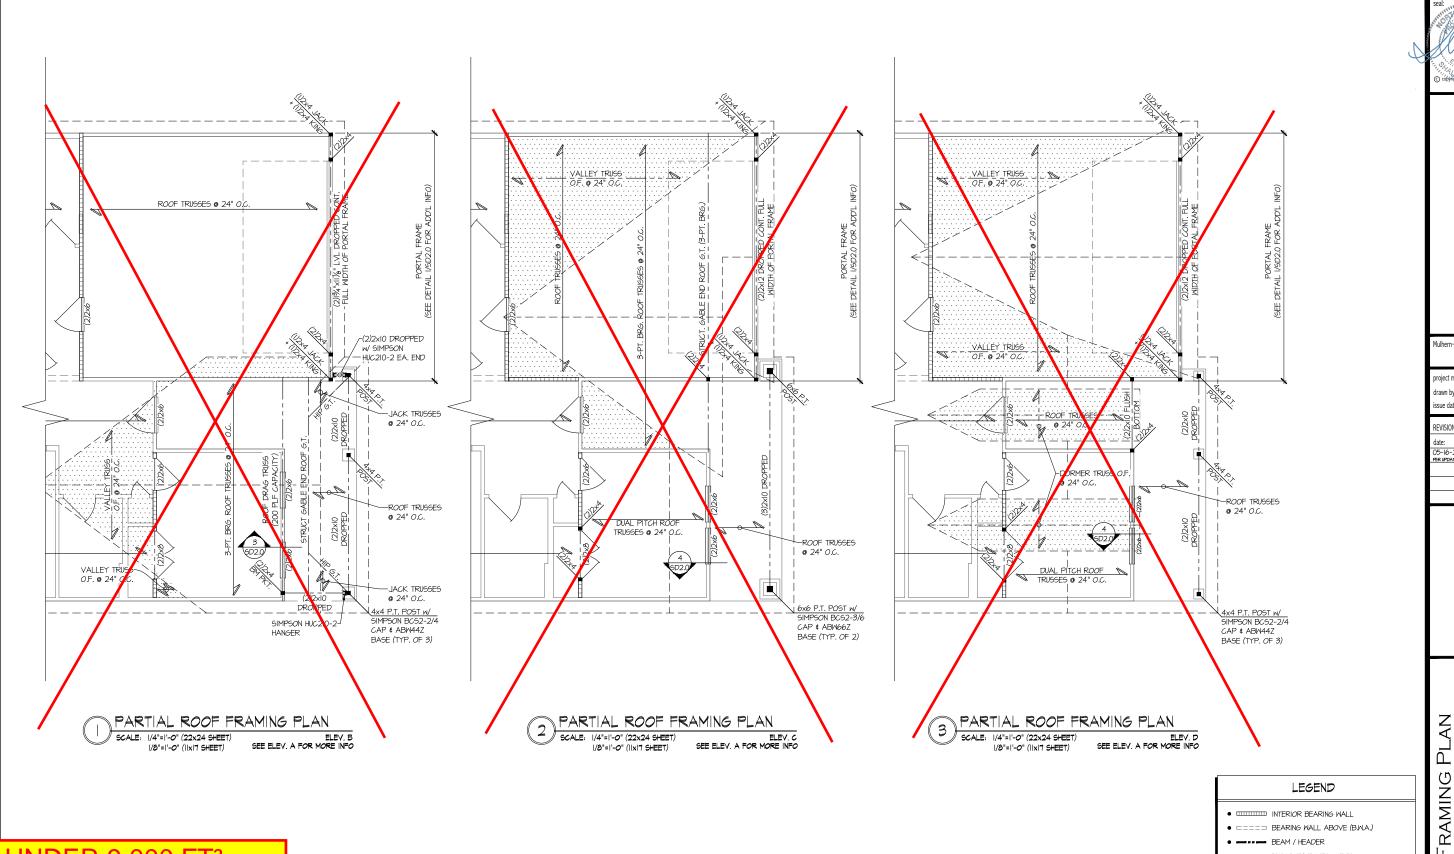

GARAGE SIDE & NON-GARAGE SIDE

<u>Lot 370</u> 5920-04 Cypress Cove Elevation A Right-Hand Garage

THIS LEVEL HAS BEEN DESIGNED FOR 9'-1" PLATE HEIGHT

REFER TO SO.O FOR TYPICAL STRUCTURAL NOTES # SCHEDULES

- INDICATES EXTENT OF INT ■ 05B SHEARWALL AND/OR 3" O.C. EDGE NAILING
- EXTENT OF VALLEY TRUSS OVERFRAMING
- EXTENT OF FLOOR SYSTEM TO BE DESIGNED FOR TILE
- NDICATES HOLDOWN
- JL METAL HANGER
- | INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE

MULHERN + KULP

RESIDENTIAL STRUCTURAL ENGINEERING

365 Eucliste Perkney, Sale 256 - Aphaetta, GA 3002

P. TULCING # C-3025

NC LICENSE # C-3025



243-24030

SMN 11-07-24 issue date:

REVISIONS:


05-16-25 PER UPDATED AR JPP

tri pointe

ROOF FRAMING PLAN

MODEI SERENITY MASTER SET RALEIGH, NC 5920-04

S2.1

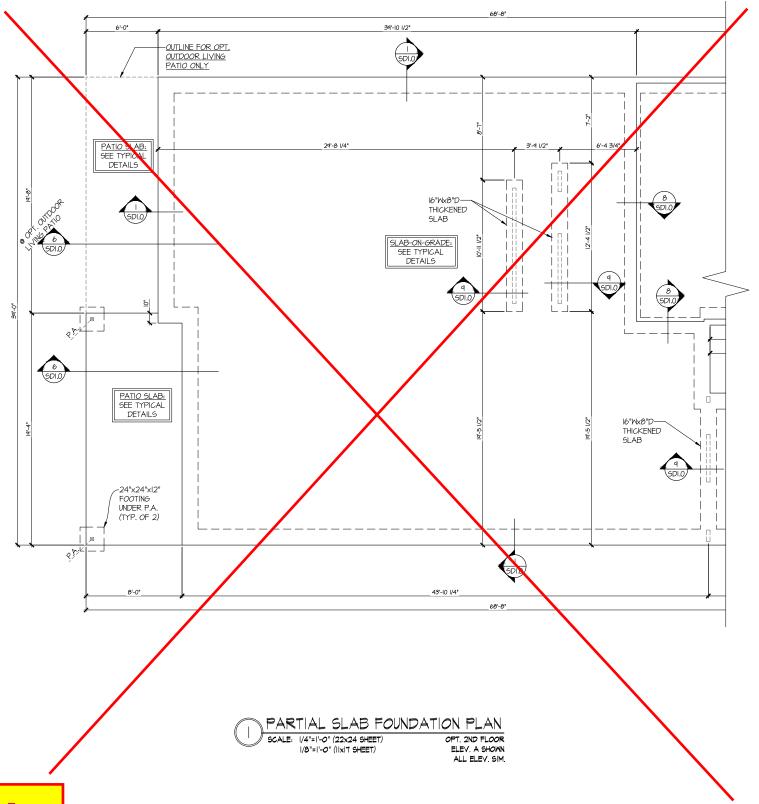

GARAGE SIDE & NON-GARAGE SIDE

<u>Lot 370</u> 5920-04 Cypress Cove Elevation A Right-Hand Garage

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING
3005 BROIGHT-PARKNEY, SAIR 250 - Application, 6A. 3002
8.776-777-8014 - malliamatop.com
NC License # C-3925



243-24030

SMK SMN issue date: 11-07-24

REVISIONS:

date: 05-16-25 per updated arc JPP

tri pointe HOMES

- ==== BEARING WALL ABOVE (B.W.A.)
- INDICATES EXTENT OF INT.

 OSB SHEARWALL AND/OR
 3" O.C. EDGE NAILING

- INDICATES POST ABOVE. PROVIDE SOLID

REFER TO SO.O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

LEGEND

• IIIII INTERIOR BEARING WALL

BEAM / HEADER

INDICATES HOLDOWN


BLOCKING UNDER POST OR JAMB ABOVE.

S3.0

STRUCTURAL OPTIONS

5920-04 MODEI

SERENITY MASTER SET RALEIGH, NC

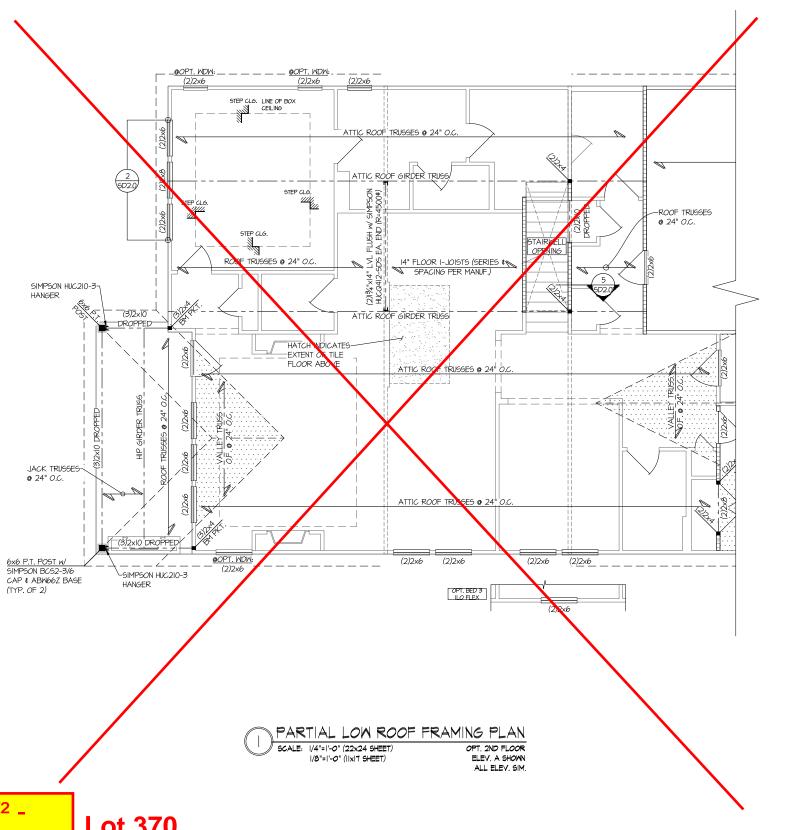

UNDER 9,000 FT² -FIRE-RATED WALL REQUIRED AT GARAGE SIDE & NON-GARAGE SIDE

Lot 370
5920-04 Cypress Cove
Elevation A
Right-Hand Garage

SEAL STATE OF THE STATE OF THE SEAL OF THE SEAL OF THE STATE OF THE SEAL OF TH

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINERING



Mulhern+Kulp project number: 243-24030

project mgr: SMK drawn by: SMM issue date: 1 1-07-24

REVISIONS:

date: initial:
05-16-25 JPP
PER UPDATED ARCH

tri pointe

THIS LEVEL HAS BEEN DESIGNED FOR 9'-I" PLATE HEIGHT

LEGEND

- INTERIOR BEARING WALL
- □===□ BEARING WALL ABOVE (B.W.A.)
- BEAM / HEADE
- INDICATES EXTENT OF INT.

 OSB SHEARWALL AND/OR

 3" O.C. EDGE NAILING
- EXTENT OF VALLEY TRUSS OVERFRAMING

 24" O.C. (MAX.)
- 77/7/7, EXTENT OF FLOOR SYSTEM
- ► INDICATES HOLDOWN
- METAL HANGER
- INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.


REFER TO SO.O FOR
TYPICAL STRUCTURAL NOTES

\$ SCHEDULES

STRUCTURAL OPTIONS 5920-04 MODEL

SERENITY
MASTER SET
RALEIGH, NC

S3.1

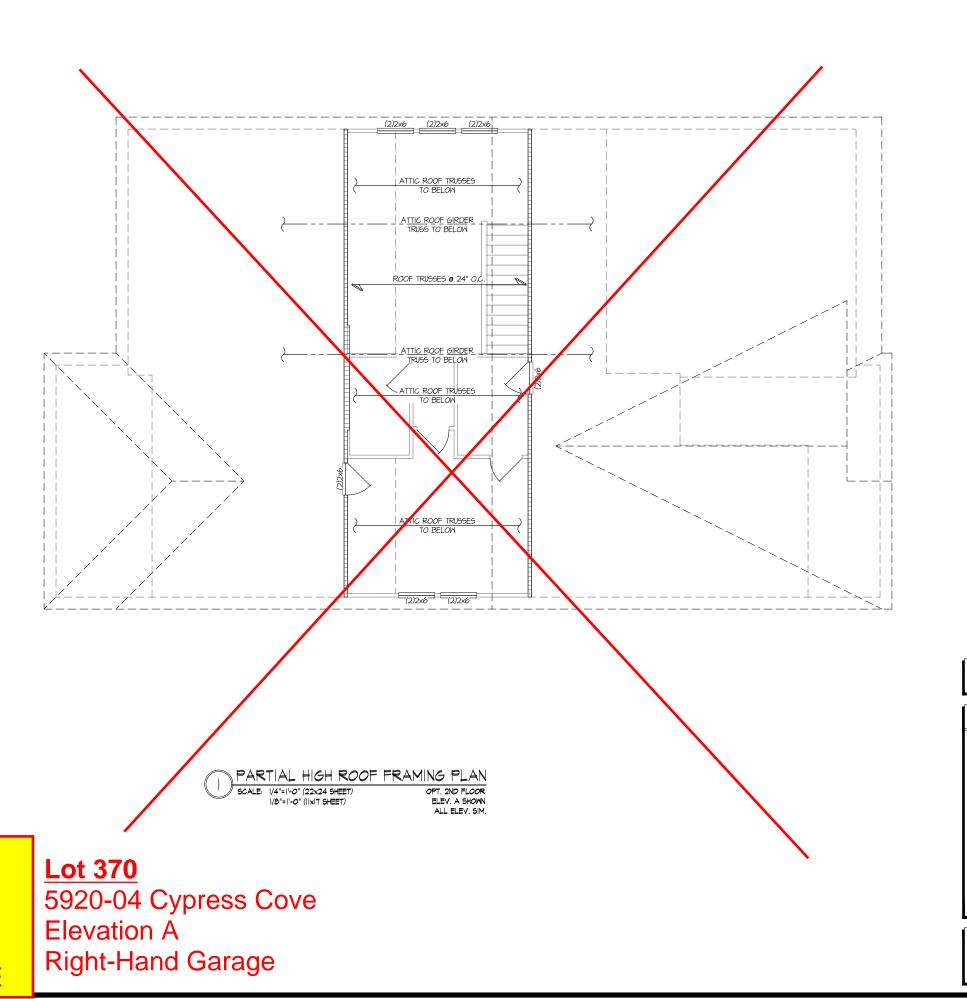

SEAL SEAL OLYGENS NULP STOCKER OLYGIN NULP



Mulhern+Kulp project number: 243-24030

project mgr: SMK drawn by: SMM issue date: 11-07-24

REVISIONS:

date: initial:
05-16-25 JPP
FER UPDATED ARCH

tri pointe

THIS LEVEL HAS BEEN DESIGNED FOR 9'-1" PLATE HEIGHT

LEGEND

- INTERIOR BEARING WALL
- □□□□□ BEARING WALL ABOVE (B.W.A.)
- BEAM / HEADE
- INDICATES EXTENT OF INT.

 OSB SHEARWALL AND/OR

 3" O.C. EDGE NAILING
- VTOF EXTENT OF VALLEY TRUSS OVERFRAMIN
- F/7.7/7.71 EVTENT OF ELOOP GYGTEM TO
- NDICATES HOLDOWN
- METAL HANGER
- HINDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

REFER TO SO.O FOR
TYPICAL STRUCTURAL NOTES
\$ SCHEDULES


STRUCTURAL OPTIONS 5920-04 MODEL


neet:

S3.2

SERENITY MASTER SET RALEIGH, NC

UNDER 9,000 FT² FIRE-RATED WALL
REQUIRED AT
GARAGE SIDE &
NON-GARAGE SIDE

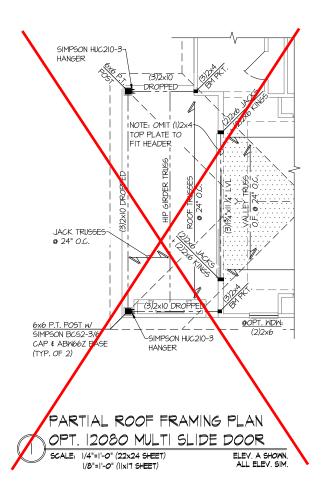



Lot 370 5920-04 Cypress Cove Elevation A Right-Hand Garage

MULHERN+KULP RESIDENTIAL STRUCTURAL ENGINERING



Mulhern+Kulp project number: 243-24030

SMK SMN issue date: 11-07-24

REVISIONS:

date: 05-16-25 PER UPDATED ARCI JPP

tri pointe

LEGEND

- IIIIII INTERIOR BEARING WALL
- □□□□□ BEARING WALL ABOVE (B.W.A.)
- BEAM / HEADER
- INDICATES EXTENT OF INT.

 OSB SHEARWALL AND/OR
 3" O.C. EDGE NAILING
- EXTENT OF VALLEY TRUSS OVERFRAMING

 24" O.C. (MAX.)
- INDICATES HOLDOWN


- | INDICATES POST ABOVE. PROVIDE SOLID BLOCKING UNDER POST OR JAMB ABOVE.

REFER TO SO.O FOR TYPICAL STRUCTURAL NOTES & SCHEDULES

STRUCTURAL OPTIONS 5920-04 MODEI

S3.3

SERENITY MASTER SET RALEIGH, NC

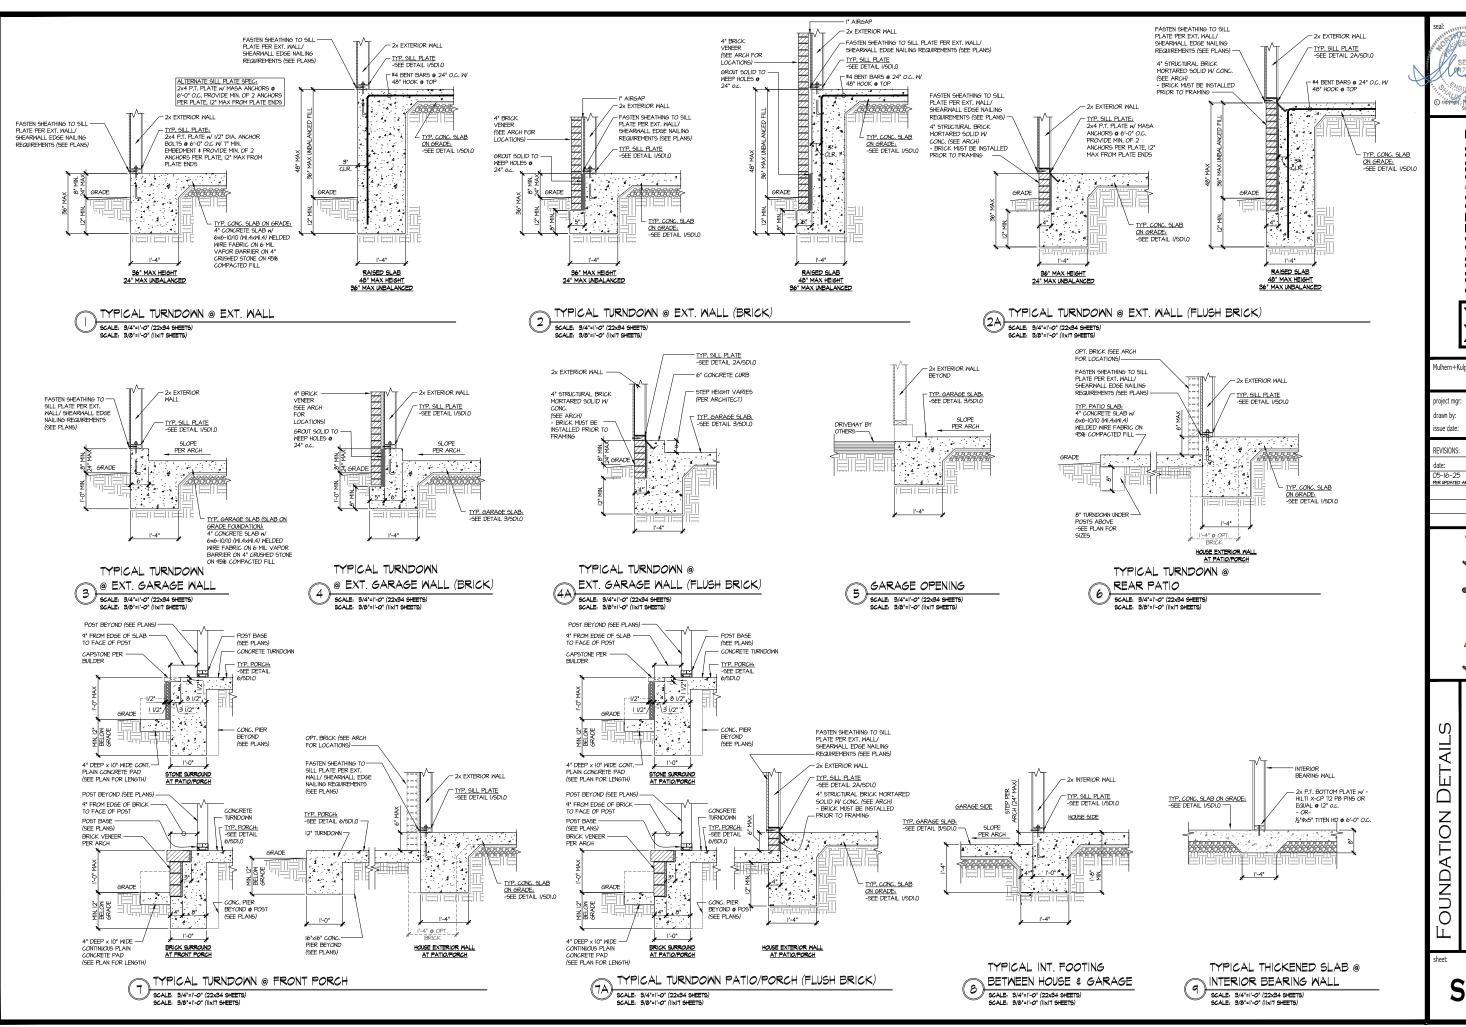

MULHERN+KULP
RESIDENTIAL STRUCTURAL ENGINEERING

lulhern+Kulp project number 243-2403 SMK SMN

11-07-24


initial: 05-16-25 PER UPDATED ARCH JPP


> pointe HOMES the second

> -04

SERENITY MASTER SET RALEIGH, NC 5920-


SD1.0

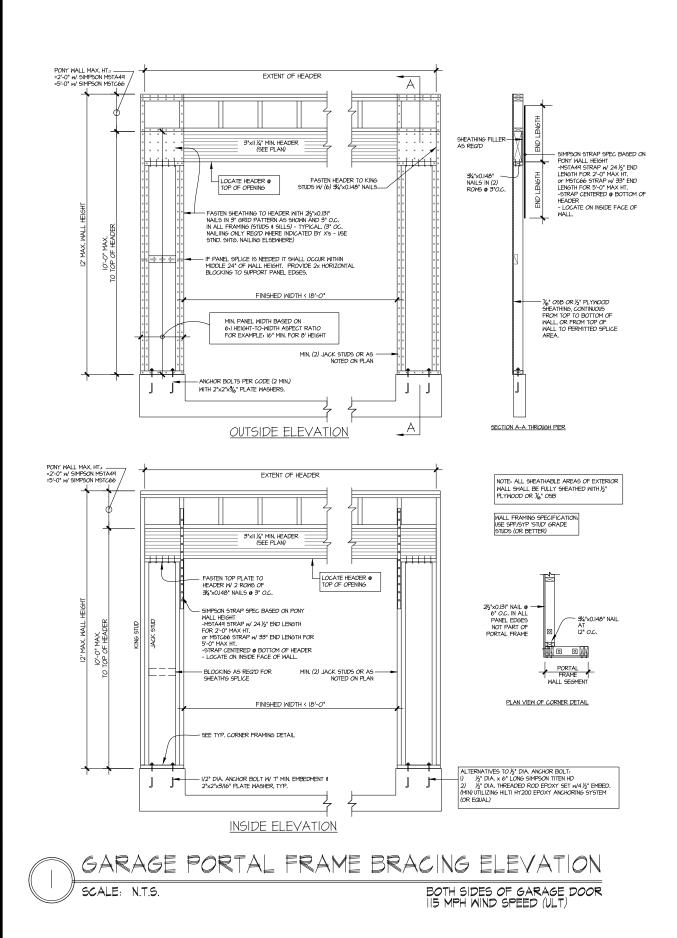

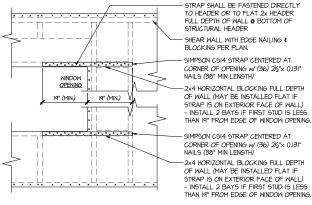



- STRAPS MAY BE INSTALLED ON EXTERIOR OR INTERIOR FACE OF WALL WHEN INSTALLED ON THE EXTERIOR FACE OF THE WALL, STRAPS TO BE INSTALLED ON EXTERIOR FACE OF SHTG. (MAY BE MOVED 1/2" FROM EDGE TO ALLOW FOR WINDOW NAILING
 REQUIRED ONLY @ OPENINGS WHERE SPECIFIED ON PLAN

TYPICAL EXT. WALL & INT. SHEARWALL OPENING ELEVATION SCALE: NTS



DRAG TRUSS DETAIL 3 DRAG TR

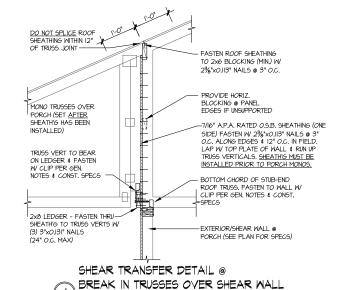

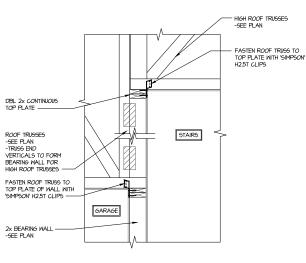

SCALE: 3/4"=1'-0" - 22x34 3/8"=1'-0" - 11x17

MULHERN+KULP RESIDENTIAL STRUCTURAL ENGINERING

Aulhern+Kulp project number 243-24030

SMK frawn by: SMN issue date: 11-07-24


REVISIONS: initial: 05-16-25 PER UPDATED ARCI JPP

pointe.

4

Ŋ DETAIL MODE FRAMING SERENITY MASTER SET RALEIGH, NC 5920-04


SD2.0

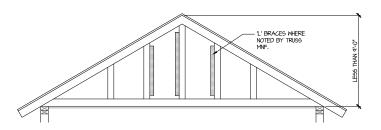

'L' BRACES FASTENED TO VERTICALS MEERE RECO'D BY TRUSS MANUFACTURER, FASTEN W 16d GUN NAILS (0.131 x 3 1/2") @ 6" O.C.

GABLE END TRUSS SHEATHED-WITH OSB.

FASTEN BOTTOM CHORD OF — GABLE END TRUSS TO DBL. TOP PLATE w/ 3"x0.120" (MIN.) TOE-NAILS & 8" O.C.

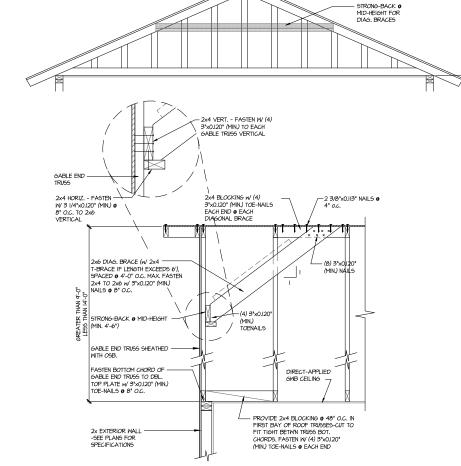

TYPICAL GABLE END BRACING DETAIL SCALE: NOME REQUIRED TRUSS REQ'D @ GABLE END TRUSS HEIGHT UP TO 9'-0'

BRACE GABLE END TRUSSES PER ABOVE DETAIL WHEN GABLE HEIGHT IS LESS THAN 9"-0". "L" BRACES REQUIRED WHERE NOTED BY TRUSS MANUFACTURER.

DIRECT-APPLIED GWB CEILING —

- PROVIDE 2x4 BLOCKING ● 48" O.C. IN FIRST BAY OF ROOF TRUSSES-CUT TO FIT TIGHT BETWN TRUSS BOT. CHORDS, FASTEN W (3) 3 J V4"x0.120" (MIN.) TOE-NAILS @ EACH END

BRACE GABLE END TRUSSES PER ABOVE DETAIL WHEN GABLE HEIGHT EXCEEDS 9'-0'. "L' BRACES NOT REQUIRED.

TYPICAL GABLE END BRACING DETAIL SCALE. NONE REQUIRE GABLE END TRUSS

REQ'D @ GABLE END TRUSS HEIGHT BETWN 9'-0" TO 14'-0"

MULHERN+KULP

RESIDENTIAL STRUCTURAL ENSINEERING

3005 Brodside Parkway, Sale 250 - Alphaenta, 9A 3002

p.778-777-6974 - markemizipacum

NC Licence # C-38.25

Mulhern+Kulp project number: 243-24030

SMK SMM drawn by: issue date: 11-07-24

REVISIONS: date: 05-16-25 PER UPDATED ARCH initial: JPP

tri pointe HOMES

FRAMING DETAILS

5920-04 MODEL SERENITY MASTER SET RALEIGH, NC

SD2.1