

HTE# SPLW1905-0001

Harnett County Department of Public Health

25988

PERMIT # NA

Operation Permit

New Installation Septic Tank Nitrification Line Repair Expansion

Name: (owner) Carlton Hinoat

PROPERTY LOCATION: 299 Thompson Rd (S2 2036)

System Installer: Yellow Dog Grading

SUBDIVISION _____ Registration # _____ LOT # _____

Basement with plumbing: Garage Number of Bedrooms NA

Type of Water Supply: Community Public Well

Distance from well NA feet **3606PD MAX**

System Type: 25% Reduction 3/11/16

Types V and VI Systems expire in 5 years.


(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

INSTALL 02/27/2020

PUMP & ALARM 08/11/2020

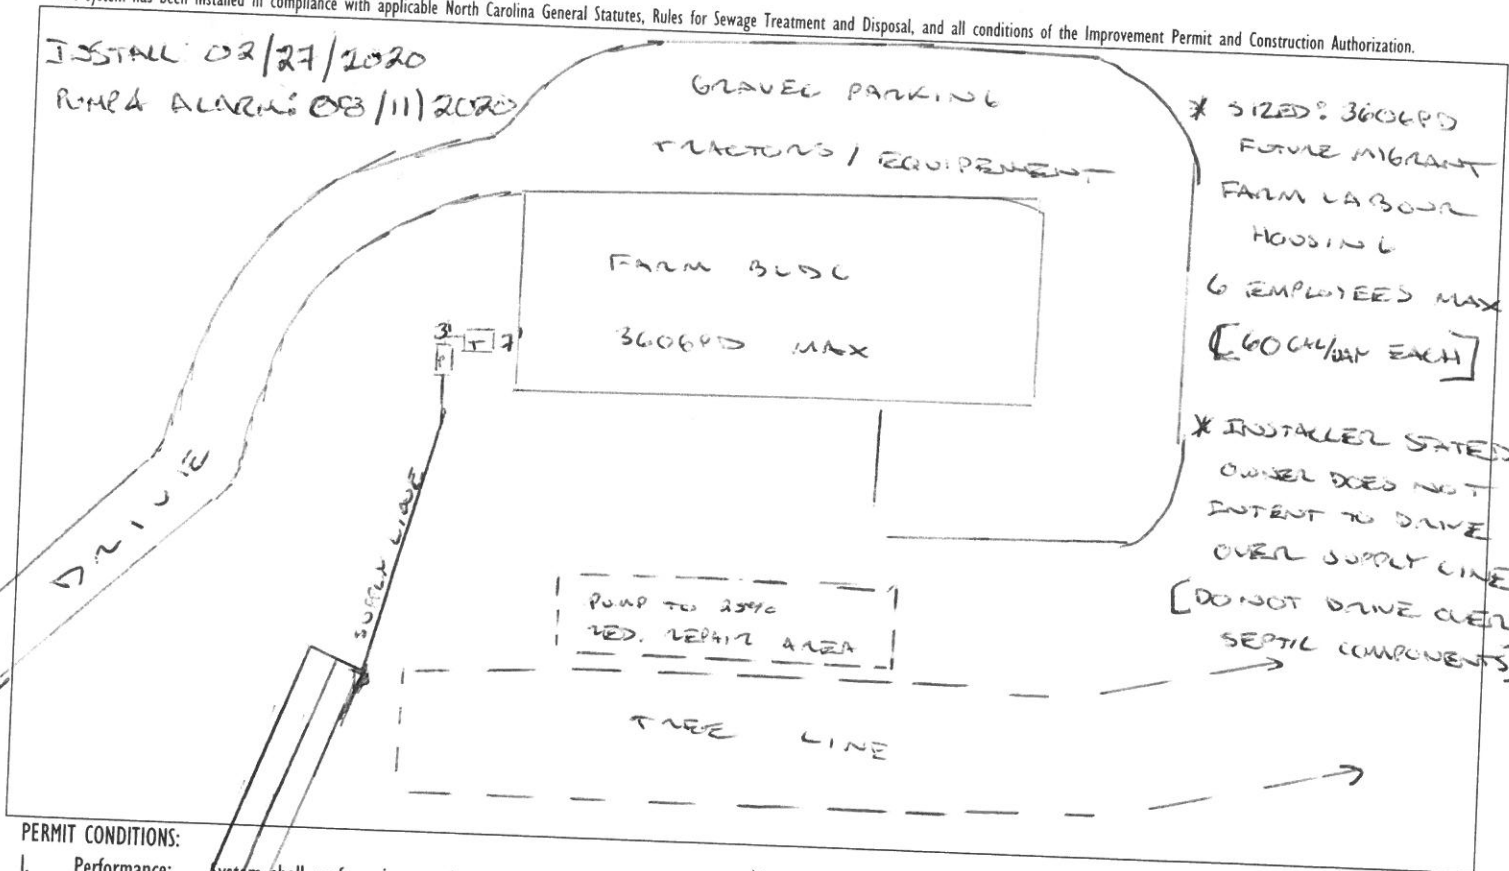

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes No

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____

D-Box Pump Alarm H2O Line PWR Line

Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: Conventional Other 04 Chambers 1116

Septic Tank: 1000 gallons Pump Tank: 1000 gallons

No. of exact length of each ditch 1 226 feet width of ditches 3 feet depth of ditches 24 inches

French Drain Required: _____ Linear feet

Authorized State Agent _____

Date 08/11/2020