

HTE# 07-57-17749

Harnett County Department of Public Health 19830

PERMIT # 23977

Operation Permit


☒ New Installation ☒ Septic Tank ☐ Repair ☒ Nitrification Line ☐ ExpansionPROPERTY LOCATION: SR 1415 Rauls CH RDName: (owner) Freeman's Construction Service SUBDIVISION Wigdon PLACE P42 LOT # 7System Installer: Jason Matthews Registration # _____Basement with plumbing: ☐ Garage ☒ Number of Bedrooms _____Type of Water Supply: ☐ Community ☒ Public ☐ Well Distance from well _____ feetSystem Type: 25% REDUCTION System Type III G Belay Types V and VI Systems expire in 5 years.

(In accordance with Table V a)

Owner must contact Health Department 6 months prior to expiration for permit renewal.

163

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal and all conditions of the Improvement Permit and Construction Authorization.

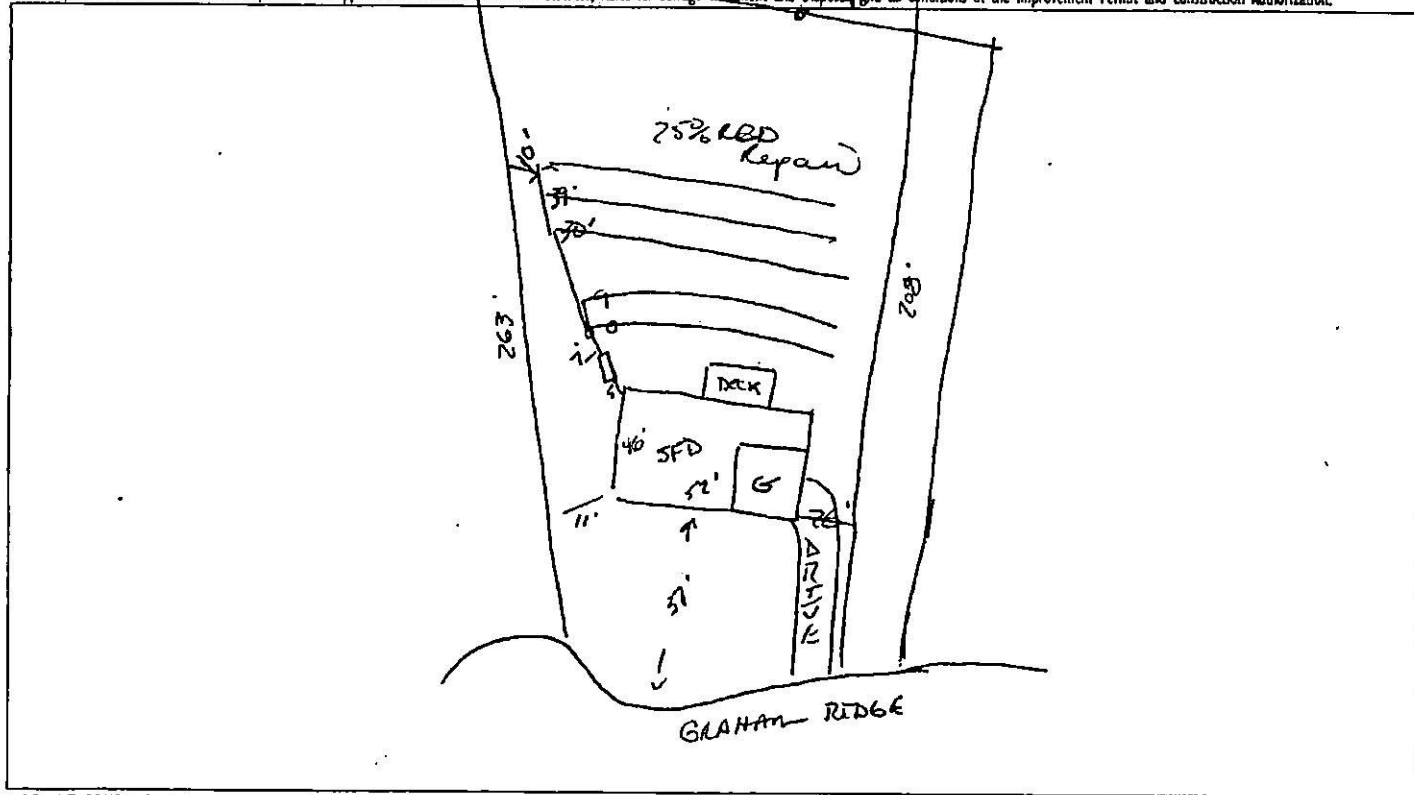

PERMIT CONDITIONS:

I. Performance: System shall perform in accordance with Rule .1961.

II. Monitoring: As required by Rule .1961.

III. Maintenance: As required by Rule .1961. Other: _____

Subsurface system operator required? Yes ☐ No ☐

If yes, see attached sheet for additional operation conditions, maintenance and reporting.

IV. Operation: _____

V. Other: _____


Following are the specifications for the sewage disposal system on the above captioned property.

Type of system: ☐ Conventional ☒ Other 25% REDUCTION Size of tank: Septic Tank: 1000 gallons Pump Tank: _____ gallonsSubsurface No. of exact length width of depth of
Drainage Field ditches 5 of each ditch 60 feet ditches 3 feet ditches 20 inches

French Drain Required: _____ Linear feet

Authorized State Agent

James E. MathesonDate 12-11-07

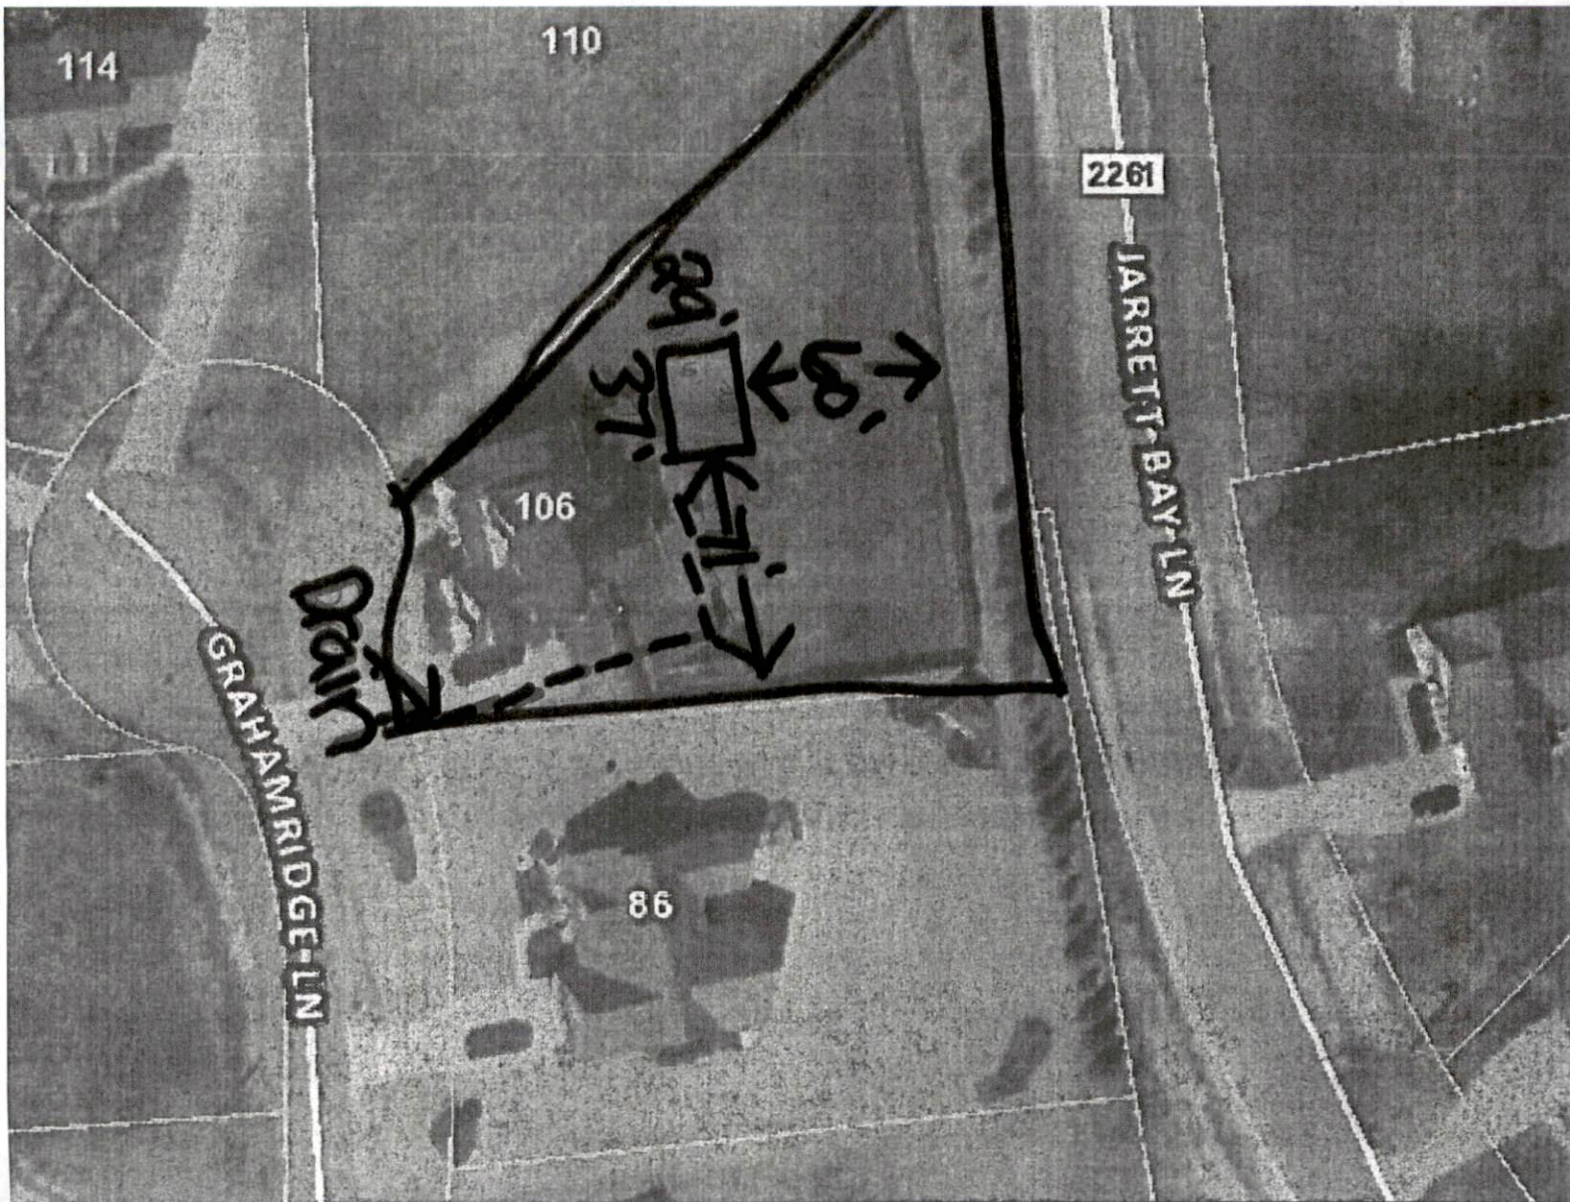

LEGEND



Recycle_Center



Landfills



Surrounding County Boundaries

Federal Property

16x30 Pool

17500
42190

SITE PLAN APPROVAL

DISTRICT

RA-30

USE

Swimming
POOL

#BEDROOMS

9/1/17

Zoning Administrator

X S. Bragg